


GENERAL NOTES

1. REFER TO M-001 FOR MECHANICAL ABBREVIATIONS, LEGEND, SYMBOLS, AND GENERAL NOTES.
2. COMPONENTS SHOWN HALF-TONE ON THIS DRAWING ARE ITEMS TO REMAIN; BOLD COMPONENTS ARE NEW.
3. GRAVITY PIPING MUST BE SLOPED IN DIRECTION OF FLOW AT 1/4" PER FOOT.

KEYED NOTES

- ① REFER TO M-402 FOR CONTINUATION.
- ② ROUTE HEADERED CONDENSATE DRAIN TO NEW CONDENSATE SOAK PIT AT GRADE. SLOPE ALL HORIZONTAL CONDENSATE PIPING DOWNWARD IN THE DIRECTION OF FLOW WITH 1% SLOPE. INSTALL HORIZONTAL PIPING MAXIMUM 24" ABOVE CONDENSATE PUMPS.
- ③ REFER TO DETAIL D1 ON M-504.

KEY PLAN

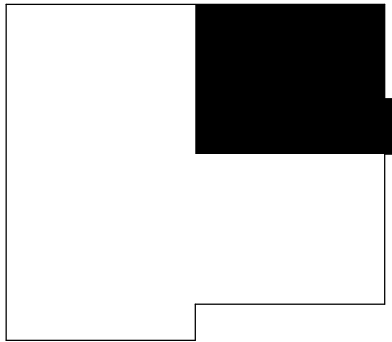

F2

M-414

MECHANICAL ENLARGED OPEN OFFICE NEW  
CONSTRUCTION PLAN - PIPING

SCALE: 1/8" = 1'-0"

0

4'

8'

16'

1/8" = 1'-0"

Sheet Title
MECHANICAL ENLARGED 2ND FLOOR OPEN OFFICE NEW CONSTRUCTION PLAN - PIPING
Dwg. No. PLM2021-0432-0022D
Sht. No. M-414