


- GENERAL NOTES**
- A. CONTRACTOR TO VERIFY EXTENT OF VAPOR EMISSION REDUCER PRIOR TO SLAB POUR. SEE SECTION 03 35 10.
- KEY NOTES**
1. VERIFY FIT DIMENSIONS WITH REQUIREMENTS OF ELEVATORS PROVIDED PRIOR TO LAYOUT OF STRUCTURAL SLAB.
2. AREA TO RECEIVE SECONDARY SLAB WITHIN RADIATION THERAPY VAULT. COORDINATE LOCATION OF IN-FLOOR RACEWAYS AND ROUTING OF SERVICES WITH EQUIPMENT VENDOR'S REQUIREMENTS PRIOR TO POURING SECONDARY SLAB TO ELEVATION 314'-9\"/>
3. APPROXIMATE LOCATION OF SUPPORT FRAME FOR LINEAR ACCELERATOR EQUIPMENT. COORDINATE WITH VENDOR.
4. AREA OF TEMPORARY SLAB/FUTURE RADIATION THERAPY VAULT SECONDARY SLAB. LOCATE TOP OF TEMPORARY SLAB AT ELEVATION 314'-9\"/>
5. LOCATION OF 4' HIGH HOUSEKEEPING PAD. COORDINATE FINAL DIMENSIONS AND LOCATIONS OF HOUSEKEEPING PADS WITH REQUIREMENTS OF EQUIPMENT SUPPLIER.
6. NEW OPENING THROUGH EXISTING FOUNDATION WALL 28\"/>
7. BLOCKOUT IN CONCRETE WALL FOR FUTURE MECHANICAL. LOCATE 50\"/>
8. NEW OPENINGS THROUGH EXISTING FOUNDATION WALL - 1\"/>
9. 2 HR RATED PARTITION. CONSTRUCT PARTITION CONSISTENT WITH UL DESIGN UL-441. USE GALVANIZED STRUCTURAL STUDS. PROVIDE TEMPORARY WEATHERPROOF ENCLOSURE OR CONSTRUCT SUCH THAT THE PARTITION MAY BE EXPOSED TO THE WEATHER DURING CONSTRUCTION WITHOUT COMPROMISING ANY COMPONENTS. PROTECT WALL FROM DAMAGE DURING CONSTRUCTION.
10. EXTERIOR GRADE HOLLOW METAL DOOR AND FRAME WITH 90 MINUTE RATING. PROVIDE DOOR BOTTOM SEAL, THRESHOLD AND GLOSER.
11. FIRE-SAFE GAP BETWEEN CONCRETE WALL AND COLUMN.
12. CAST-IN-PLACE CONCRETE WALL - SEE STRUCTURAL.
13. CAST-IN-PLACE CONCRETE COLUMNS TYPICAL - SEE STRUCTURAL.
14. LOCATION OF SEISMIC JOINT. PROVIDE FIRESAFING AND TEMPORARY WEATHER-TIGHT SEAL BETWEEN EXISTING FOUNDATION WALL AND NEW COLUMN.
15. HOLLOW METAL DOOR AND FRAME. PAINT TO MATCH ADJACENT DOORS IN EXISTING BUILDING - SEE DETAIL C5-A2/02.
16. PREFABRICATED METAL STAIR AND RAILING.
17. SEE DETAIL E3-A2/02 FOR 2ND FLOOR (CEILING) TOP OF SLAB ELEVATIONS.
18. LOCATION OF EXISTING STEPPED FOOTING - ELEVATION VARIES - SEE STRUCTURAL.
19. SAWCUT OPENING THROUGH EXISTING CONCRETE. TOP OF OPENING AT ELEVATION 321'-5\"/>

GIFFIN • BOLTE • JURGENS
ARCHITECTS
815 S.W. SECOND AVENUE, PORTLAND, OREGON 97204
(503) 223-0992 www.gbjarch.com FAX (503) 294-3961

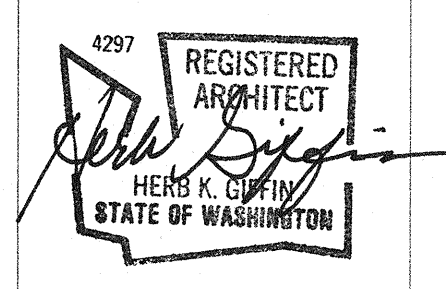

MultiCare
EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION
TACOMA, WASHINGTON

ADDENDUM #3	11-20-07
ADDENDUM #5	02-25-08
ADDENDUM #6	04-15-08
100% CD	09-26-08

Date 6-15-2007
Scale 1/8"=1'-0"
Drawn By JLC
Job No. 4034

1st Floor
Edge of Slab -
North

A2
11