
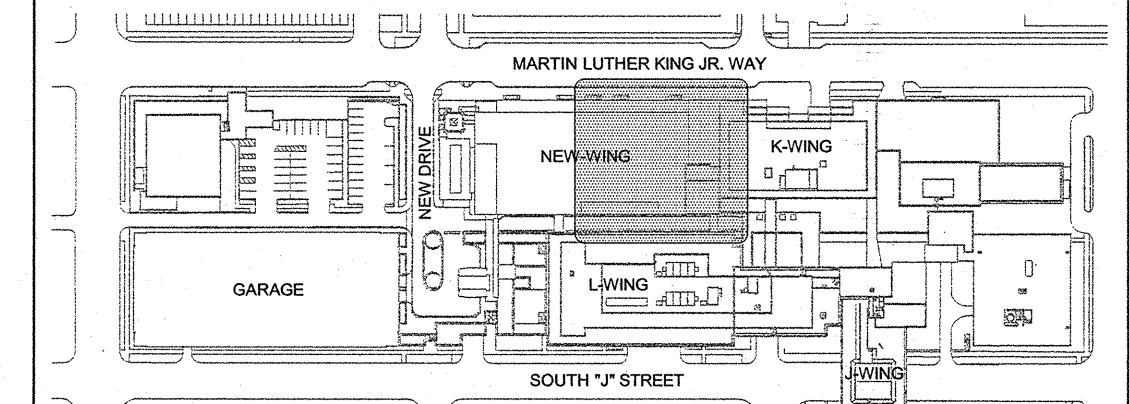


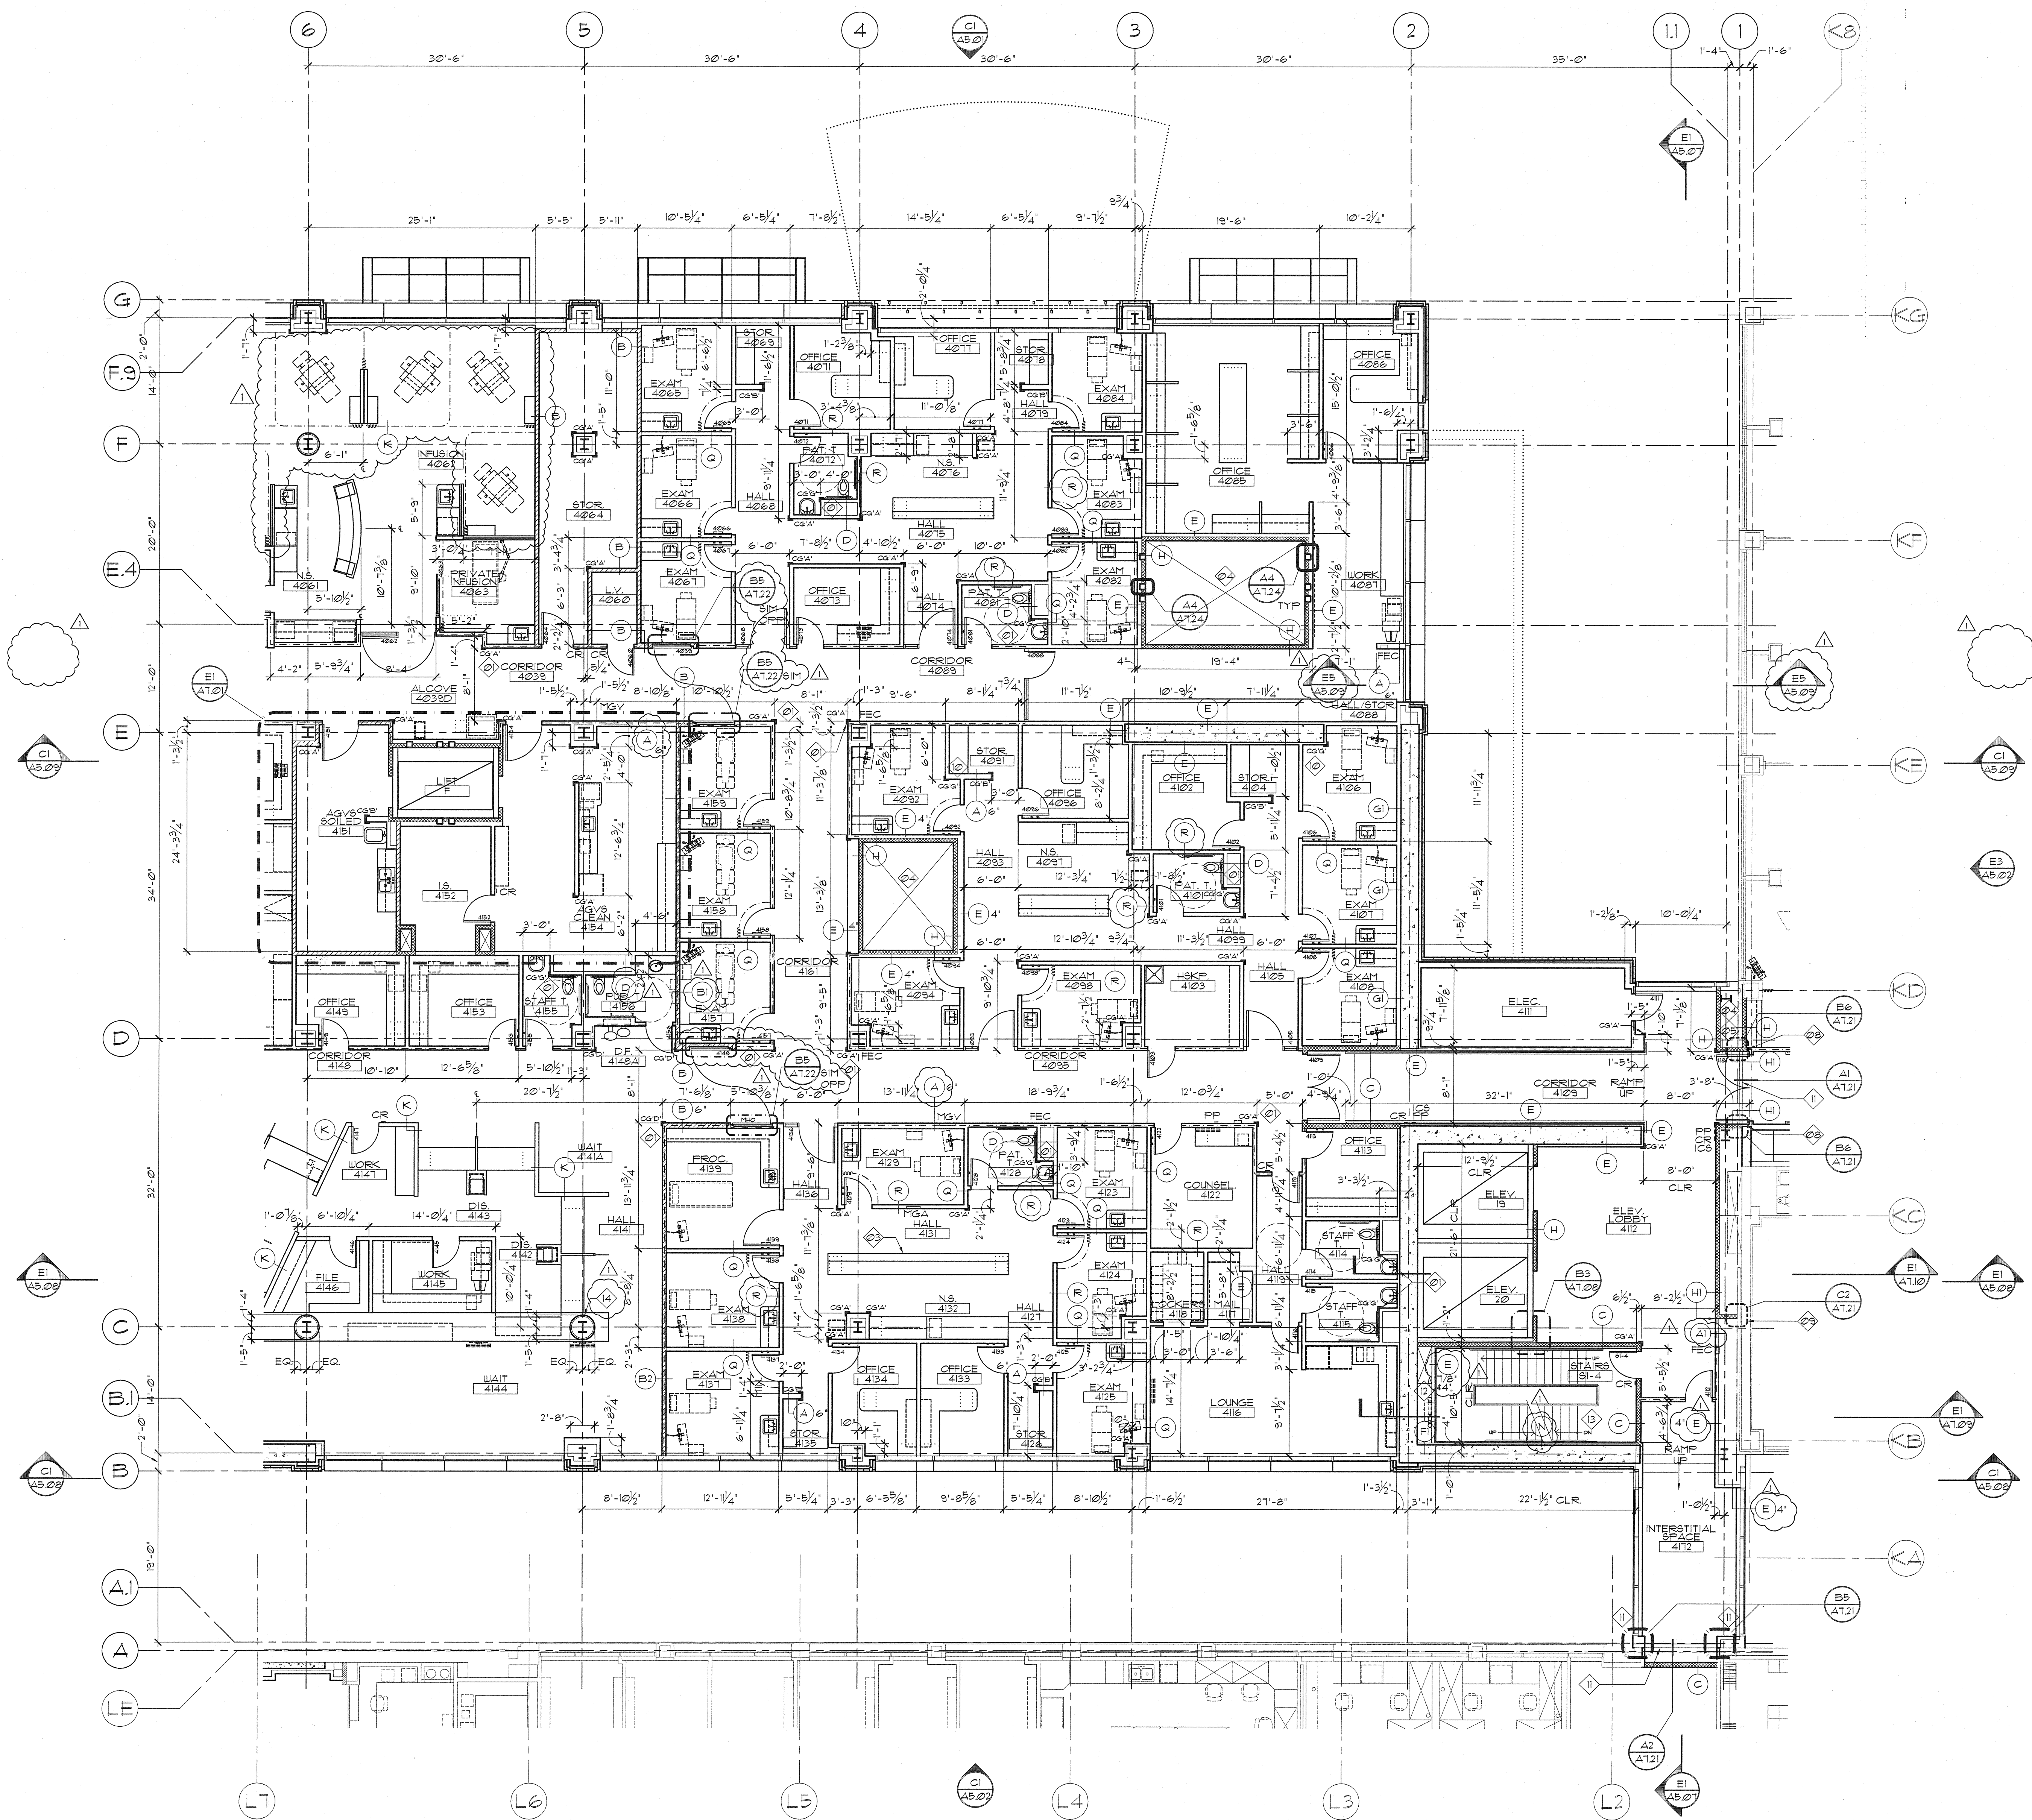

- GENERAL NOTES**
- ALL PARTITIONS TYPE 'A' UNLESS NOTED OTHERWISE. REFER TO WALL LEGEND FOR REQUIRED SMOKE PARTITION.
 - REFER TO E1/A120 FOR PARTITION TYPES.
 - REFER TO C6/A124 FOR TYPICAL PARTITION FRAMING AT STEEL COLUMNS.
 - SEE A2/14 FOR TOP OF SLAB ELEVATIONS AND EDGE OF SLAB DIMENSIONS.
 - REFER A5 AND A6 SERIES DRAWINGS FOR ALL EXTERIOR TARGETING AND DETAILS.
- KEY NOTES**
- CORNER GUARDS EXTEND FULL HEIGHT TO CEILING
 - CORNER GUARDS EXTEND TO 1'-4" AFF.
 - CASEWORK TO BE CENTERED ON NURSES STATION WALL BEYOND
 - SEE A2/14 FOR SHAFT OPENING DIMENSIONS. LOCATE FACE OF PARTITION & EDGE OF SLAB.
 - LOCATION OF SEISMIC SEPARATION. DO NOT ATTACH PARTITION FRAMING/NEW BUILDING MEP INFRASTRUCTURE TO EXISTING CONCRETE WALL.
 - JOINT COVER BOTH SIDES, NO FIRE BLANKET
 - JOINT COVER BOTH SIDES, FIRE BLANKET, 1 HR. FIRE RATING.
 - JOINT COVER (1) ONE SIDE, FIRE BLANKET, 2 HR. FIRE RATING.
 - NO JOINT COVER, FIRE BLANKET, 2 HR. FIRE RATING.
 - CORNER GUARDS EXTEND TO TOP OF WALL PROTECTION
 - JOINT COVER ONE SIDE, NO FIRE BLANKET, NON-RATED
 - RECESSED VALVE CABINET TYPE SVPI. SEE DETAIL A2/A124. SEE ALSO MECHANICAL.
 - METAL STAIR & RAILING "BIDDER ENGINEERED."
 - GFRG COLUMN COVER 30" INCHES IN DIAMETER UNLESS NOTED OTHERWISE

- WALL TYPES**
- CONCRETE WALL (EXIST.)
 - NON-RATED WALL (EXIST.)
 - 1 HR FIRE RATED WALL (EXIST.)
 - 1 HR FIRE/SMOKE RATED WALL (EXIST.)
 - 2 HR FIRE RATED WALL (EXIST.)
 - CONCRETE WALL (NEW)
 - NON-RATED WALL (NEW)
 - CMU WALL (NEW)
 - 1 HR FIRE RATED WALL (NEW)
 - 1 HR FIRE/SMOKE RATED WALL (NEW)
 - SMOKE PARTITION (NEW)
 - 2 HR FIRE RATED WALL (NEW)