


A
B
C
D
E

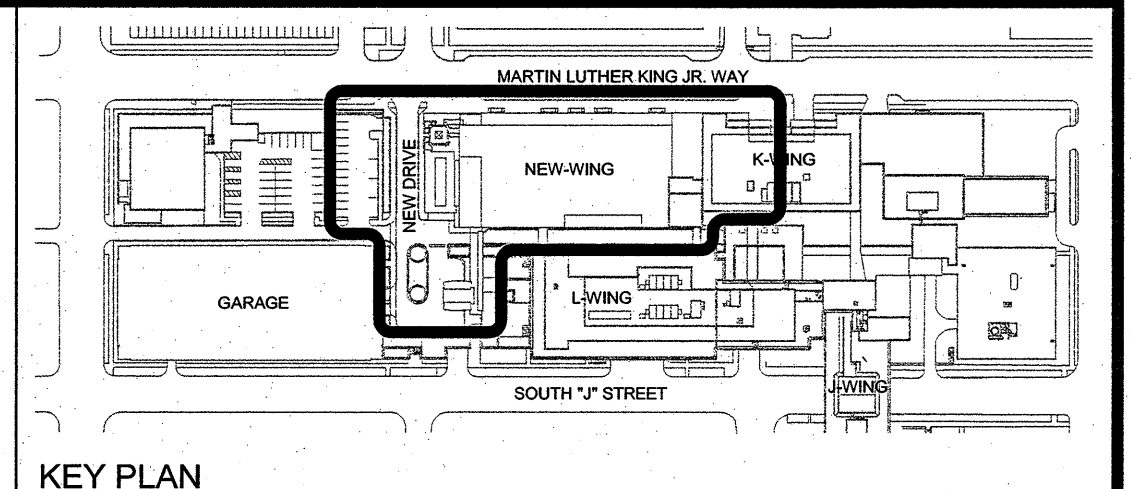


GENERAL NOTES

A. TOTAL OCCUPANTS OF NEW AND REMODELED AREAS = 6 (SEE SHEET FLS 07A)

B. TOTAL EXIT CAPACITY AVAILABLE TO OCCUPANTS = 165

- LEGEND**
- HORIZONTAL EXIT
 - EXIT ACCESS
 - EXIT DOOR
 - STAND PIPE (PROVIDE IN EACH REQUIRED STAIR)
 - AREA OF WORK
 - 2-HOUR FIRE BARRIER AT SHAFT/EXIT (106) STAIRS. DUCT PENETRATION: 90 MIN F/S DAMPER. DOOR: 90 MIN F/S AT SHAFT, 90 MIN F AT STAIR
 - 2-HOUR FIRE BARRIER AT HORIZONTAL EXIT (106). DUCT PENETRATION: 90 MIN F DAMPER. DOOR: 90 MIN F RATED
 - 2-HOUR FIRE BARRIER OCCUPANCY/SMOKE COMPARTMENT (106). DUCT: 90 MIN F/S DAMPER. DOOR: 90 MIN F/S RATED
 - 1-HOUR FIRE BARRIER OCCUPANCY SEPARATION. DUCT: 90 MIN F DAMPER. DOOR: 45 MIN F RATED
 - 1-HOUR FIRE BARRIER INCIDENTAL USE SEPARATION (TABLE 508.2). DUCT: 90 MIN F/S DAMPER. DOOR: 45 MIN F/S RATED
 - 1-HOUR SMOKE BARRIER / SMOKE COMPARTMENT (109). DUCT: 90 MIN F/S DAMPER. DOOR 20 MIN F/S RATED
 - SMOKE PARTITION AT SUITE BOUNDARY (110). DUCT: SEALED AROUND NO DAMPER (110.1). DOOR: NON-RATED (401.3.1)
 - SMOKE PARTITION AT CORRIDOR (110). DUCT: SEALED AROUND NO DAMPER (110.1). DOOR: NON-RATED (401.3.1)
 - INCIDENTAL USE - 1-HOUR (TABLE 508.2) (NFPA 103.2.1)
 - INCIDENTAL USE - SMOKE (TABLE 508.2)

GIFFIN • BOLTE • JURGENS
ARCHITECTS
815 S.W. SECOND AVENUE • PORTLAND, OREGON 97204
(503) 223-0992 www.gbjarch.com FAX (503) 294-3961

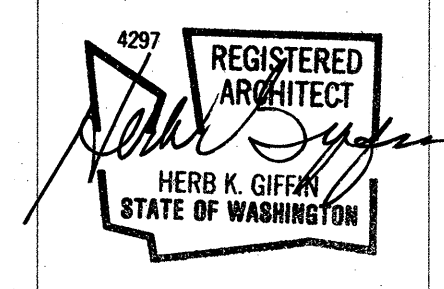

MultiCare
EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION
TACOMA, WASHINGTON

△ CCD 04 12-17-2008
△ CCD 07 02-20-2009

Date 09-26-2008
Scale 1" = 20'-0"
Drawn By JLC
Job No. 4034

**7th Floor
Fire & Life Safety**

**FLS
07**