



1
53.30
1/8"=1'-0"

ELEVATION

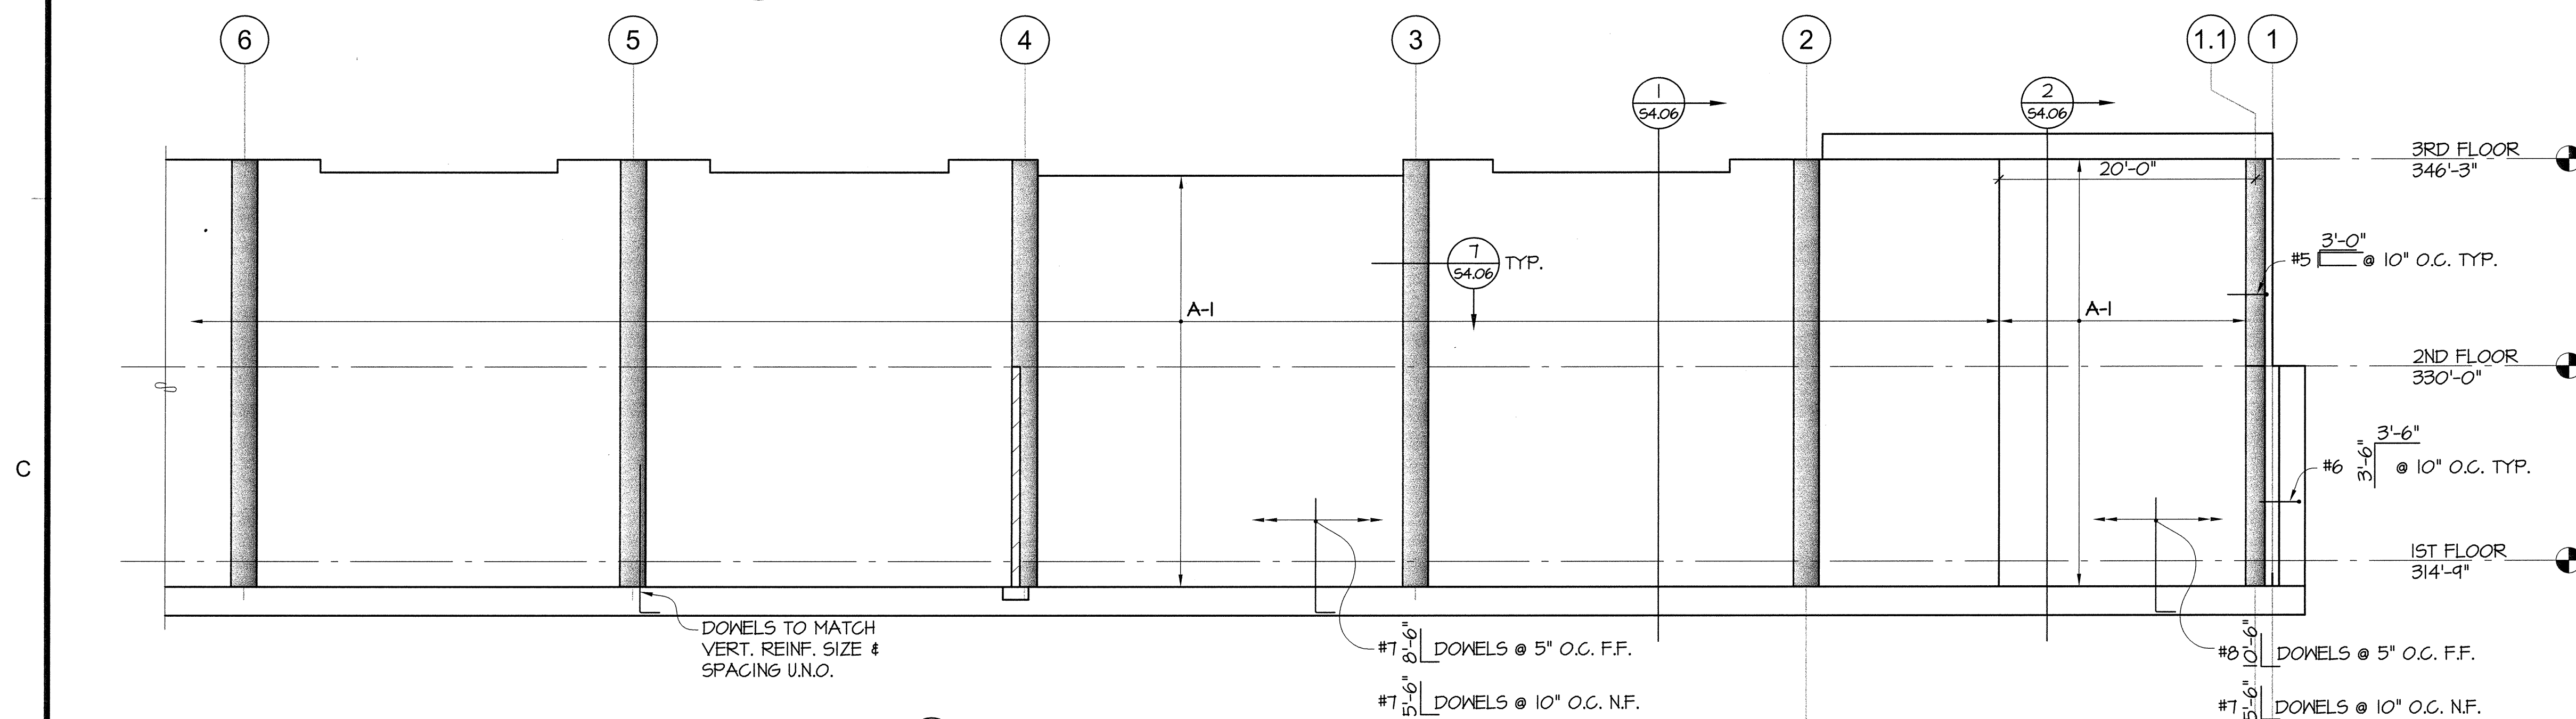


2
53.30
1/8"=1'-0"

ELEVATION

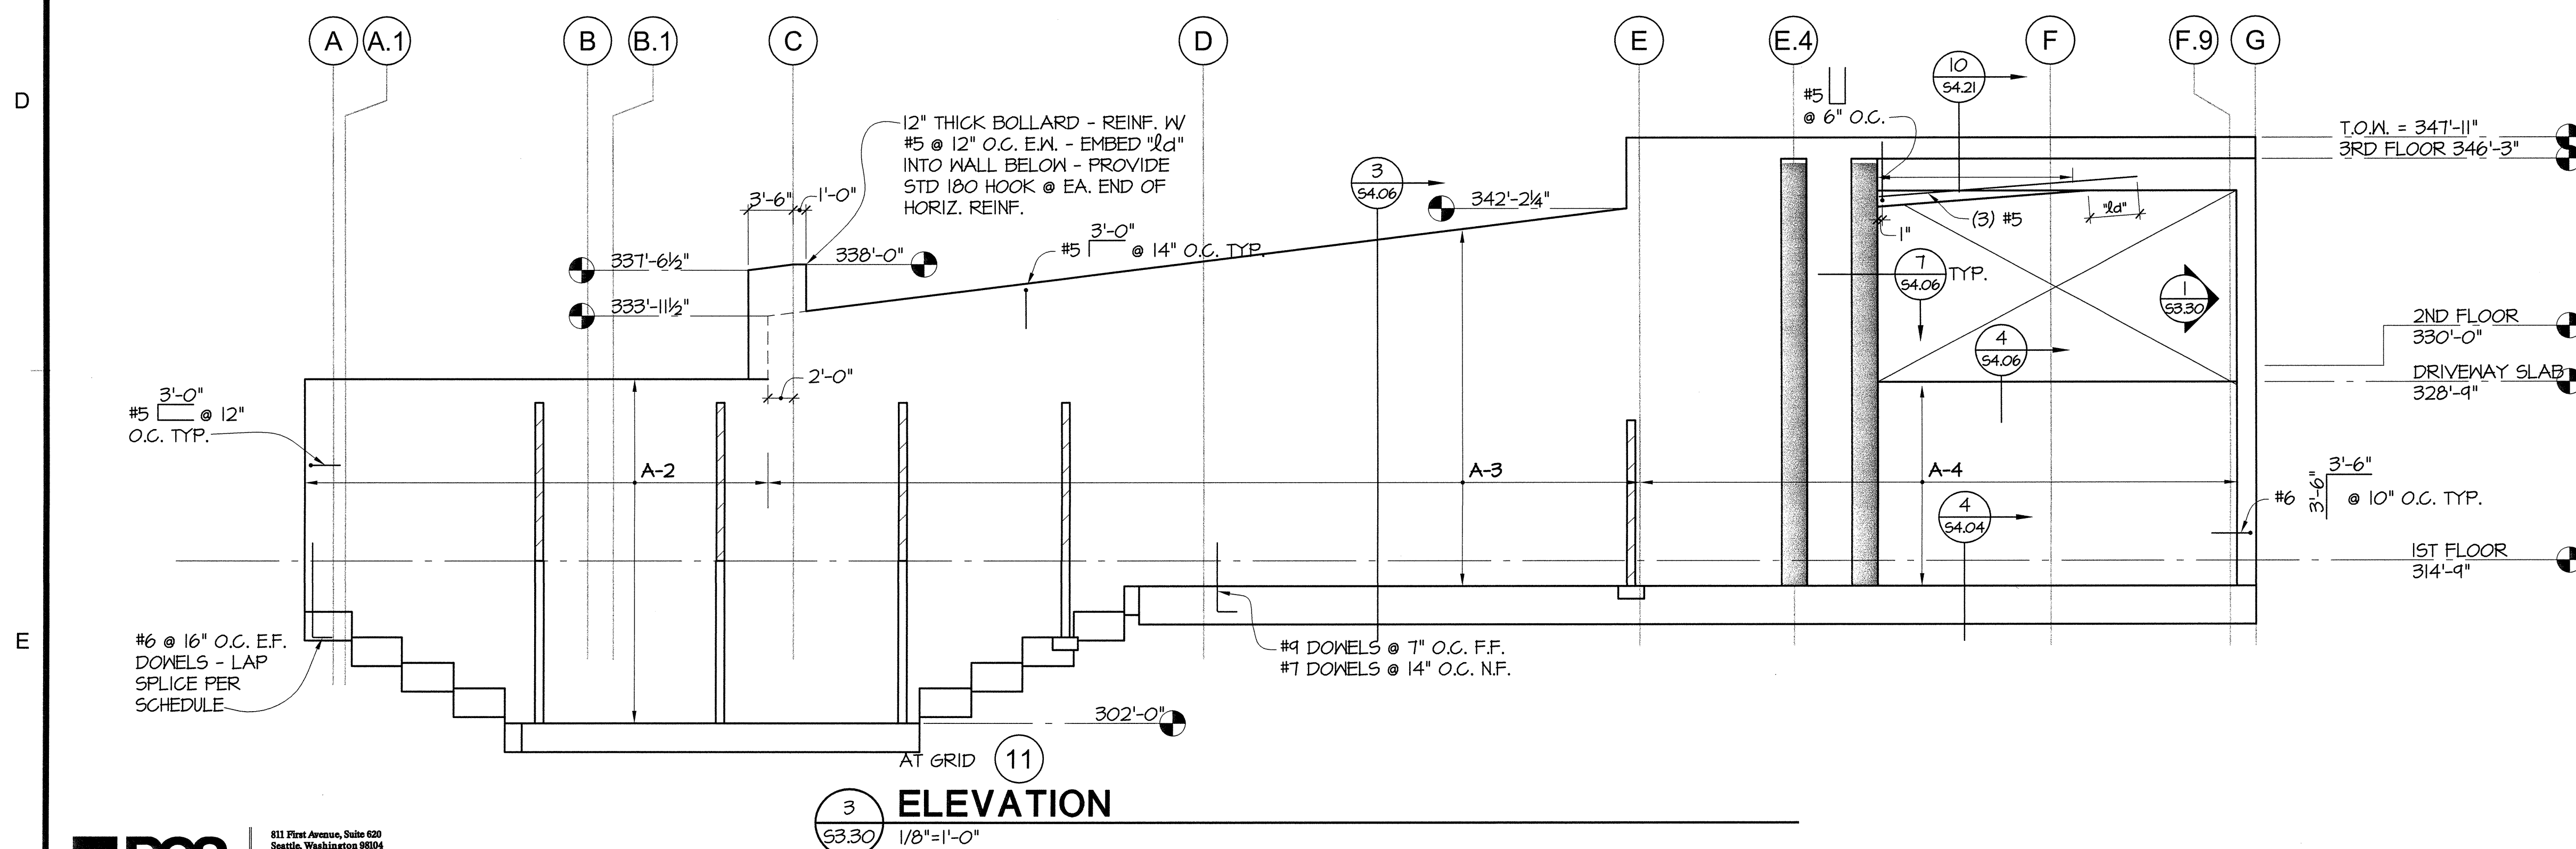


3
53.30
1/8"=1'-0"

ELEVATION

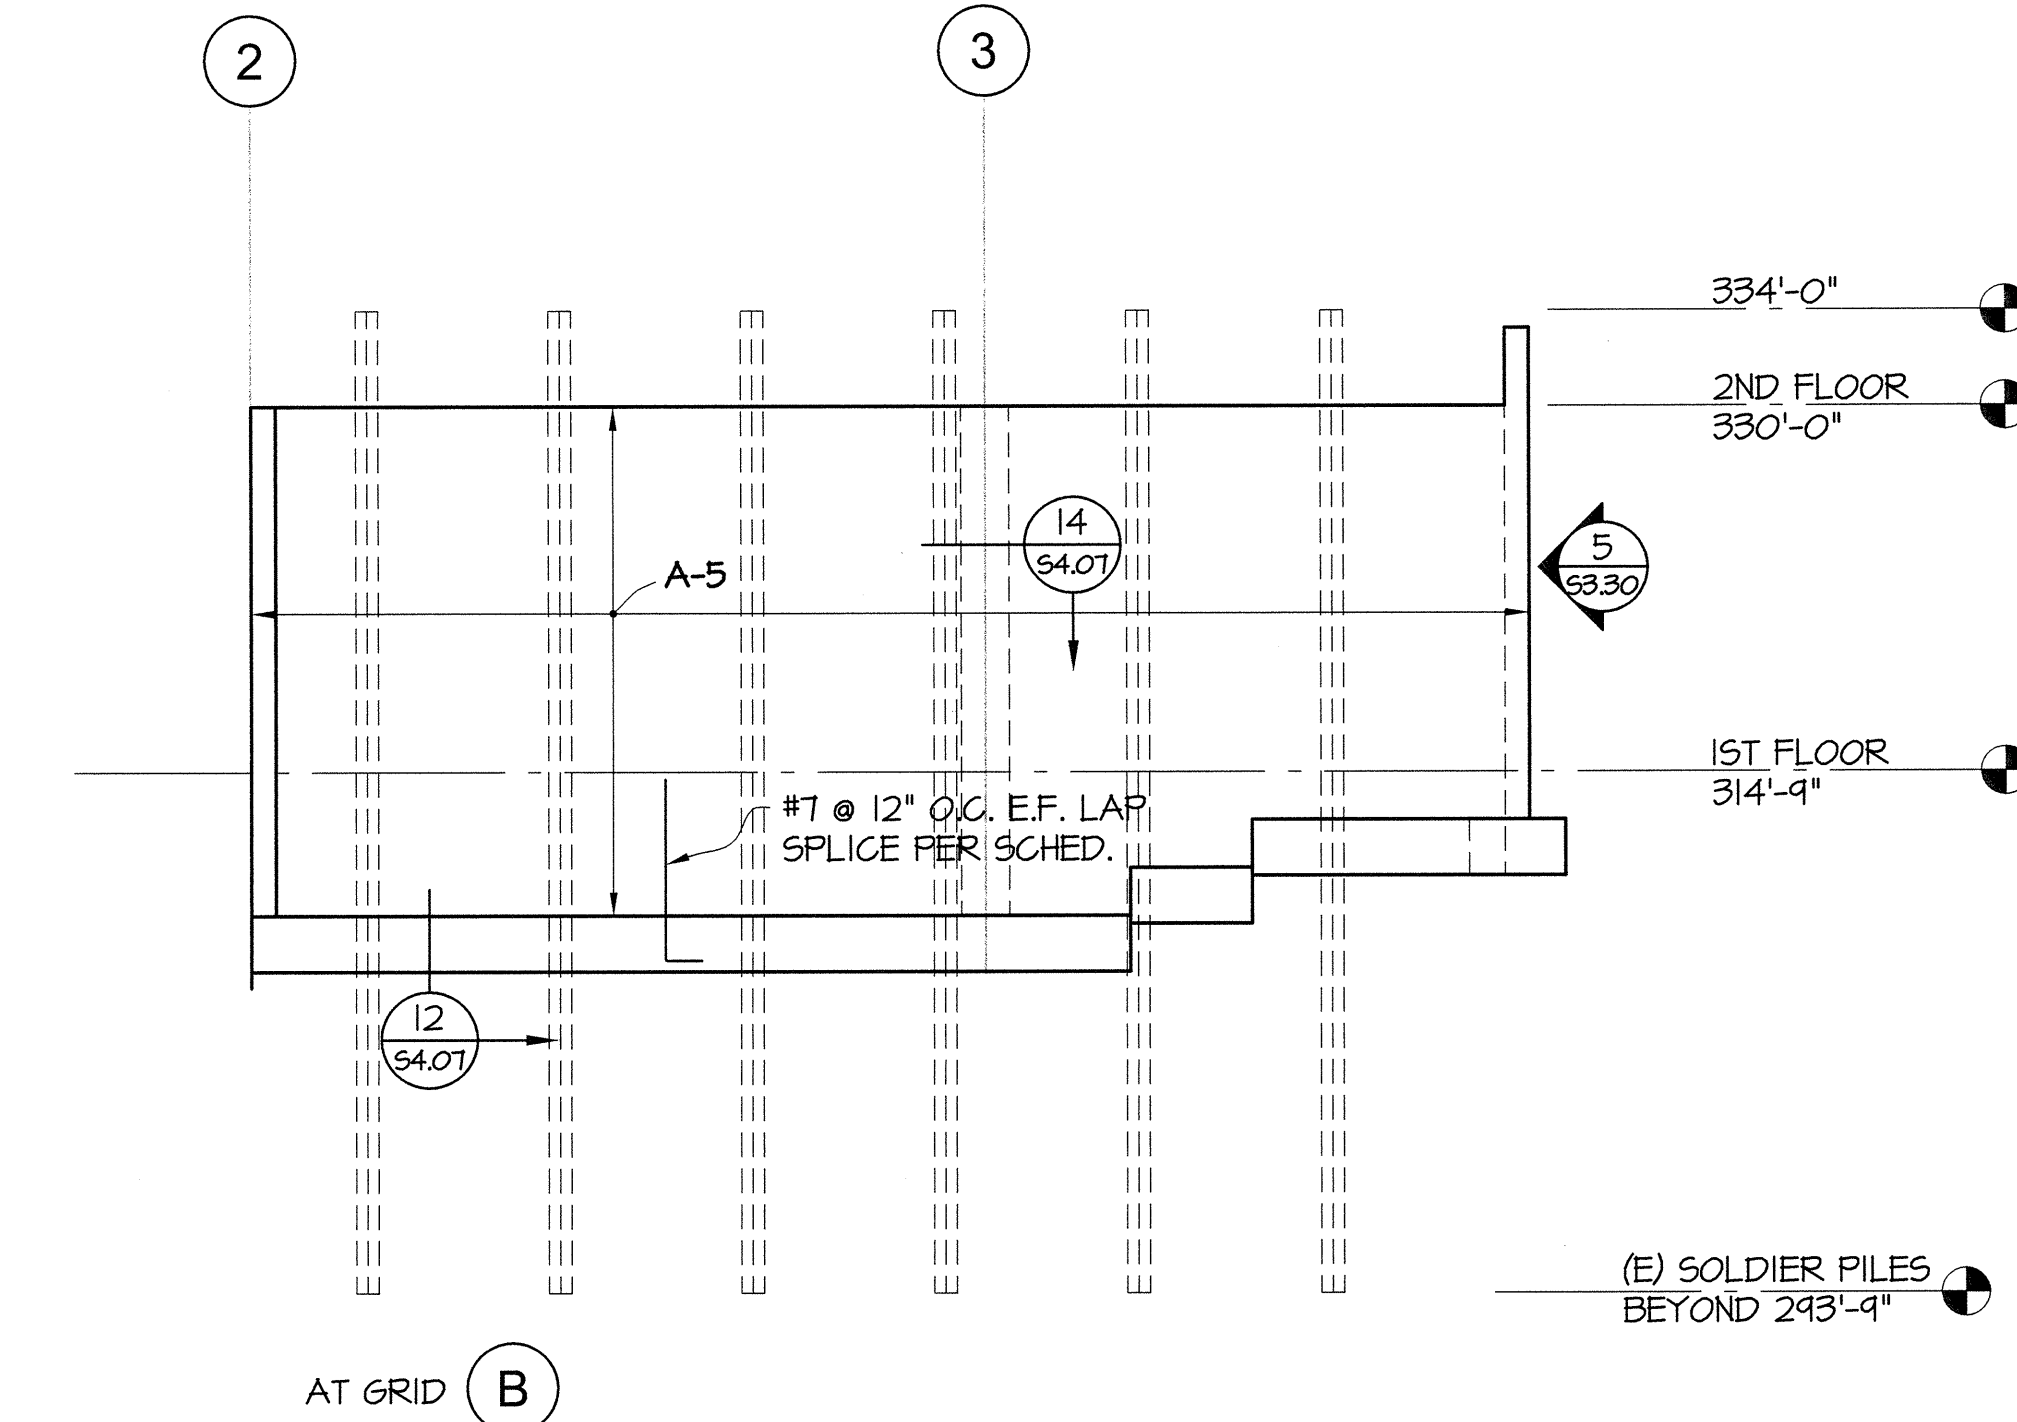


4
53.30
1/8"=1'-0"

ELEVATION

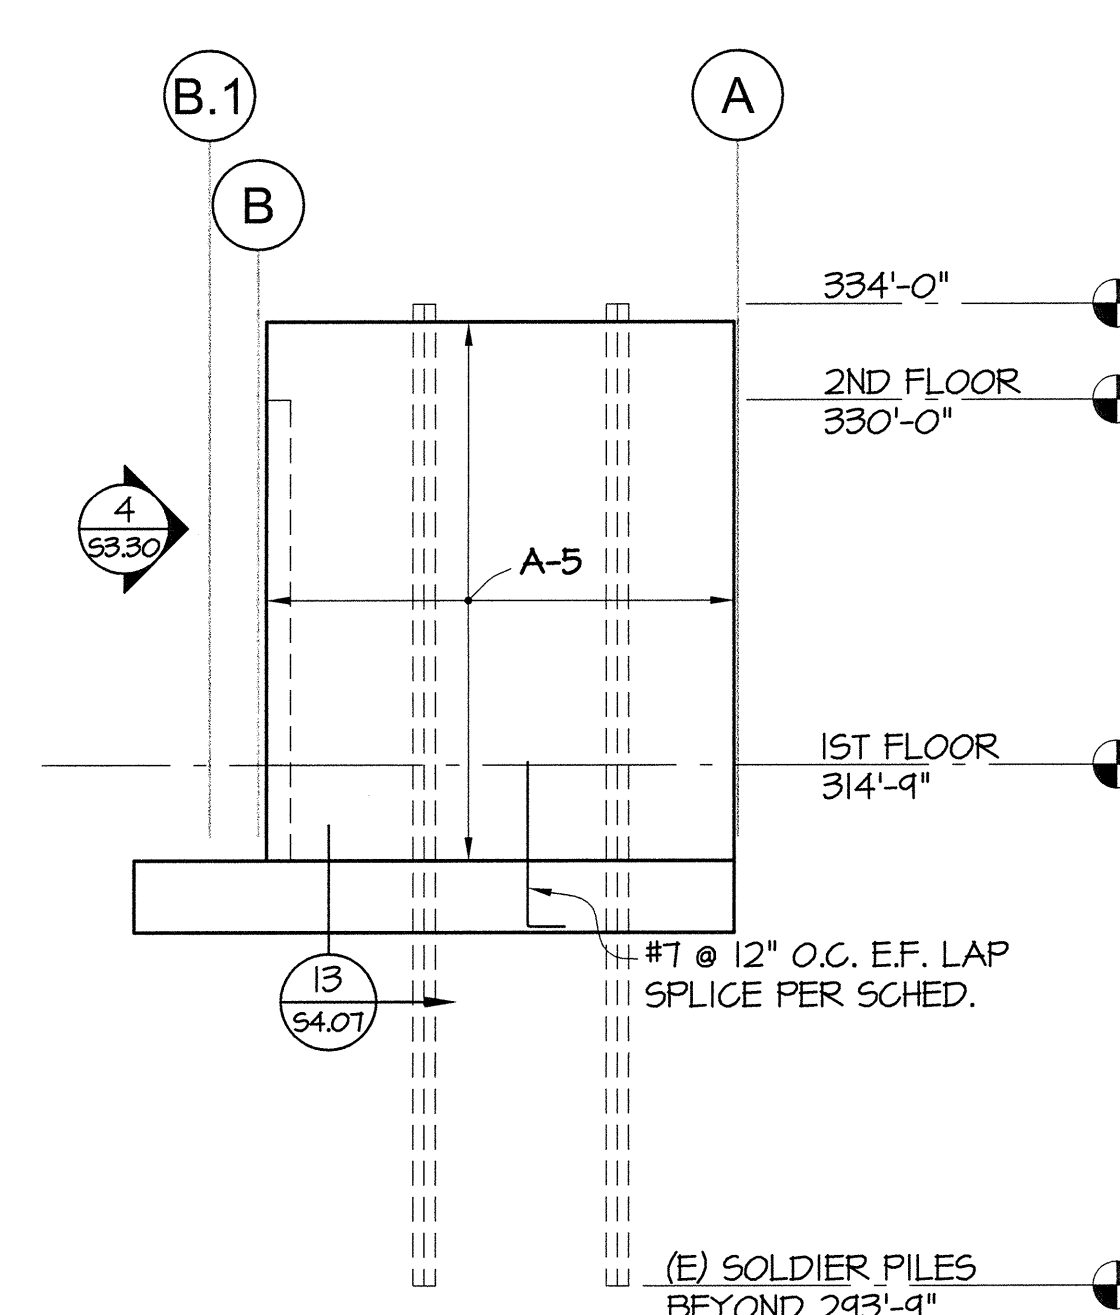

5
53.30
1/8"=1'-0"

ELEVATION

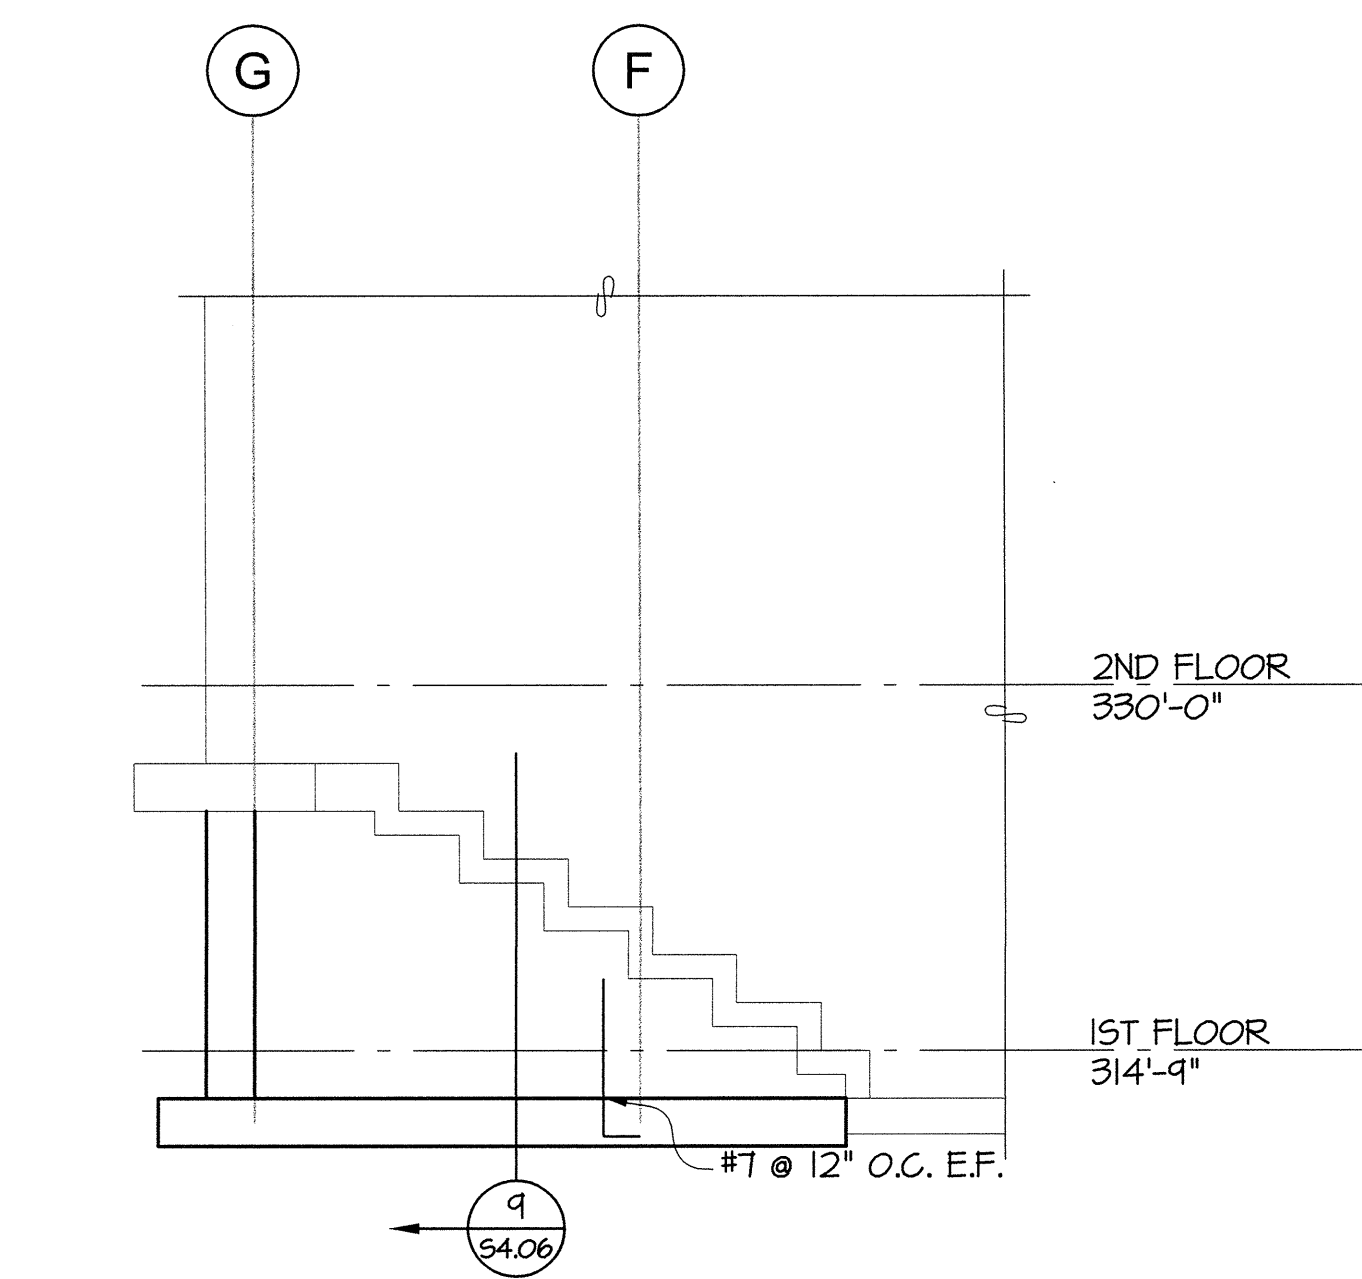

6
53.30
1/8"=1'-0"

ELEVATION

CONCRETE WALL REINFORCEMENT SCHEDULE			
MARK	HORIZ.	VERTS.	REMARKS
A-1	#6 @ 10" O.C. EA. FACE	#7 @ 10" O.C. EA. FACE	
A-2	#6 @ 12" O.C. EA. FACE	#6 @ 16" O.C. EA. FACE	
A-3	#6 @ 12" O.C. EA. FACE	#4 @ 7" O.C. F.F. #7 @ 14" O.C. N.F.	
A-4	#6 @ 12" O.C. EA. FACE	#6 @ 16" O.C. EA. FACE	
A-5	#5 @ 12" O.C. EA. FACE	#7 @ 12" O.C. EA. FACE	

SHEAR WALL SPLICE SCHEDULE			
BAR SIZE	CONFINED VERT. REINF.	UNCONFINED VERT. REINF.	HORIZ. REINF.
#4	1'-3"	2'-0"	2'-8"
#5	1'-6"	2'-6"	3'-4"
#6	1'-10"	3'-0"	4'-0"
#7	2'-8"	4'-6"	5'-10"
#8	3'-1"	5'-2"	6'-8"
#9	3'-6"	5'-10"	7'-6"
#10	3'-11"	6'-6"	8'-6"
#11	4'-4"	7'-3"	9'-5"

SPLICE SCHEDULE NOTES:
1. SEE SECTION CUTS FOR REINFORCING LAYOUT.

NOTES:

1. TOP OF WALL VARIES, SEE PLAN.

2. CONCRETE WALL VERTICAL AND HORIZONTAL ALIGNMENT TOLERANCE SHALL BE 1/4 INCH FROM THEORETICAL.

3. SEE 54.50 FOR EMBED PLATE DETAILS.

4. SEE 54.21 & 54.40 FOR TYPICAL WALL TO SLAB CONNECTION DETAILS.

5. VERTICAL BAR SPLICES ARE OPTIONAL, CONTRACTORS COORDINATE.

6. "A-X" INDICATES AREA OF CONCRETE SHEAR WALL. VERTICAL AND HORIZONTAL REINFORCEMENT SEE SCHEDULE.

7. INDICATES COLUMN. SEE COLUMN SCHEDULE FOR REIN. AND DOWELS