


GENERAL NOTES:

1. REFER TO FOUNDATION PACKAGE FOR FLOOR CLEANOUT INDICATED AS EXISTING.

- KEY NOTES:**
- 4" W. UP.
 - 2" W. UP.
 - 2" V. UP.
 - 2" W. DOWN.
 - 2" W. UP TO D2.
 - 2" V. DOWN.
 - 2" W. DOWN.
 - ELECTRIC TRAP PRIMER. SEE M7.01 FOR CONNECTION TO COLD WATER PIPING.
 - 4" RWL UP, 5.8400.
 - PROVIDE DRIP PANS UNDER WASTE LINES IN ELECTRICAL ROOMS. PROVIDE DWV COPPER PIPING WITH SOLDERED JOINTS.
 - 6" AT 0.5% SLOPE, 5.8400.
 - 2" FLOOR CLEANOUT FOR FUTURE SINK CONNECTION.
 - DISCONNECT HEAT TRACE SYSTEM FOR EXISTING 6" CW RISER.
 - INSULATE AND HEAT TRACE PIPING IN PARKING AREA.
 - 2" W. UP TO D10.
 - ROUTE 3" WASTE DOWN TO FLOOR DRAIN AND TERMINATE WITH AIR GAP. PROVIDE EQUIPMENT TAG INDICATING DRAIN SERVICE. ELEVATOR PIT DRAIN.
 - POST INDICATOR VALVE EXTENDED UP THROUGH SLAB INTO ABOVE ADJACENT TO ALLEY. SEE CIVIL DRAWINGS. PROVIDE INDICATOR SWITCH TO ACTIVATE A WALL MOUNTED STROBE LOCATED NEAR THE FUEL FILL MONITOR PANEL AND THE VALVE HANDLE. STROBE ACTIVATED WHEN VALVE IS CLOSED. AFTER 30 MINUTES (ADJUST) A ALARM SIGNAL SHALL BE SENT TO THE DDC SYSTEM THAT THE VALVE IS STILL CLOSED. PROVIDE SIGNAGE FOR STROBE "STORM DRAIN VALVE CLOSED."

GIFFIN • BOLTE • JURGENS, P.C.
A R C H I T E C T S
815 S.W. SECOND AVENUE, PORTLAND, OREGON 97204
(503) 223-0992 www.gbja.com FAX (503) 224-3561

CDI ENGINEERS
2200 - 15th S.W. Suite 200
PORTLAND, OREGON 97201
T 426.692.1071 F 426.778.8180
www.CDIENGINEERS.com

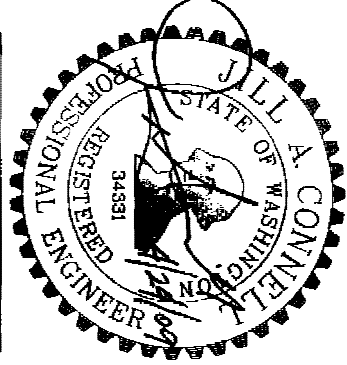

MultiCare
EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION
TACOMA, WASHINGTON

△ CCD 04 (RFI 0289)	12-17-08	Date	09-26-2008
△ RFI 100.0001	01-21-09	Scale	1/8"=1'-0"
△ CCD 11	04-24-09	Drawn By	CDI
		Job No.	4034

1ST FLOOR PLAN - NORTH - PLUMBING
M2
11