

4TH FLOOR PLAN - SOUTH - HVAC
SCALE: 1/8"=1'-0"

KEY NOTES:


- 1 LAMINAR FLOW DIFFUSER EQUIPPED WITH HEPA FILTER, CD9-400.
- 2 LOW WALL EXHAUST, EG10-600 AT 6" ABOVE FINISHED FLOOR.
- 3 PRESSURE SENSOR THROUGH WALL. MOUNT ABOVE DOOR.
- 4 ROOM PRESSURE MONITOR READOUT. SEE CONTROL DIAGRAM AND BALANCING NOTE ON DWG M11.02.
- 5 TU-401.
- 6 TU-402.
- 7 TU-403.
- 8 TU-404.
- 9 TU-405.
- 10 TU-406.
- 11 TU-407.
- 12 TU-408.
- 13 TU-409.
- 14 TU-410.
- 15 TU-411.
- 16 TU-412.
- 17 TU-413.
- 18 TU-414.
- 19 TU-415.
- 20 TU-416.
- 21 TU-417.
- 22 TU-418.
- 23 TU-419.
- 24 TU-420.
- 25 TU-421.
- 26 TU-422.
- 27 TU-424.
- 28 TU-425.
- 29 TU-427.
- 30 TU-431.
- 31 CD2-120.
- 32 RG1-110.
- 33 CD2-110.
- 34 20x20 UP TO [EF-4A].
- 35 CD9-340, 3 TYPICAL.
- 36 CD2-220.
- 37 16" UP TO [EF-11].
- 38 EG2-270.
- 39 EG4-900.

GIFFIN • BOLTE • JURGENS *p.c.*
ARCHITECTS

815 S.W. SECOND AVENUE, PORTLAND, OREGON 97204
(503) 223-0992 www.gbjarch.com FAX (503) 294-3961

CDI ENGINEERS

4200 - 194th St SW, Suite 200
Lynnwood, WA 98036
T 425.672.1071 F 425.778.8769
www.CDIENGINEERS.com

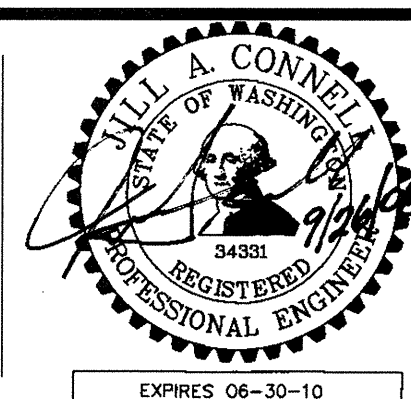

MultiCare

EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION

TACOMA, WASHINGTON

Date 09-26-2008
Scale 1/8"=1'-0"
Drawn By CDI
Job No. 4034

4TH FLOOR
PLAN - SOUTH -
HVAC

M4
04