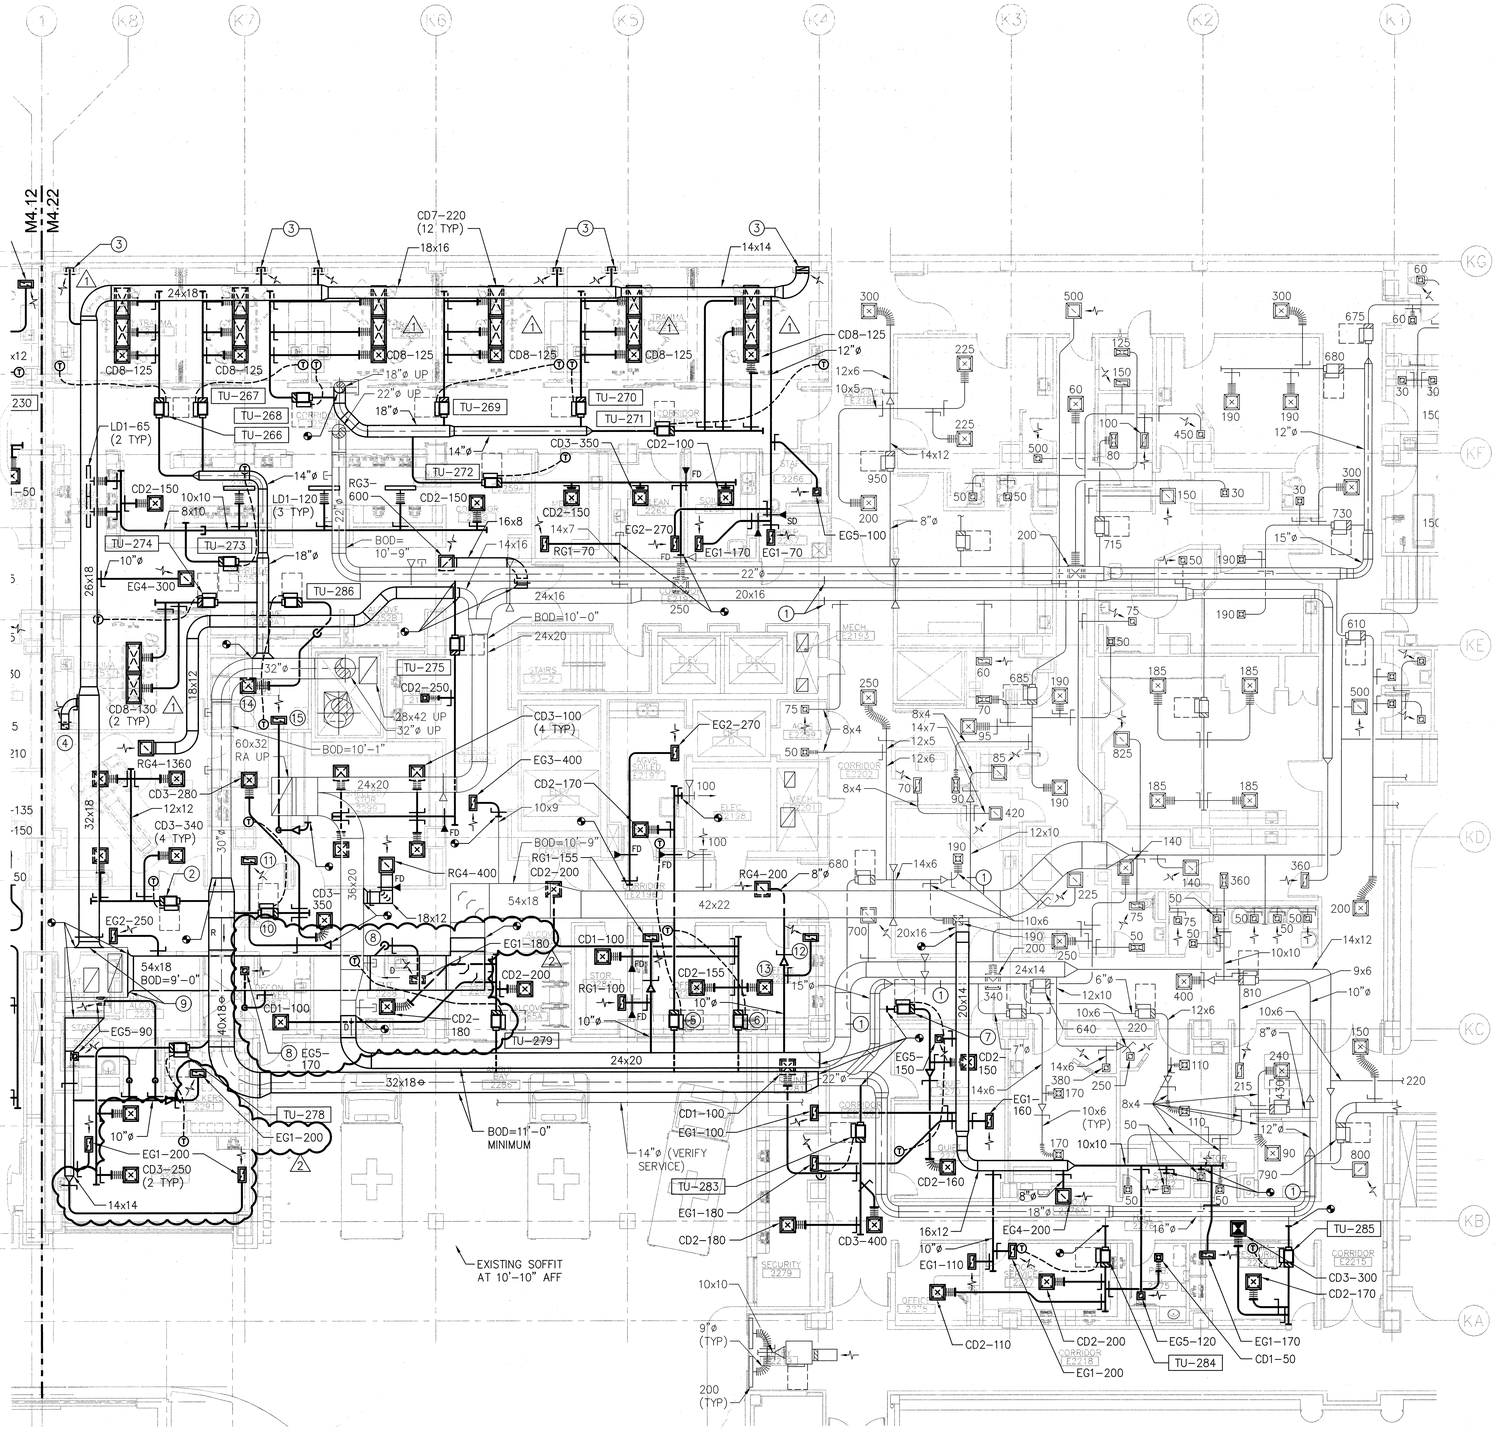

2ND FLOOR PLAN - K WING REMODEL - HVAC

SCALE: 1/8"=1'-0"

GENERAL NOTES:

1. AIRFLOWS FOR EXISTING TERMINAL UNITS INDICATED.

KEY NOTES:

1. AIR BALANCE CONTRACTOR TO REBALANCE BRANCH DUCTS TO PRE-CONSTRUCTION AIRFLOWS, SEE M122. PROVIDE BALANCE DAMPERS AS REQUIRED.
2. TU-276 .
3. 20x6 EXHAUST DUCT DOWN IN CHASE. LOCATE EG7-465 AT 6" ABOVE FINISHED FLOOR AND PROVIDE VOLUME DAMPER AT GRILLE.
4. 20x6 EXHAUST DOWN IN CHASE. LOCATE EG7-510 AT 6" ABOVE FINISHED FLOOR AND PROVIDE VOLUME DAMPER AT GRILLE.
5. TU-280 .
6. TU-281 .
7. TU-282 .
8. INSTALL EXHAUST DUCT WITH A MINIMUM OF TWO ELBOWS.
9. PROVIDE BELLMOUTH FITTINGS, TYPICAL.
10. TU-277 .
11. RG2-280.
12. RG1-155.
13. CD2-155.
14. CD4-500.
15. RG3-500.

GIFFIN • BOLTE • JURGENS p.c.
ARCHITECTS
815 S.W. SECOND AVENUE · PORTLAND, OREGON 97204
(503) 223-0992 www.gbjarch.com FAX (503) 294-3961

CDiENGINEERS
4200 - 194th St SW, Suite 200
Lynnwood, WA 98036
T 425.672.1071 F 425.778.8769
www.CDIENGINEERS.com

JILL A. CONNELLY — STATE OF WASHINGTON — 24838 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 06-30-10

MultiCare

EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION

TACOMA, WASHINGTON

CCD 04	12-17-08	
CCD 07	2-20-09	

Date	09-26-2008
Scale	1/8"=1'-0"
Drawn By	CDi
Job No.	4034

2ND FLOOR PLAN - K WING REMODEL - HVAC

M4
22

H:\2008\2008-4034 Multicare TI\Dwg\M4\22-M4122.dwg, 7/10/2009 1:57:26 PM, kkuh