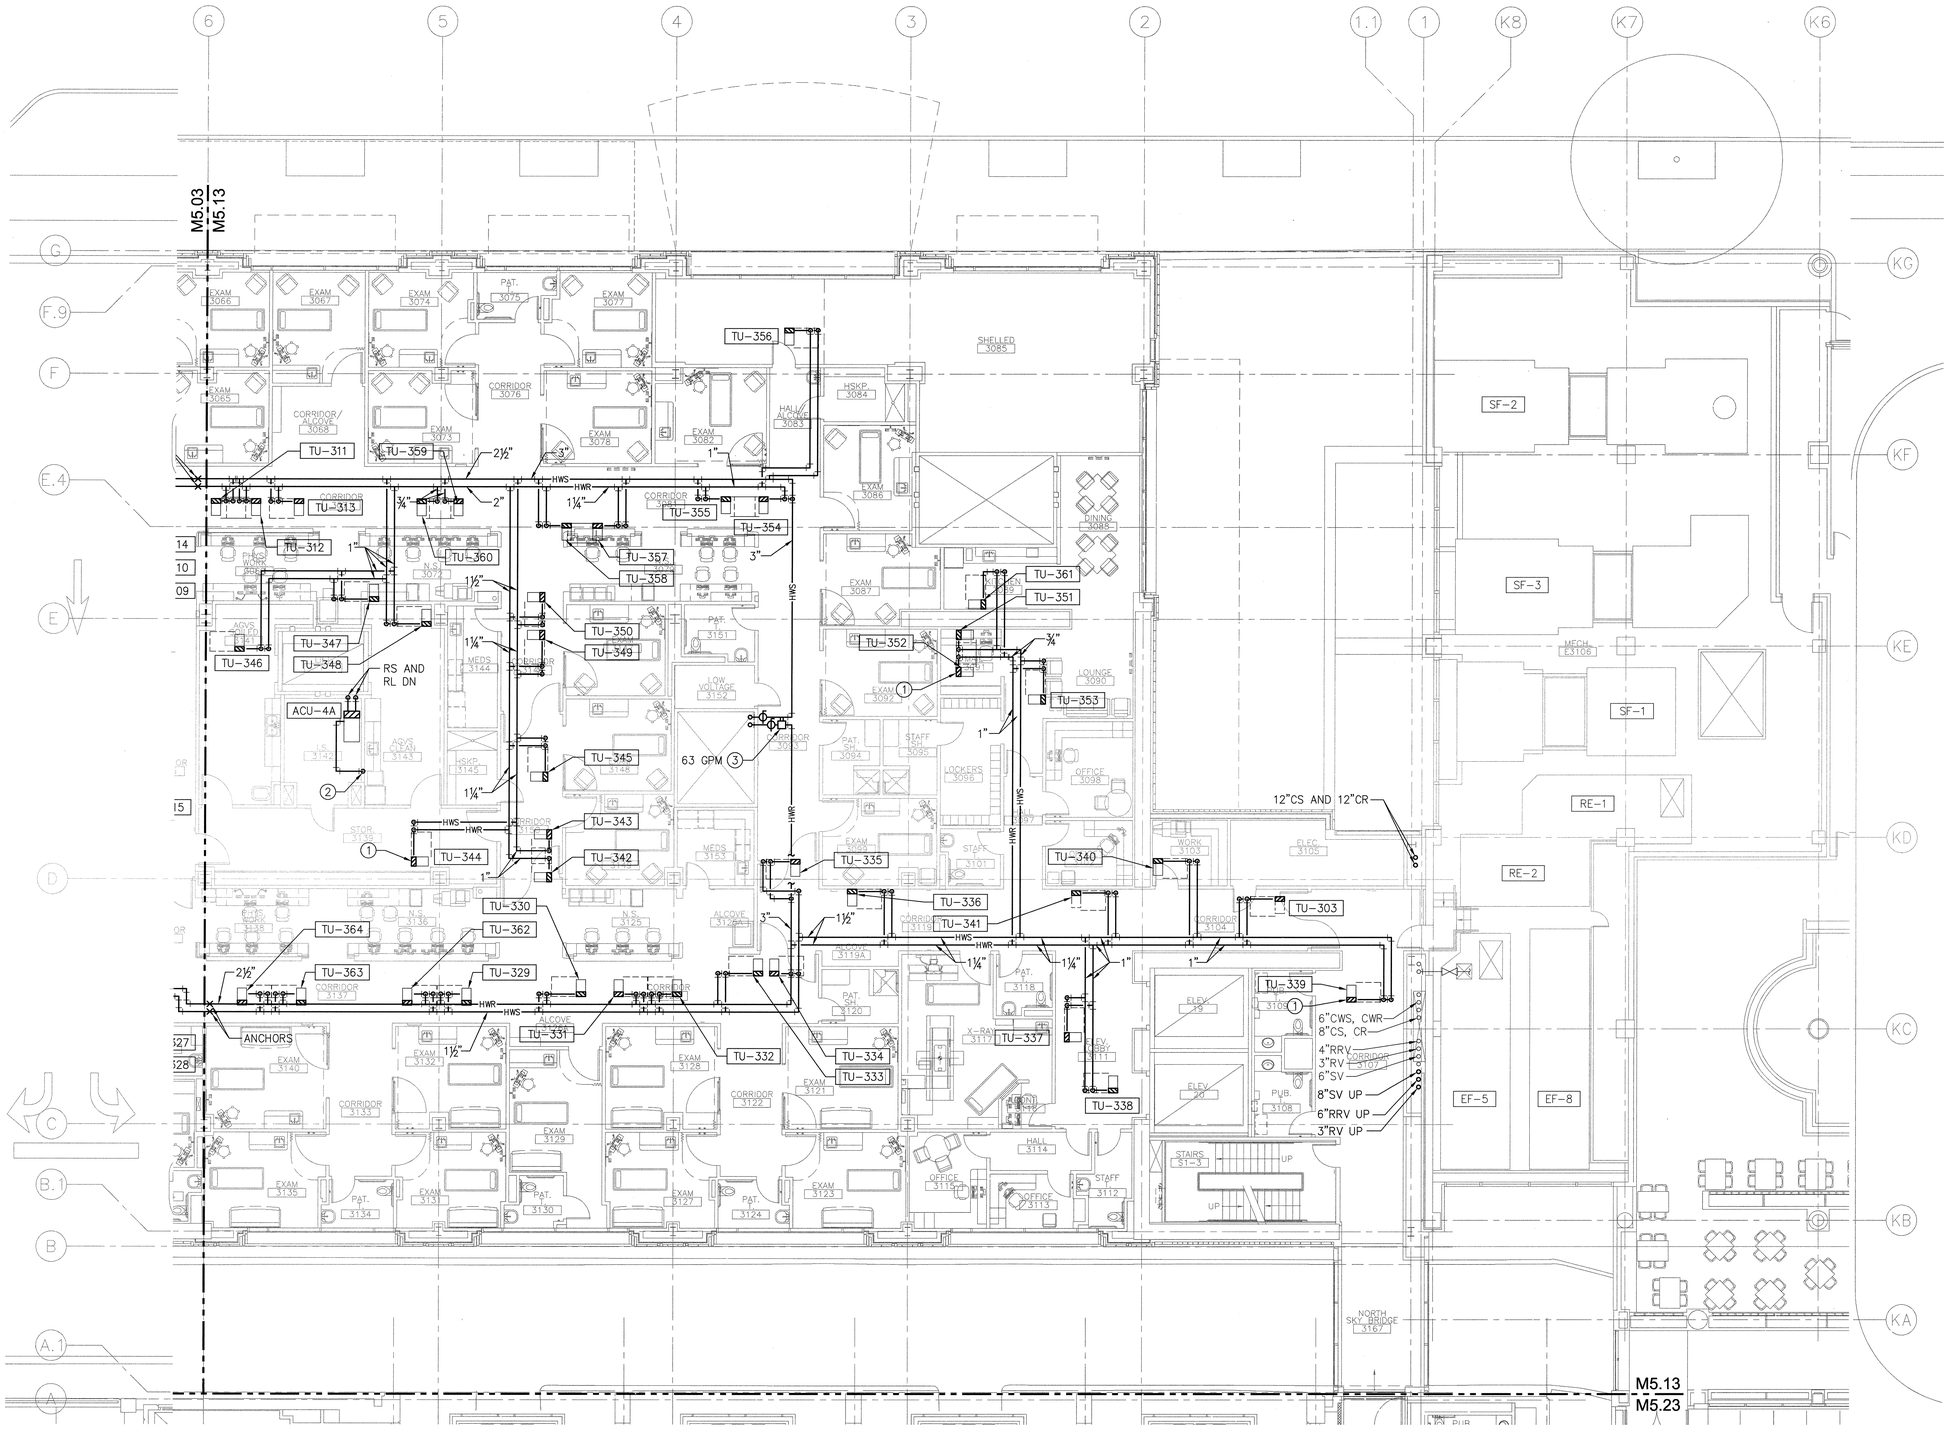

3RD FLOOR PLAN - NORTH - HVAC PIPING

SCALE: 1/8"=1'-0"

GENERAL NOTES:

1. TERMINAL UNITS SHALL BE PIPED WITH TWO-WAY CONTROL VALVES UNLESS NOTED OTHERWISE ON PLANS. SEE DETAIL 1 ON M10.05.

KEY NOTES:

(1) PIPE TERMINAL UNIT HEATING COIL WITH 3-WAY CONTROL VALVE, SEE DETAIL 1 ON M10.05.

(2) 1"ID DOWN IN WALL. SEE M2.13 AND DETAIL 7 ON M10.05.

(3) 80% DIVERSITY APPLIED TO FLOWRATE.

GIFFIN • BOLTE • JURGENS p.c.
ARCHITECTS
815 S.W. SECOND AVENUE · PORTLAND, OREGON 97204
(503) 223-0992 www.gbjarch.com FAX (503) 294-3961

CDiENGINEERS
4200 - 194th St SW, Suite 200
Lynnwood, WA 98036
T 425.672.1071 F 425.778.8769
www.CDiENGINEERS.com

ALLEN CONNELL — STATE OF WASHINGTON — 34331 — REGISTERED PROFESSIONAL ENGINEER — 9/26/08
EXPIRES 06-30-10

MultiCare

EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION

TACOMA, WASHINGTON

Date	09-26-2008
Scale	1/8"=1'-0"
Drawn By	CDi
Job No.	4034

3RD FLOOR PLAN - NORTH - HVAC PIPING

M5
13