


6TH FLOOR PLAN - NORTH - FIRE PROTECTION

SCALE: $\frac{1}{8}"=1'-0"$

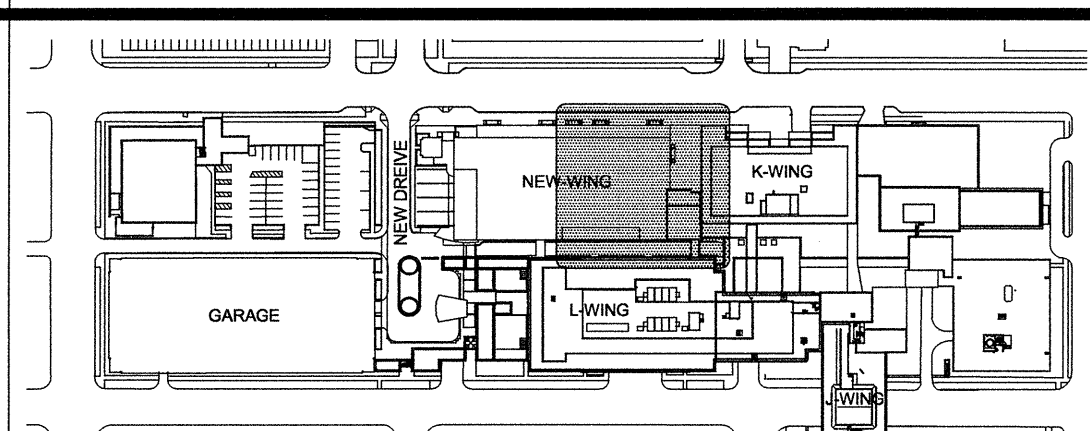

- KEY NOTES:**

- ① COMBINATION STAND PIPE.
- ② 2" TEST DRAIN.
- ③ PROVIDE SPRINKLER ZONE VALVE ASSEMBLY AND HOSE VALVE IN RECESSED CABINET AT MID STAIR LANDING.
- ④ MODIFY EXISTING FIRE SPRINKLER SYSTEM TO ACCOMMODATE CHANGES TO FLOOR PLANS, WALLS AND CEILINGS. REPLACE ALL EXISTING SPRINKLER HEADS WITH NEW QUICK RESPONSE HEADS, REFER TO PROJECT SPECIFICATIONS FOR FURTHER INFORMATION.

