


1 SECOND FLOOR PLAN K-WING REMODEL - LIGHTING
SCALE: AS INDICATED

0 4 8 16 24
feet

GIFFIN • BOLTE • JURGENS
ARCHITECTS

815 S.W. SECOND AVENUE - PORTLAND, OREGON 97204
(503) 233-0692 www.gbjarch.com FAX (503) 294-3961

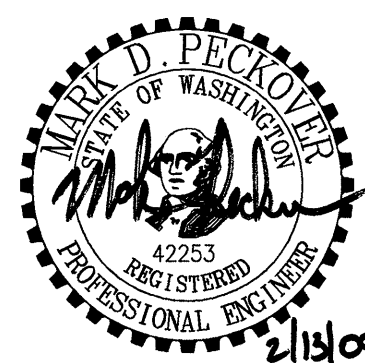

MultiCare

EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION

TACOMA, WASHINGTON

100% CD SET 9/26/08
CCD #4 12/17/08
CCD #7 2/20/09

Date 09-26-2008
Scale AS INDICATED
Drawn By JL
Job No. 4034

SECOND FLOOR
PLAN K-WING
REMODEL -
LIGHTING

E2
22

GENERAL NOTES

1. SEE ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT FIXTURE LOCATIONS.
2. SEE ARCHITECTURAL ELEVATIONS FOR MOUNTING HEIGHTS FOR WALL MOUNTED FIXTURES.
3. COORDINATE FIXTURE LOCATIONS IN AREAS WITH DUCTWORK AND PIPING WITH EXPOSED CEILINGS. ADJUST LOCATIONS AS REQUIRED FOR ACTUAL FIELD CONDITIONS.
4. SUPPORT LIGHTS IN ACCORDANCE WITH UBC 1632 AND 1634 SEISMIC ZONE REQUIREMENTS.
5. WHERE SWITCHES ARE SHOWN GROUPED, PROVIDE A COMMON BACKBOX WITH BARRIERS AS REQUIRED BY NEC AND COMMON SEAMLESS FACEPLATES.
6. IN ROOMS WITH 3-LAMP FIXTURES WHERE DUAL LEVEL SWITCHING IS INDICATED, CIRCUIT FIXTURE SUCH THAT ONE SWITCH CONTROLS THE INNER LAMP AND THE SECOND SWITCH CONTROLS THE OUTER LAMP.
7. PROVIDE DIMMING BALLAST(S) FOR FLUORESCENT FIXTURES SHOWN CONNECTED TO A DIMMING SWITCH DAYLIGHT SENSING PHOTOCELL.

FLAG NOTES

- CONNECTION TO OWNER FURNISHED EXAM LIGHT.
- FIXTURE IS DUAL BALLASTED, THREE LAMPS ON THE FIRST BALLAST AND ONE LAMP ON THE SECOND BALLAST. SWITCH THE THREE LAMP BALLAST ON THE SWITCH LEG SHOWN. SWITCH IS LOCATED AT NURSE STATION 2233. SINGLE LAMP BALLAST IS UNSWITCHED AND REMAINS ON AT ALL TIMES.
- CONNECT COMPLETE TO EXISTING LIGHTING FIXTURES IN ROOM SHOWN.