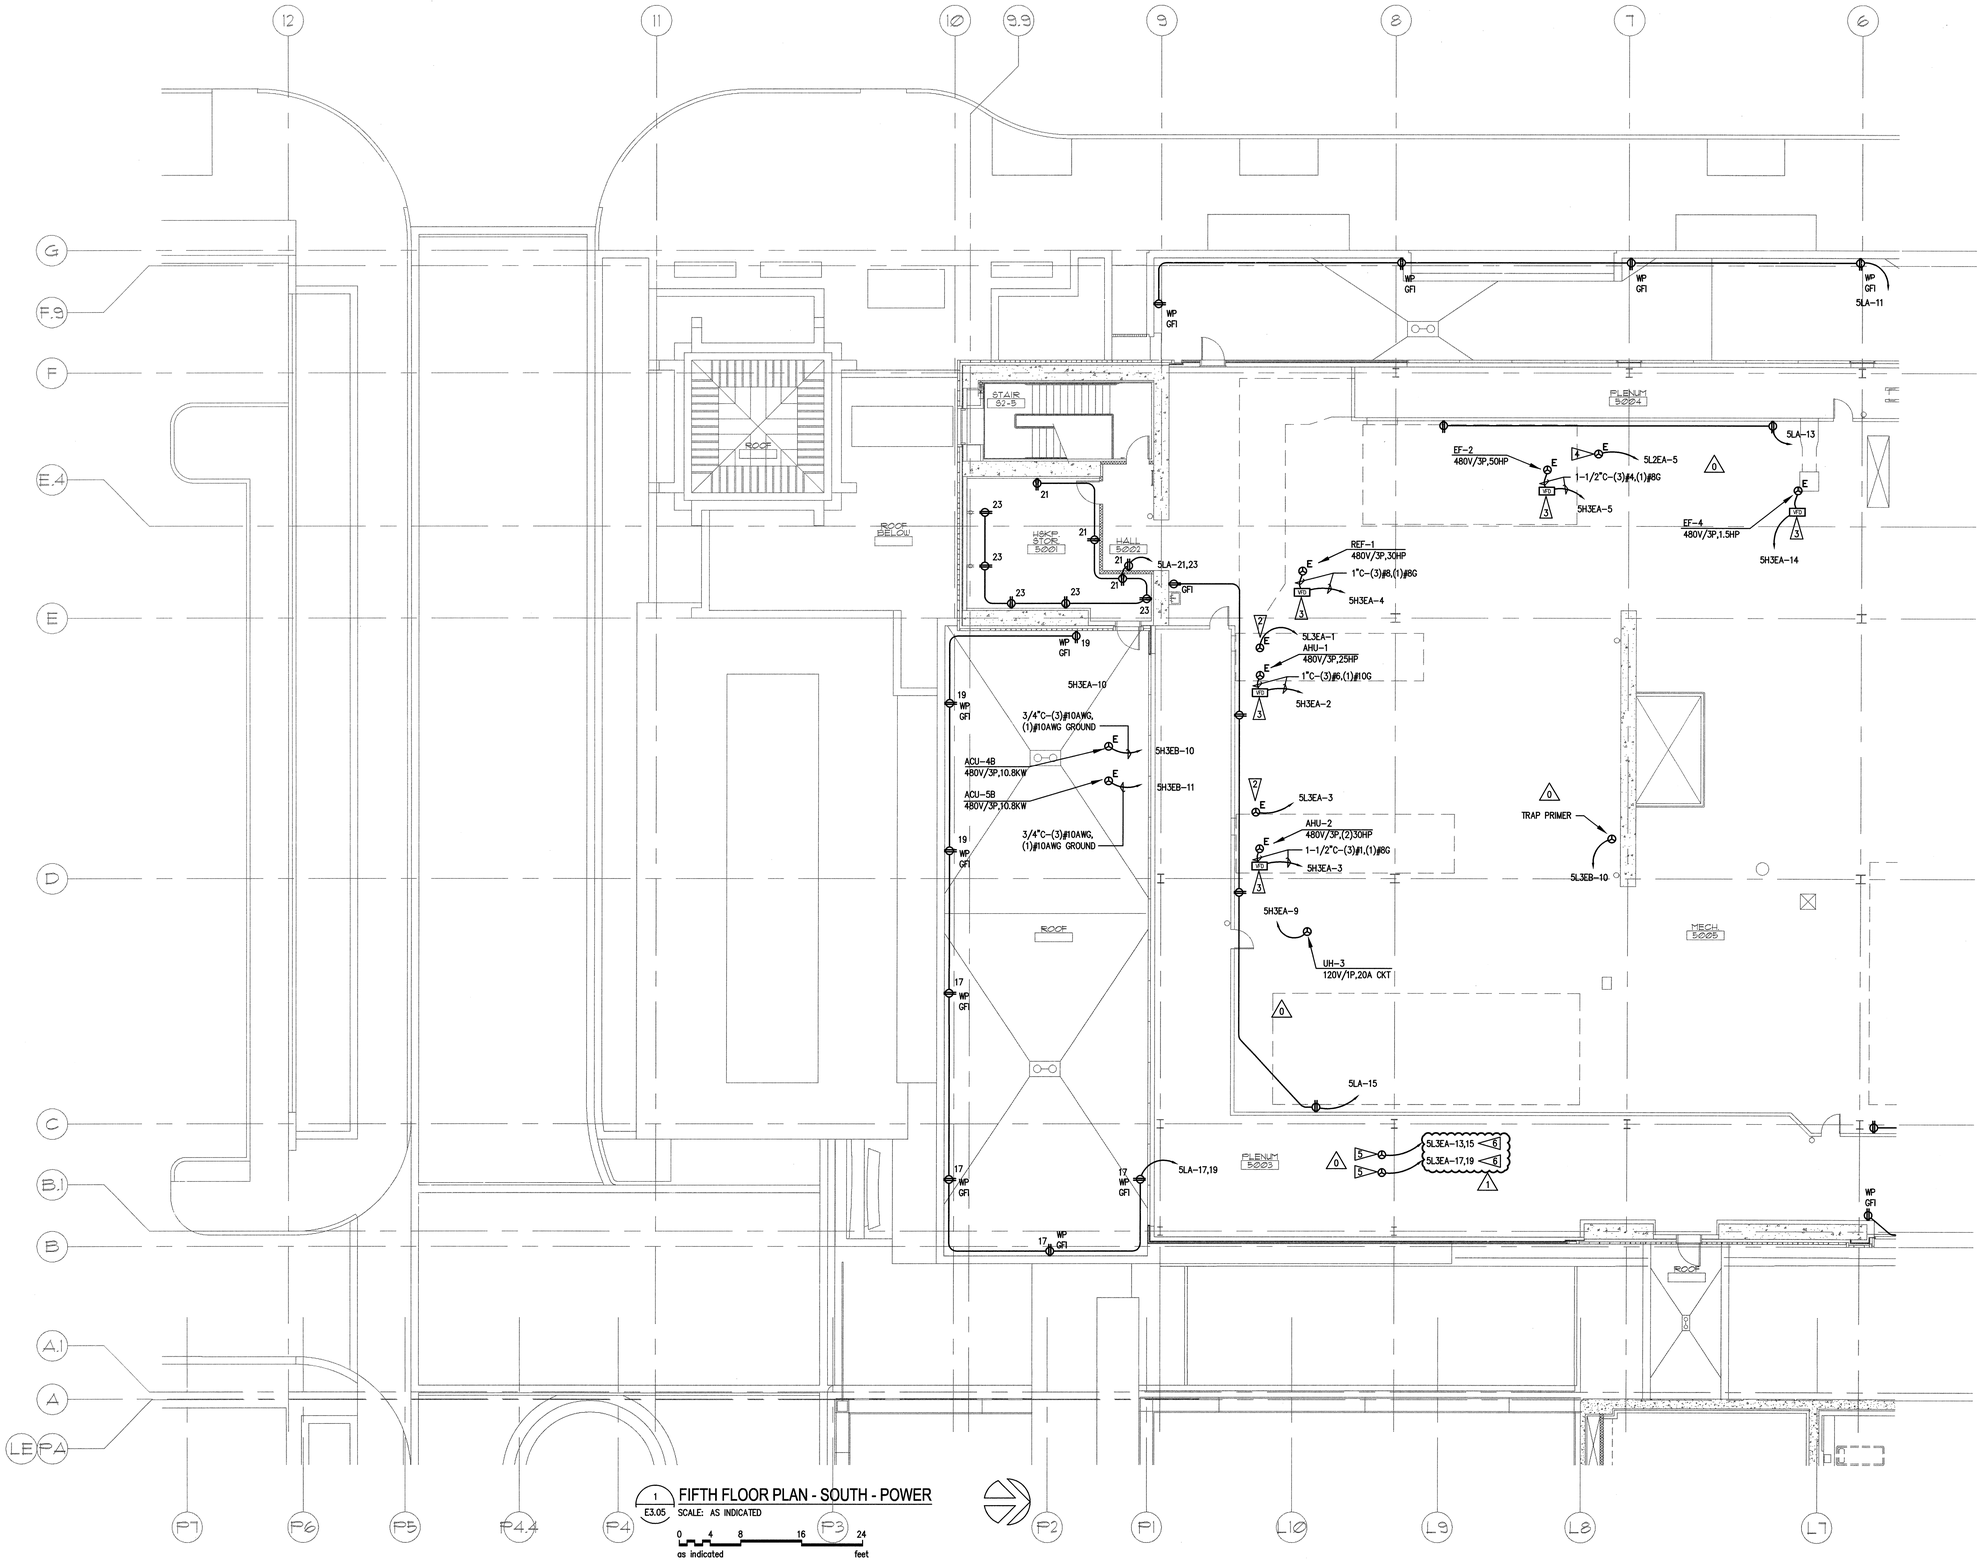

1 E3.05 FIFTH FLOOR PLAN - SOUTH - POWER

SCALE: AS INDICATED

0 4 8 16 24

as indicated feet

GENERAL NOTES

1. SEE ARCHITECTURAL PLANS, SECTIONS AND ELEVATIONS FOR EXACT EQUIPMENT AND DEVICE LOCATIONS, INCLUDING MOUNTING HEIGHTS.
2. PROVIDE RED DEVICES AND COVERPLATES FOR DEVICES SERVED FROM EMERGENCY POWER SYSTEM.
3. SEE ARCHITECTURAL PLANS FOR LOCATIONS OF SOUND, SMOKE AND FIRE RATED WALLS.
4. ABOVE COUNTER RECEPTACLES LOCATED WITHIN 5' OF SINK SHALL BE GFI RATED.
5. SEE MECHANICAL DRAWINGS FOR EXACT LOCATION OF MECHANICAL EQUIPMENT. COORDINATE WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.
6. SEE MECHANICAL DRAWINGS FOR EXACT LOCATION OF ALL EQUIPMENT.
7. PROVIDE FUSES SIZED PER EQUIPMENT MANUFACTURER'S RECOMMENDATION. FIELD VERIFY EQUIPMENT NAMEPLATE OVER CURRENT AN DISCONNECT REQUIREMENTS PRIOR TO EQUIPMENT CONNECTION.
8. MOUNT ALL DISCONNECTS AND STARTERS INDEPENDENT OF MECHANICAL EQUIPMENT IN A READILY ACCESSIBLE LOCATION. COORDINATE EXACT LOCATIONS WITH FINAL EQUIPMENT LAYOUT AND ORIENTATION.
9. ALL ELECTRICAL EQUIPMENT ON ROOF SHALL BE WEATHERPROOF.
10. ALL PENETRATIONS IN SUPPORT OF ELECTRICAL CIRCUITRY OR EQUIPMENT SUPPORT SHALL MATCH THOSE REQUIRED AND DETAILED BY THE ARCHITECT. COORDINATE AS REQUIRED PRIOR TO ROUGH-IN.
11. ALL WIRING TO ROOFTOP RECEPTACLES SHALL BE #10 AWG UNLESS OTHERWISE NOTED.
12. SURFACE MOUNTED WIRING ON ROOF IS PROHIBITED. ALL WIRING TO BE ROUTED IN CEILING SPACE BELOW ROOF.

FLAG NOTES

△0

1. NOT USED.
2. PROVIDE 120V CIRCUIT FOR AIR HANDLER UNIT LIGHTING.
3. VFD PROVIDED BY DIVISON 23. CONTRACTOR SHALL PROVIDE AND MAKE ALL REQUIRED INTERCONNECTIONS.

△0

4. PROVIDE 120V CIRCUIT FOR EXHAUST FAN UNIT.
5. HEAT TRACE CONNECTION. COORDINATE LOCATION WITH MECHANICAL CONTRACTOR. INSTALLATION OF HEAT TRACE, ALL ASSOCIATED DEVICES AND CONTROL BY MECHANICAL CONTRACTOR.

△1

6. COORDINATE VOLTAGE, PHASE AND LOAD REQUIREMENTS WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN. PROVIDE CIRCUIT BREAKER AND CONDUCTORS SIZED APPROPRIATELY FOR LOAD.
7. PROVIDE HARD WIRED CONNECTION TO ELECTRIC TRAP PRIMER. CONFIRM REQUIREMENTS WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.

GIFFIN • BOLTE • JURGENS p.c.
ARCHITECTS
815 S.W. SECOND AVENUE · PORTLAND, OREGON 97204
(503) 223-0992 www.gbjarch.com FAX (503) 294-3961

MARK D. PECOTTE — STATE OF WASHINGTON — 42253 — REGISTERED PROFESSIONAL ENGINEER — 2/13/09

MultiCare

EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION

TACOMA, WASHINGTON

△0	100% CD SET	9/26/08
△1	CCD #7	2/20/09

Date 09-26-2008
Scale AS INDICATED
Drawn By JL
Job No. 4034

FIFTH FLOOR PLAN - SOUTH POWER

E3
05

N:\B1360\CADD-05\310_E3-05.DWG FEB 13, 2009 - 11:29:14 AM BY: TWHITE