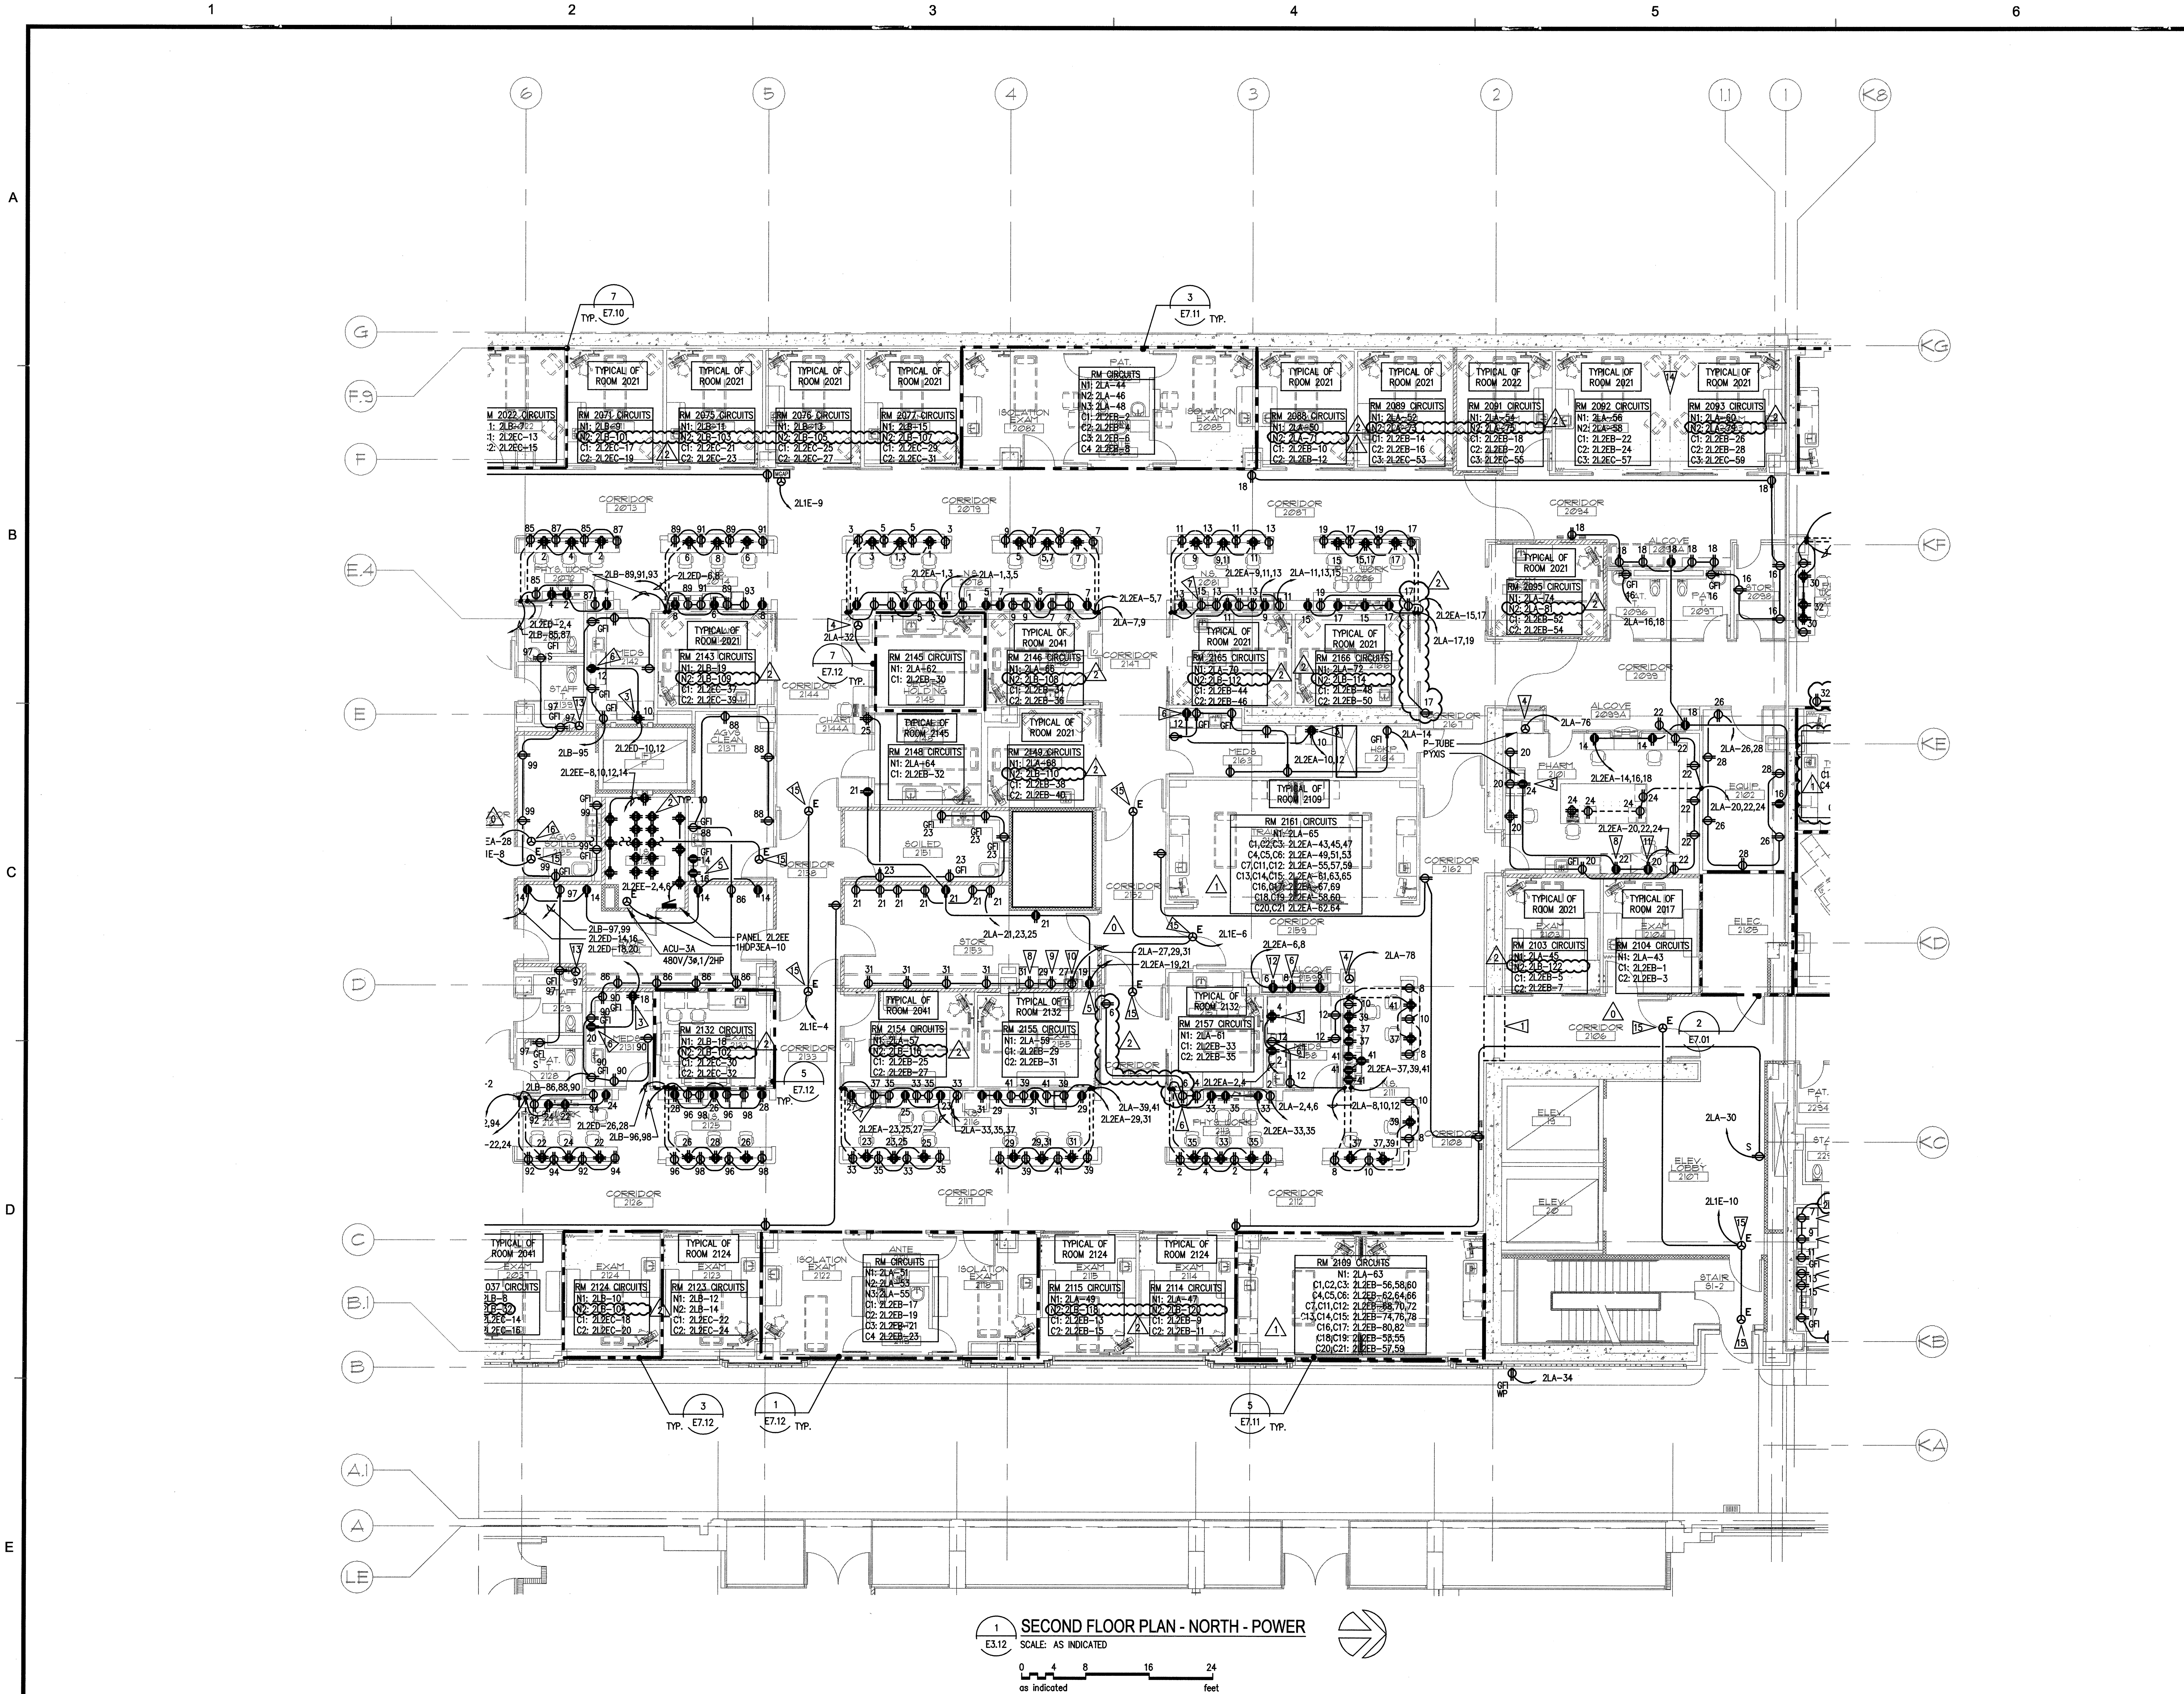

1 SECOND FLOOR PLAN - NORTH - POWER
E3.12 SCALE: AS INDICATED

0 4 8 16 24
as indicated feet

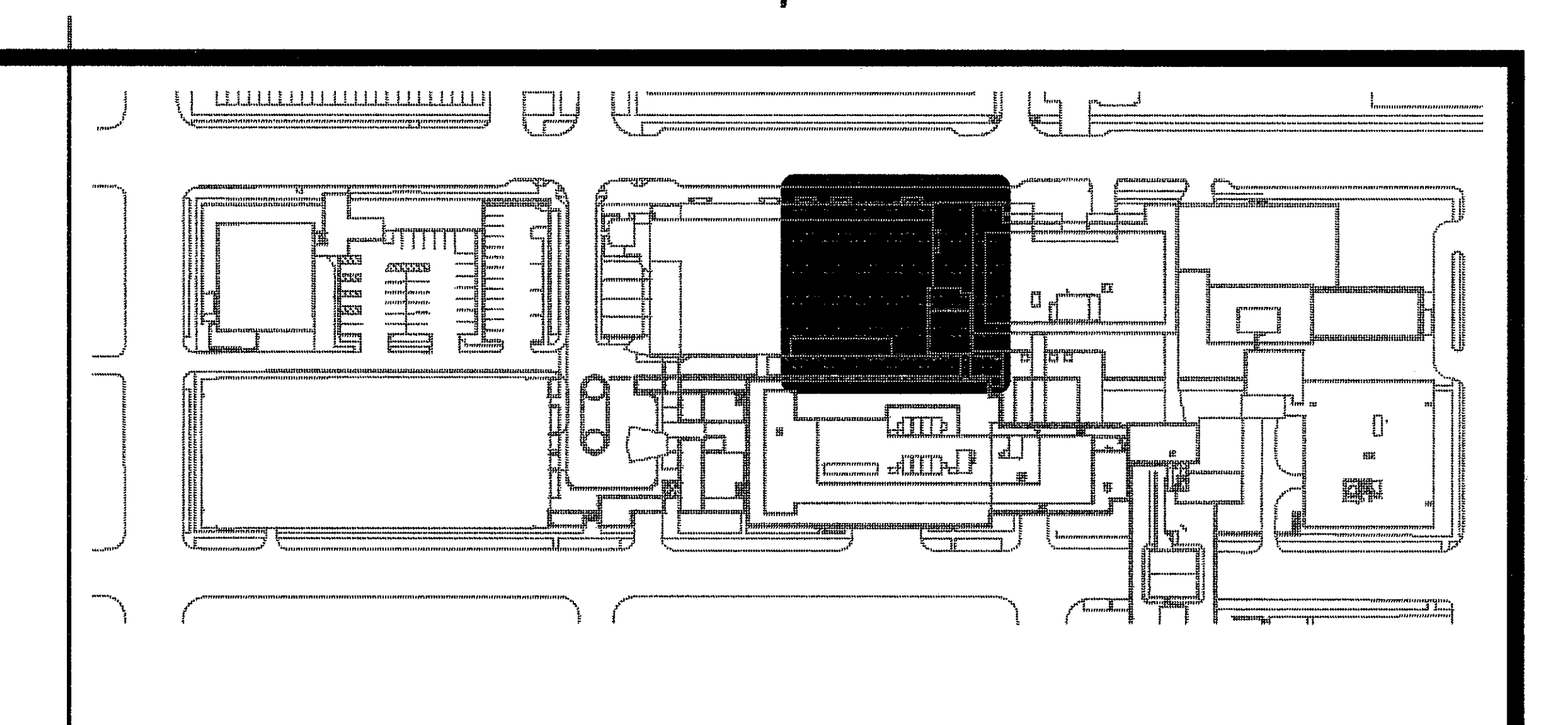

GENERAL NOTES

1. SEE ARCHITECTURAL PLANS, SECTIONS AND ELEVATIONS FOR EXACT EQUIPMENT AND DEVICE LOCATIONS, INCLUDING MOUNTING HEIGHTS.
2. PROVIDE RED DEVICES AND COVERPLATES FOR DEVICES SERVED FROM EMERGENCY POWER SYSTEM.
3. SEE ARCHITECTURAL PLANS FOR LOCATIONS OF SOUND, SMOKE AND FIRE RATED WALLS.
4. ABOVE COUNTER RECEPTACLES LOCATED WITHIN 5' OF SINK SHALL BE GFI RATED.
5. SEE MECHANICAL DRAWINGS FOR EXACT LOCATION OF MECHANICAL EQUIPMENT. COORDINATE WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.

FLAG NOTES

1. ALL CONDUITS PASSING THROUGH GRID LINE 2 SHALL PASS THROUGH BLOCKOUT IN SHEAR WALL.
2. PROVIDE (10) DEDICATED DOUBLE DUPLEX (L5-20R) RECEPTACLES MOUNTED ON RACK CABLE TRAY. REFER TO PANEL SCHEDULE 2L2EE FOR DEDICATED SUPPLY CIRCUITS.
3. PYXIS CONNECTION.
4. PROVIDE HARD WIRED CONNECTION TO PNEUMATIC TUBE DIVERTER. CONFIRM EXACT LOCATION AND ELECTRICAL REQUIREMENTS WITH SITE SPECIFIC VENDOR DRAWINGS.
5. ICE MACHINE CONNECTION.
6. UNDER-COUNTER REFRIGERATOR CONNECTION.
7. PHOTO-COPIER CONNECTION.
8. REFRIGERATOR CONNECTION.
9. COFFEE MACHINE CONNECTION.
10. MICROWAVE CONNECTION.
11. PHARMACY HOOD CONNECTION.
12. BLANKET WARMER CONNECTION.
13. PROVIDE HARD WIRED CONNECTION TO AUTO-SINK SENSOR.
14. ROOMS ARE SEPARATED BY COLLAPSABLE PARTITION. CONFIRM EXACT DEVICE LOCATION WITH ARCHITECT PRIOR TO ROUGH IN.
15. PROVIDE HARD WIRED CONNECTION TO AUTO-DOOR MOTOR. PROVIDE ALL REQUIRED CONDUIT, WIRING AND ELECTRICAL DOOR HARDWARE. CONFIRM REQUIREMENTS WITH ARCHITECTURAL DOOR HARDWARE SCHEDULE.
16. AGVS CONTROL PANEL CONNECTION COORDINATE WITH AGVS DRAWINGS AND ARCHITECT PRIOR TO ROUGH-IN.

GIFFIN • BOLTE • JURGENS p.c.
ARCHITECTS
815 S.W. SECOND AVENUE · PORTLAND, OREGON 97204
(503) 223-0992 www.gbjarch.com FAX (503) 294-3961

MARK D. PECKOVER · STATE OF WASHINGTON · 42253 · REGISTERED PROFESSIONAL ENGINEER · 2/13/09

MultiCare

EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION

TACOMA, WASHINGTON

0	100% CD SET 9/26/08
1	CCD #4 12/17/08
2	CCD #7 2/20/09

Date	09-26-2008
Scale	AS INDICATED
Drawn By	JL
Job No.	4034

SECOND FLOOR PLAN - NORTH POWER

E3
12

N:\B13608\CADD-05\304_E3-12.DWG FEB 13, 2009 - 11:30:37 AM BY: TWHITE