


N: B13608 CAD-05-317.E3-39.DWG FEB 13, 2009 - 11:28:33 AM BY: TWHITE

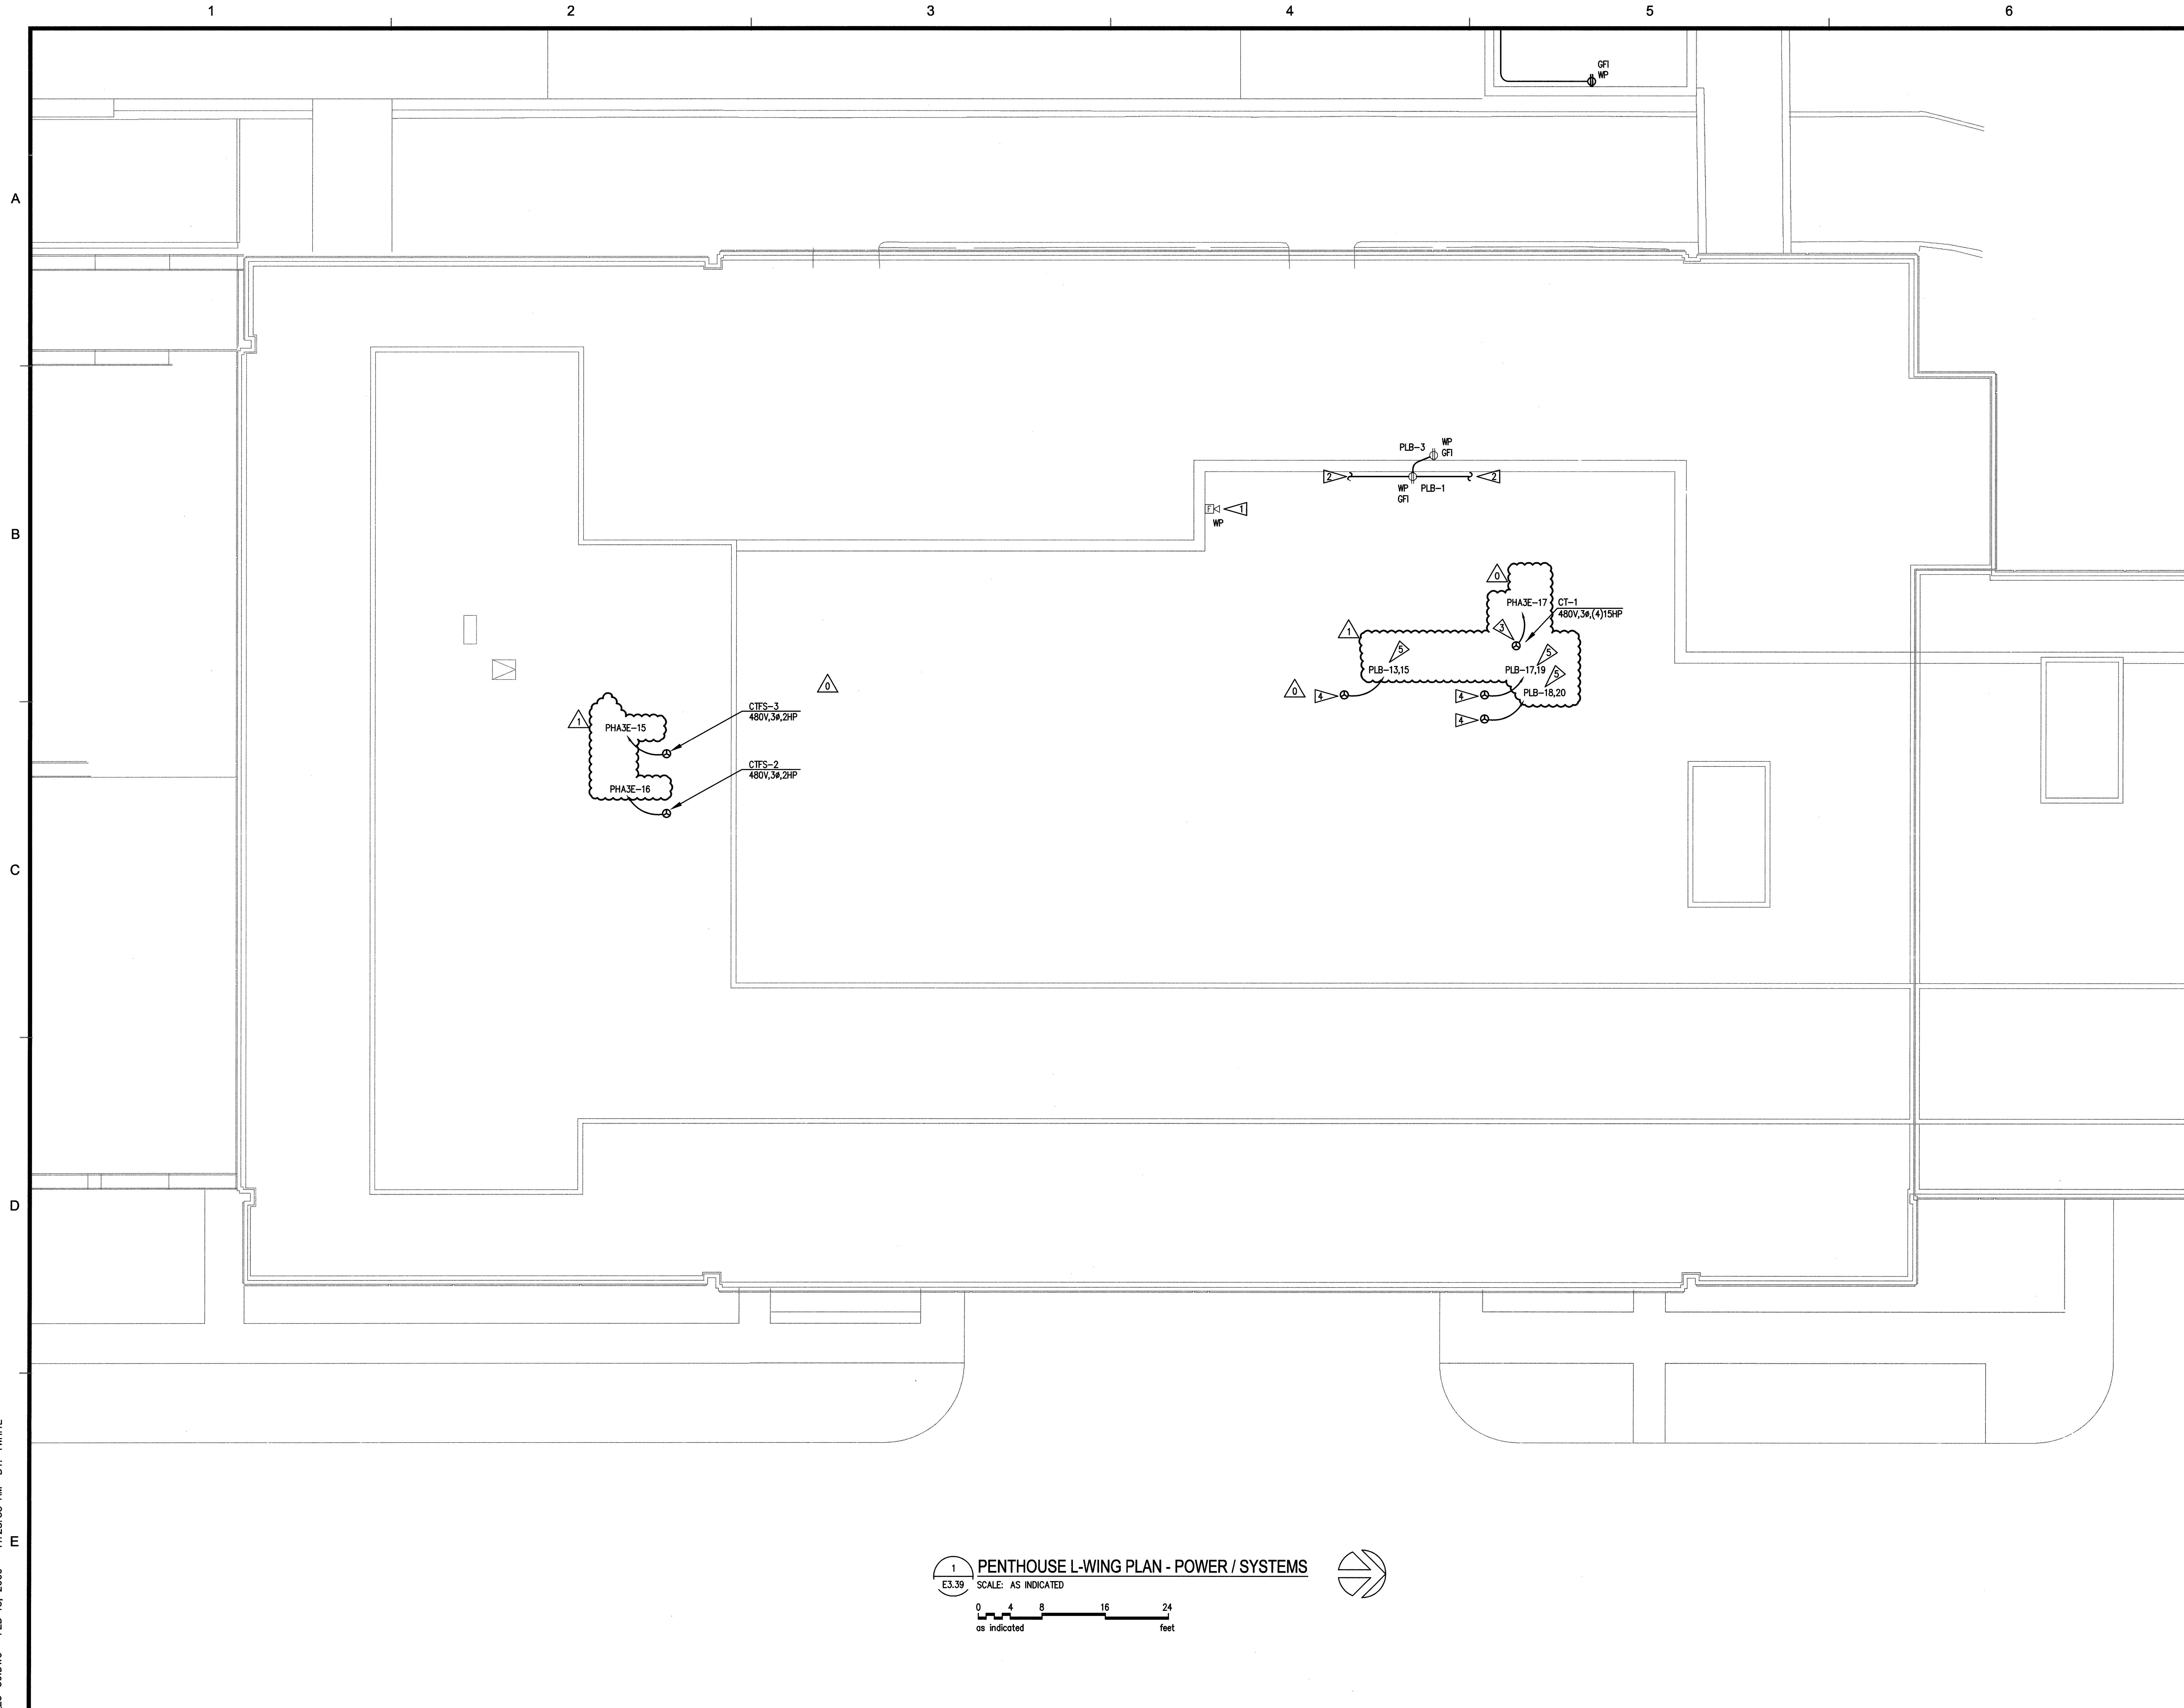


GENERAL NOTES

- SEE SCHEDULE ON E3.1 FOR MECHANICAL EQUIPMENT CONNECTION REQUIREMENTS AND CIRCUITS.
- SEE MECHANICAL DRAWINGS FOR EXACT LOCATION OF ALL EQUIPMENT.
- PROVIDE FUSES SIZED PER EQUIPMENT MANUFACTURER'S RECOMMENDATION. FIELD VERIFY EQUIPMENT NAMEPLATE OVER CURRENT AND DISCONNECT REQUIREMENTS PRIOR TO EQUIPMENT CONNECTION.
- MOUNT ALL DISCONNECTS AND STARTERS INDEPENDENT OF MECHANICAL EQUIPMENT IN A READILY ACCESSIBLE LOCATION. COORDINATE EXACT LOCATIONS WITH FINAL EQUIPMENT LAYOUT AND ORIENTATION.
- ALL ELECTRICAL EQUIPMENT ON ROOF SHALL BE WEATHERPROOF.
- ALL PENETRATIONS IN SUPPORT OF ELECTRICAL CIRCUITRY OR EQUIPMENT SUPPORT SHALL MATCH THOSE REQUIRED AND DETAILED BY THE ARCHITECT. COORDINATE AS REQUIRED PRIOR TO ROUGH-IN.
- ALL WIRING TO ROOFTOP RECEPTACLES SHALL BE #10 AWG UNLESS OTHERWISE NOTED.
- SURFACE MOUNTED WIRING ON ROOF IS PROHIBITED. ALL WIRING TO BE ROUTED IN CEILING SPACE BELOW ROOF.


FLAG NOTES

- INSTALL EXISTING EQUIPMENT IN LOCATION SHOWN.
- CONNECT COMPLETE TO EXISTING CIRCUIT TO MAINTAIN CONTINUITY.
- SINGLE POINT CONNECTION FOR COOLING TOWER DISTRIBUTION PANEL PROVIDED BY DIVISION 23. CONTRACTOR SHALL PROVIDE ALL REQUIRED INTERCONNECTING CONDUIT AND WIRING FOR EACH COOLING TOWER CELL AND HEATERS. REFER TO 1/E3.18 FOR CONDUIT ROUTING.
- HEAT TRACE CONNECTION. COORDINATE LOCATION WITH MECHANICAL CONTRACTOR. INSTALLATION OF HEAT TRACE, ALL ASSOCIATED DEVICES AND CONTROL BY MECHANICAL CONTRACTOR.
- CONNECT COMPLETE TO EXISTING NORMAL PANEL. COORDINATE VOLTAGE, PHASE AND LOAD REQUIREMENTS WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN. PROVIDE NEW CIRCUIT BREAKER AND AS NECESSARY.
- NOT USED.

1 PENTHOUSE L-WING PLAN - POWER / SYSTEMS
E3.39 SCALE: AS INDICATED



GIFFIN • BOLTE • JURGENS *p.c.*
ARCHITECTS
815 S.W. SECOND AVENUE • PORTLAND, OREGON 97204
(503) 223-0992 www.gbjarch.com FAX (503) 294-3961

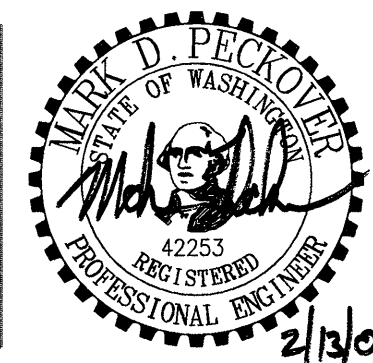

MultiCare
EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION
TACOMA, WASHINGTON

100% CD SET 9/26/08
CCD #7 2/20/09

Date 09-26-2008
Scale AS INDICATED
Drawn By JL
Job No. 4034

PENTHOUSE
L-WING PLAN -
POWER / SYATEMS

E3
39