

- 1 FULL INTEGRATED ELEVATOR PANEL WITH SHUNT TRIP AND FIRE SWITCH INTERFACE. PROVIDE COOPER BUSHMAN PMP OR EQUIVALENT WIRING INTEGRAL TO FREE PUMP PACKAGED CONTROL UNIT AND TRANSFER SWITCH.
- 2 PROVIDE THERMAL MAGNETIC CIRCUIT BREAKER WITH 15K MAGNETIC WITHSTAND RATING.
- 3 CIRCUIT BREAKERS WITHIN THIS EQUIPMENT TO BE MOULDED CASE WITH ELECTRONIC TRIP UNIT AND LS ADJUSTMENTS.
- 4 THERMAL MAGNETIC INTERCHANGEABLE TRIP UNIT WITH ADJUSTABLE INSTANTANEOUS SETTING. JO FRAME CIRCUIT BREAKER.

GENERAL NOTES:


- GENERAL NOTES:**
1. SEE SHEET E6.00 FOR FEEDER SCHEDULE AND TRANSFORMER SECONDARY SCHEDULE.
  2. IN PANELBOARDS, THE NOTATION "SW" REFERS TO MAGNETIC ONLY MOLDED CASE CIRCUIT BREAKER.
  3. PROVIDE #10 AWG GROUND WIRE BETWEEN NORMAL AND EMERGENCY PANELBOARDS PER NEC 517.14.

ONE-LINE / RISER DIAGRAM - EMERGENCY

Date 09-26-2008  
Scale NONE  
Drawn By JL  
Job No. 4034

## ONE-LINE RISER DIAGRAM EMERGENCY


E6  
02

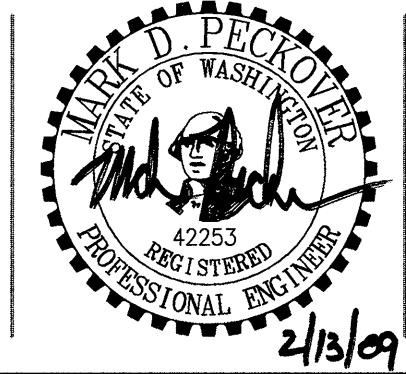

**MultiCare** 

**EMERGENCY DEPARTMENT & CANCER CENTER EXPANSION**

TACOMA, WASHINGTON

**MultiCare**   
**MENT & CANCER**  
TACOMA, WASHINGTON