


4
E7.16

4TH FL TYPICAL EXAM RM ENLARGED PLAN - POWER

SCALE: AS INDICATED

0 1 2 4 8 12
as indicated feet

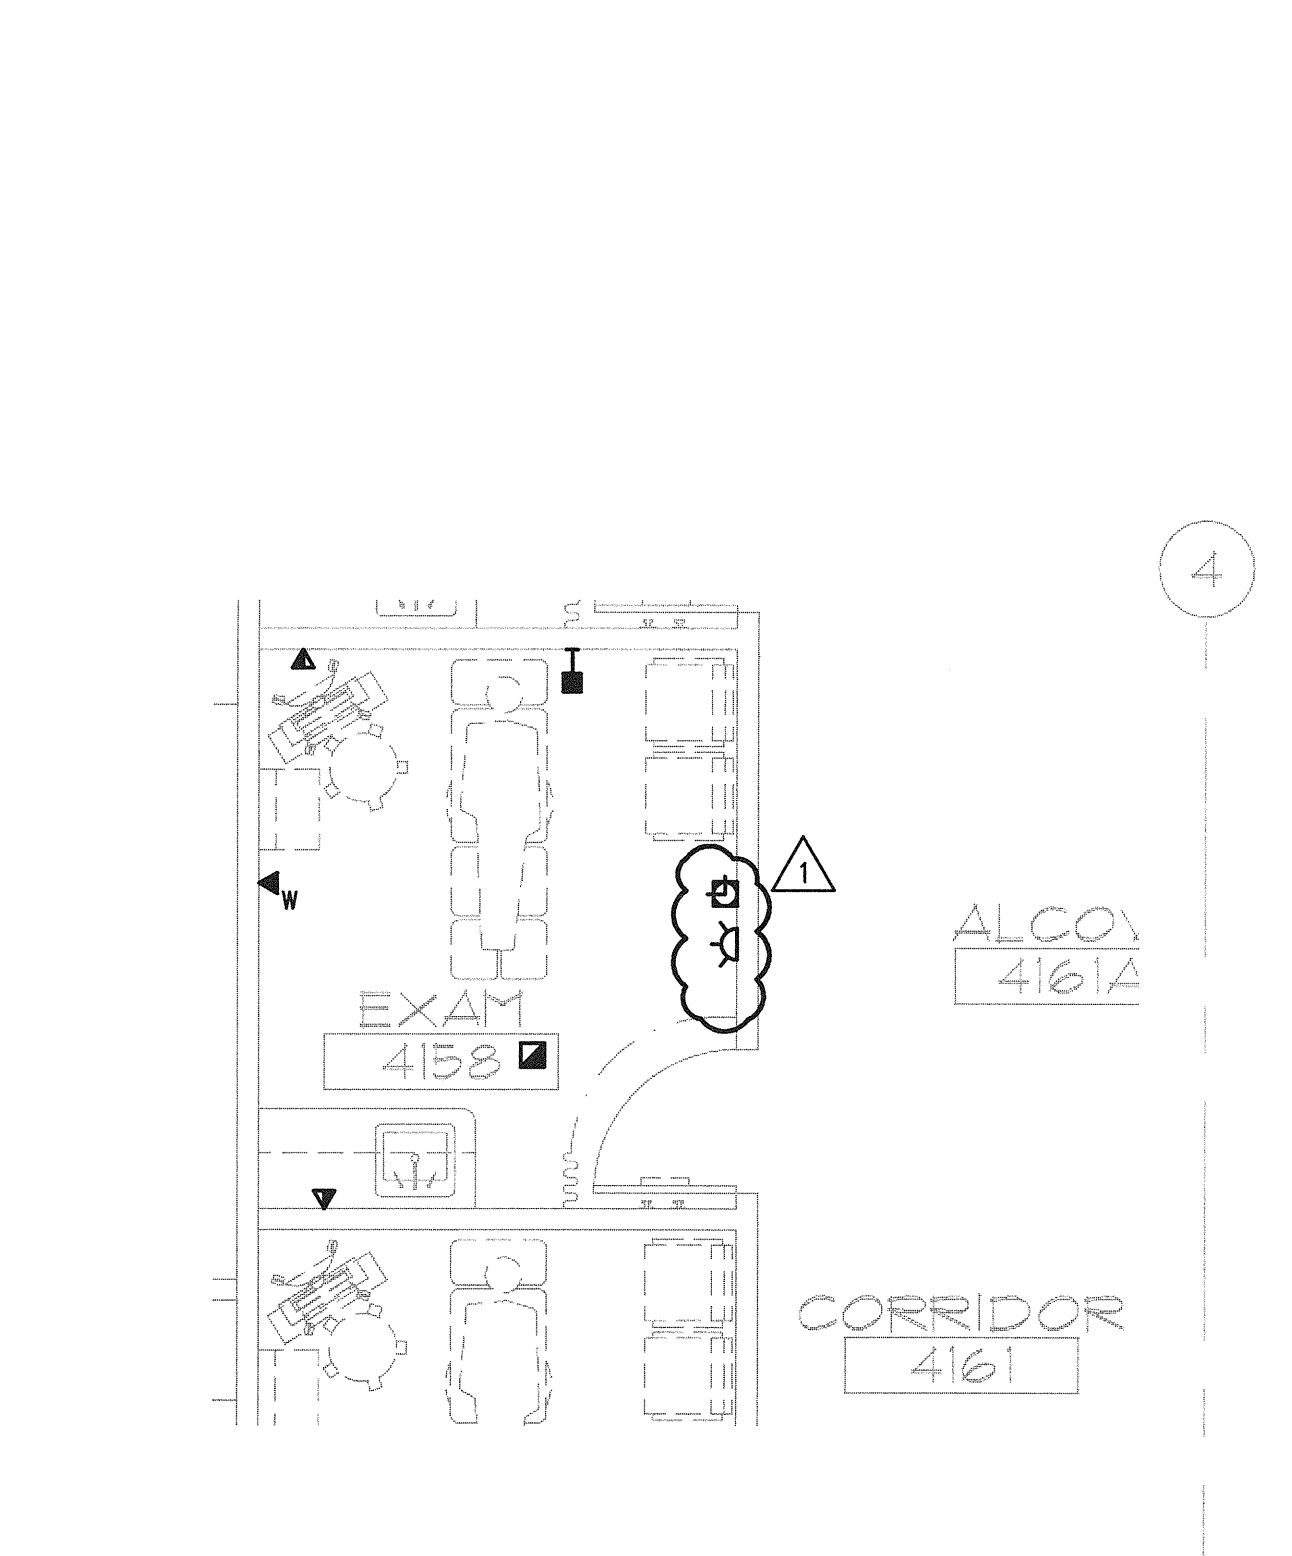

8
E7.16

4TH FL TYPICAL EXAM RM ENLARGED PLAN - SYSTEMS

SCALE: AS INDICATED

0 1 2 4 8 12
as indicated feet

- ## FLAG NOTES
- | | |
|---|--|
| 1 | ALL RECEPTACLES THIS ROOM SHALL BE LISTED AS "SAFETY" TYPE RECEPTACLES. |
| 2 | PROVIDE HARD-WIRED CONNECTION TO AUTOMATIC WINDOW SHADE MOTOR. PROVIDE WIRING AND CONDUIT BACK TO CONTROL SWITCH AT NURSE STATION. |