

3 PAVILION ROOF - SECTOR A
3/16" = 1'-0"

ROOF FRAMING PLAN NOTES

- FOR DIMENSIONS NOT INDICATED ON THIS DRAWING REFER TO ARCHITECTURAL DRAWINGS.
- FOR BALANCE OF INFORMATION NOT INDICATED IN STRUCTURAL DRAWINGS, SEE ARCHITECTURAL DRAWINGS.
- CONTRACTOR IS RESPONSIBLE FOR THE MEANS AND METHODS OF ERECTION AND ENGINEERING OF ANY TEMPORARY SUPPORT OR LOADING CONDITIONS. CONTRACTOR TO SUBMIT ERECTION SEQUENCE PLAN FOR APPROVAL. DESIGN IS BASED ON SHORED CONSTRUCTION.
- COORDINATE AND PROVIDE (4) 1/2" DIA THREADED INSERTS EMBED INTO SLAB TO SUPPORT HANGING MECHANICAL EQUIPMENT, 900 lbs MAX.

ROOF FRAMING KEY PLAN NOTES


ALL INTERIOR FRAMING MEMBERS TO BE 14"x2" U.N.O. ALL PERIMETER MEMBERS TO FOLLOW KEY NOTE 5

- INDICATES FRAMING MEMBER 14X2
- INDICATES FRAMING MEMBER 14X2.5 REF SECTION 1 FOR PLATE GEOMETRY
- INDICATES FRAMING MEMBER 14X3 REF SECTION 1 FOR PLATE GEOMETRY
- INDICATES FRAMING MEMBER 14X4 REF SECTION 1 FOR PLATE GEOMETRY
- INDICATES PERIMETER MEMBER 14X1.5
- INDICATES BRACING MEMBER (TYP.) BY SPECIALTY ENGINEER
- INDICATES FRAMING MEMBER 14X4.5 REF SECTION 1 FOR PLATE GEOMETRY
- INDICATES 14" PT SLAB, REF TO VSL DWGS FOR SIZE AND REINF.


- INDICATES CIP WALL, TOP OF FULL HEIGHT CIP WALL ELEVATION TO MATCH BOTTOM OF SLAB ELEVATION. REFER TO ARCH FOR DIMENSIONAL CONTROL
- INDICATES V-COLUMN, BOT OF V-COLUMN ELEVATION TO MATCH BOT OF CANOPY STRUCTURE. REF ARCH FOR DIMENSIONAL CONTROL. CONCRETE BEAM ABOVE V-COLUMN TO HAVE SAME WIDTH AS COLUMN
- INDICATES PIPE BELOW, REF PAVILION WALL PLAN FOR SIZE AND LOCATION
- KITCHEN HOOD SUSPENDED FROM ROOF 600# MAX. COORDINATE AND PROVIDE (4) 1/2" DIA. THREADED INSERTS.
- EMBED INTO SLAB. PROVIDE L3x1/4 w/1/2"x5" HSA @ 18" OC ANGLE FRAME EMBED @ ROOF HOODS.

TOP EMBED PLATE KEY PLAN NOTES

- INDICATES TYPE "A" TOP PLATE EMBED CONNECTION FROM TRELLIS TO PT SLAB. REF SCHEDULE ON S7.32 FOR PLATE SIZE AND EMBEDS REQUIRED
- INDICATES TYPE "B" TOP PLATE EMBED CONNECTION FROM TRELLIS TO PT SLAB. REF SCHEDULE ON S7.32 FOR PLATE SIZE AND EMBEDS REQUIRED
- INDICATES TYPE "C" TOP PLATE EMBED CONNECTION FROM TRELLIS TO PT SLAB. REF SCHEDULE ON S7.32 FOR PLATE SIZE AND EMBEDS REQUIRED
- INDICATES TYPE "D" TOP PLATE EMBED CONNECTION FROM TRELLIS TO PT SLAB. REF SCHEDULE ON S7.32 FOR PLATE SIZE AND EMBEDS REQUIRED
- INDICATES TYPE "E" TOP PLATE EMBED CONNECTION FROM TRELLIS TO PT SLAB. REF SCHEDULE ON S7.32 FOR PLATE SIZE AND EMBEDS REQUIRED

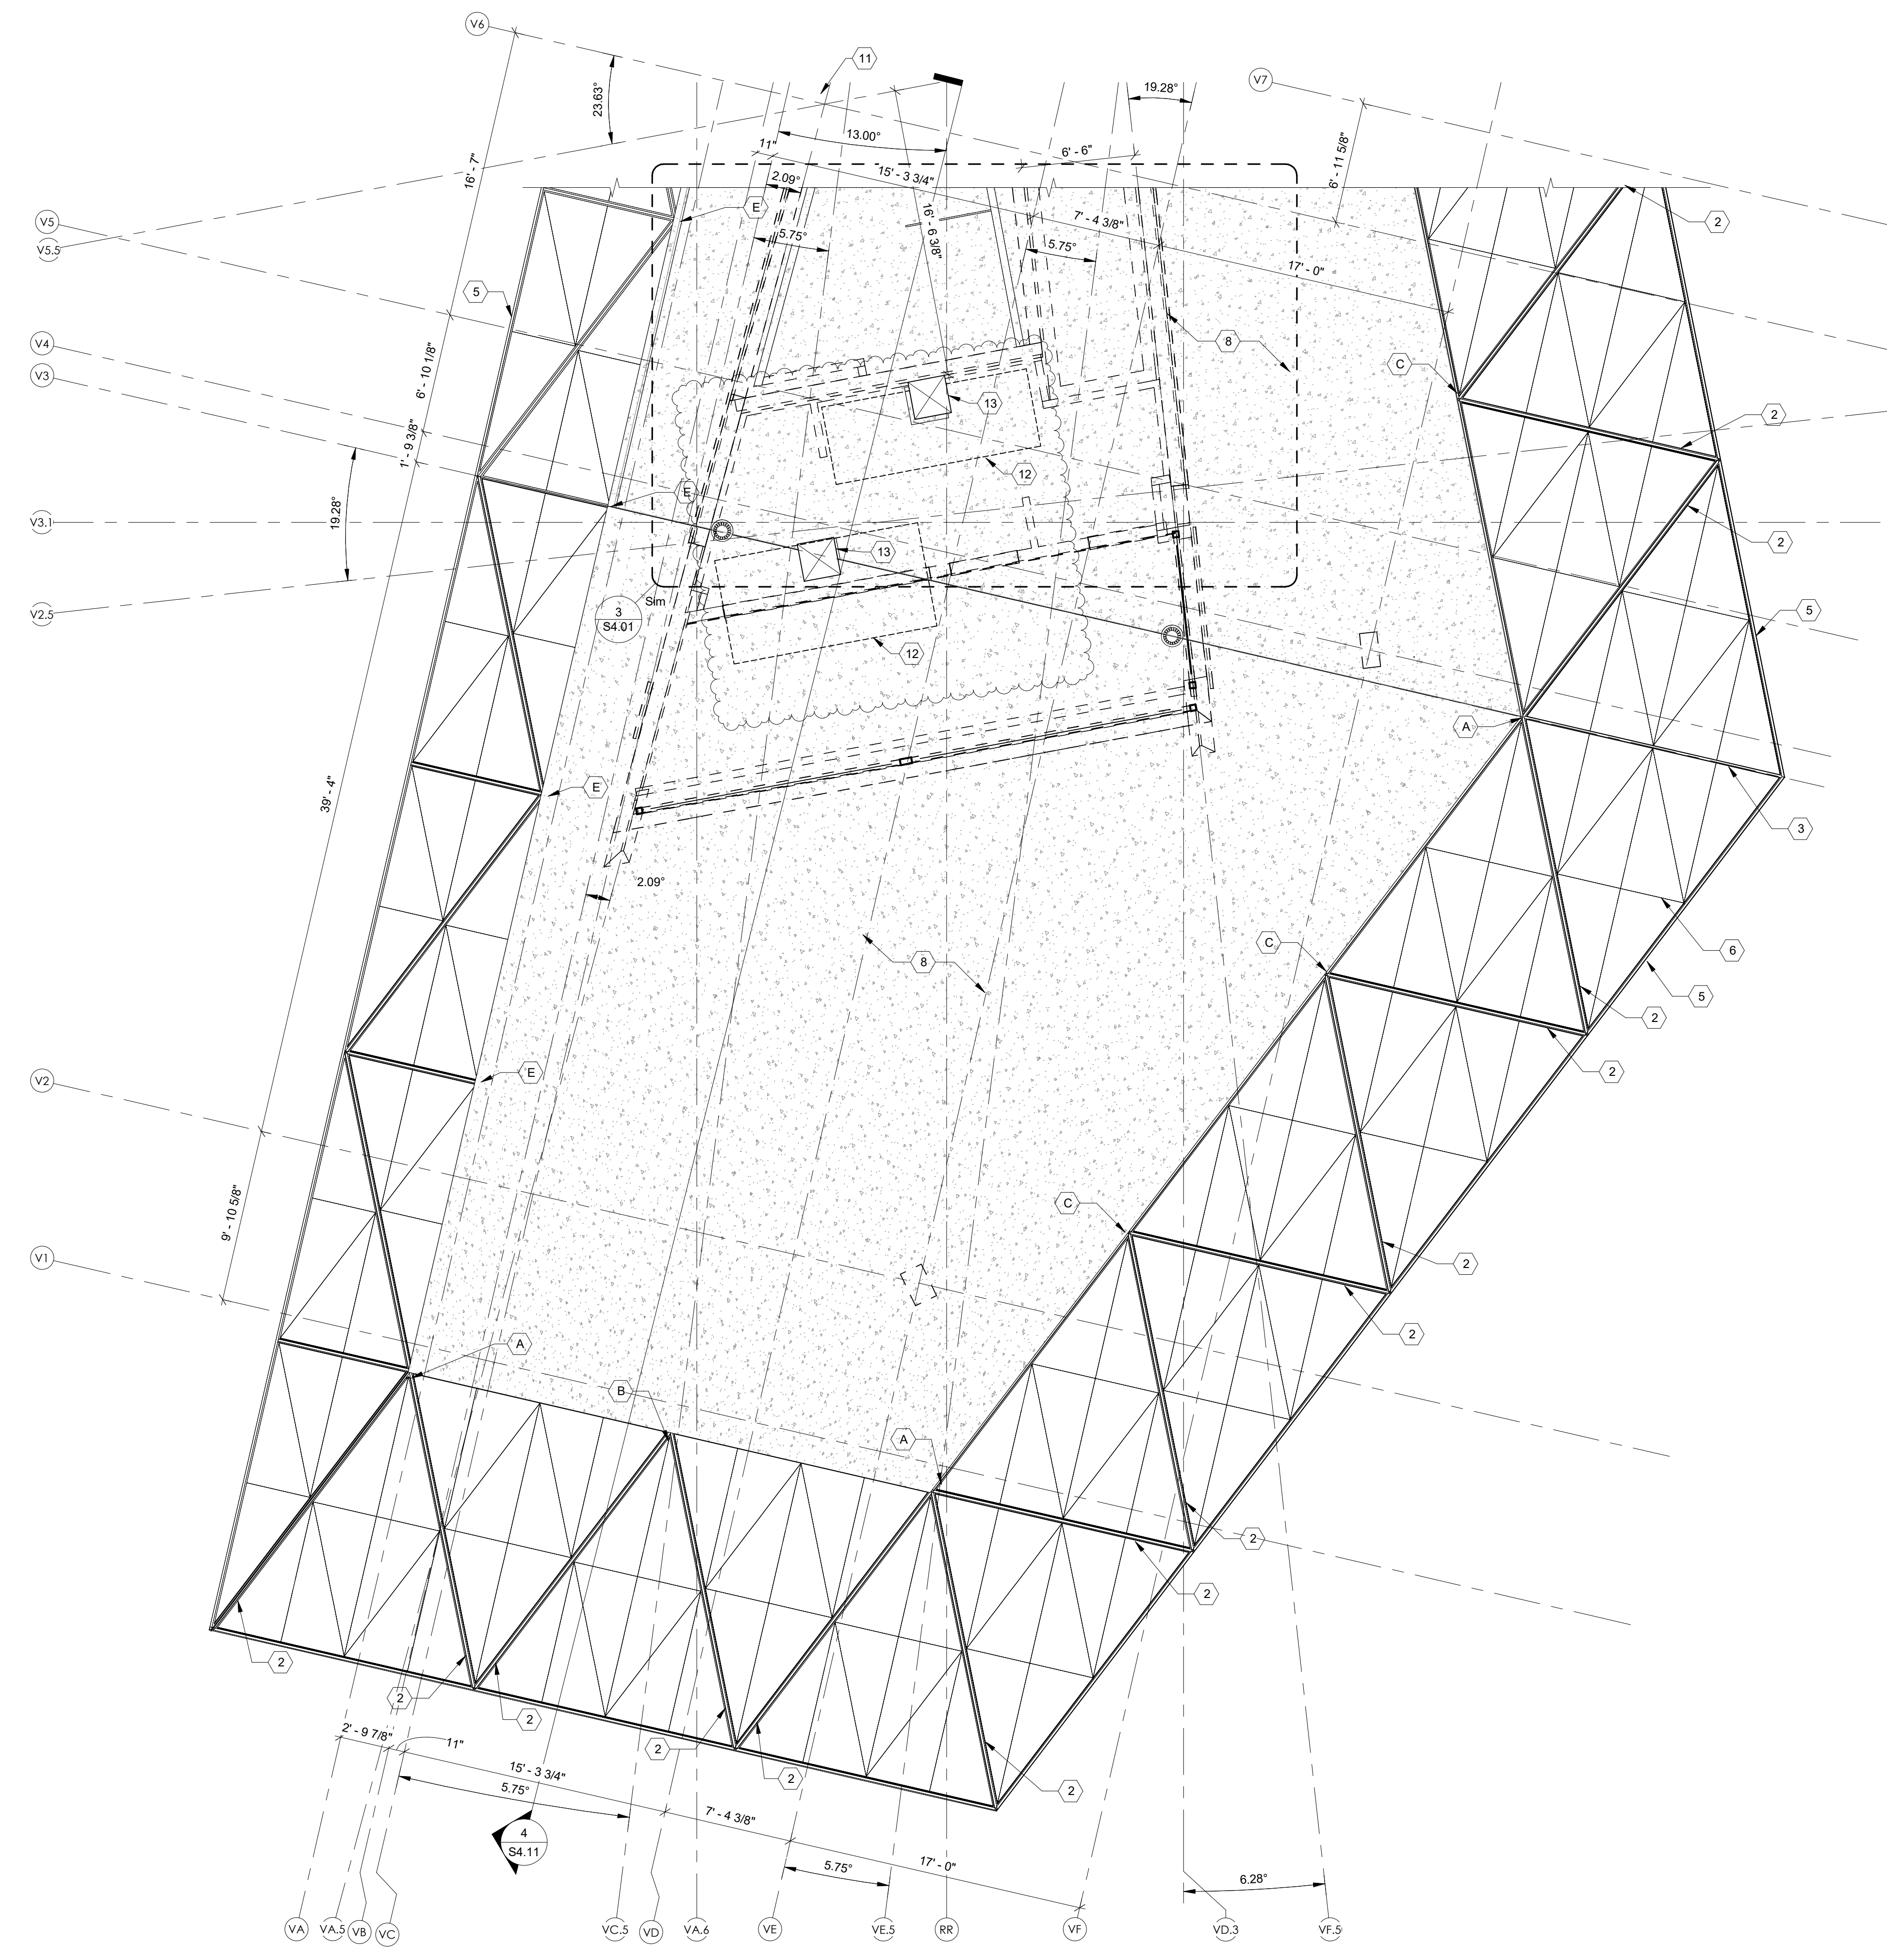

4 PAVILION ROOF - SECTOR B
3/16" = 1'-0"

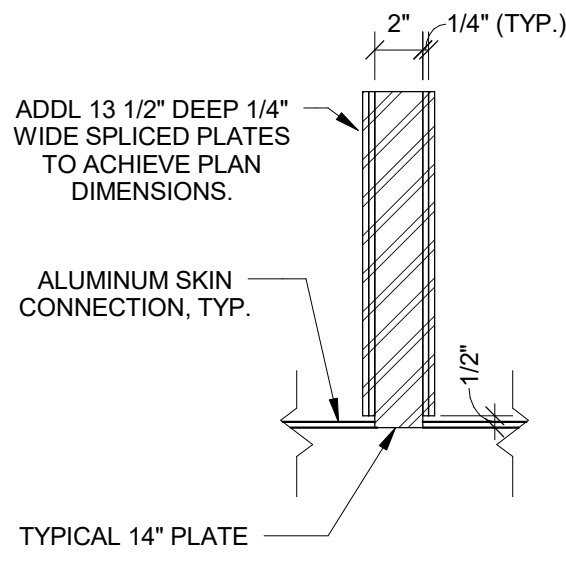

1 TYPICAL BUILT-UP SECTION @ PAVILION
1 1/2" = 1'-0"

ROOF FRAMING LEGEND

- 10" CIP INDICATES 10" CONCRETE WALL. REF ARCH FOR LOCATIONS OF 2" FORM LINER ON EXTERIOR FACE

TO THE BEST OF THE STRUCTURAL ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM CODES AS DETERMINED BY LOCAL AUTHORITY IN ACCORDANCE WITH CHAPTER 553, FLORIDA STATUTES.