


DA Number	EQUIPMENT TYPE	EQUIPMENT NUMBER	Special Seismic Certification Required per CAN 2-1708A.5 section 2.1?	Intended Method for Obtaining SSC: OSP - Proj Spec (PS) Test - PS Analysis - PS Test+ Analysis - Rugged per CAN 2-1708A.5 section 2.2	OSHPD Special Seismic Certification Number	Floor Level of Installation	Manufacturer (reference only)	Model No. (reference only)	Operating Weight (lbs) (reference only)
Plumbing									
E	Section 26 25 00 (Enclosed Bus Assemblies)	BNDH2/BATS-E2 800A/800A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	BNDH2/BATS-LS	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	GEN 1/GSDS 4000A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	GEN 2/GSDS 4000A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	GSDS/BATS-E2 2500A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	GSDS/BATS-E1 3000A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	GSDS/BATS-E2 600A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	GSDS/BATS-LS 800A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	GSDS/BNDH3 2500A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	GSDS/BNDH4 2500A	NO	N/A		LL	Square D / Schneider Electric	T80	
D	Section 26 25 00 (Enclosed Bus Assemblies)	GSDS/BATS-CT 2500A	NO	N/A		LL	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RATS-E2/CH-1 2000A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RATS-E3/REMO-C2	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	REDH/RATS-C 1800A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	REDH/RATS-E1 3000A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	REDH/REMO-C1 1200A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RUSDH/RATS-LS 800A/800A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RNDH/CH-3 2000A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RNDH/RATS-C 1800A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RNDH/RATS-E2 3000A	NO	N/A		Roof	Square D / Schneider Electric	T80	
C	Section 26 25 00 (Enclosed Bus Assemblies)	RNDH/RATS-E3	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RNDH/RATS-LS 800A/800A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RNDH/REDH 3000A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RNDH1/CH-2 2000A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 25 00 (Enclosed Bus Assemblies)	RNDH1/RATS-E1 3000A	NO	N/A		Roof	Square D / Schneider Electric	T80	
	Section 26 27 23 (Enclosed Circuit Breakers)	CB 150 AT	YES	OSP		All	Square D / Schneider Electric	T80	
	Section 26 27 23 (Enclosed Circuit Breakers)	CB 125 AT	YES	OSP		All	Square D / Schneider Electric	T80	
	Section 26 27 23 (Enclosed Circuit Breakers)	CB 100 AT	YES	OSP		All	Square D / Schneider Electric	T80	
	Section 26 27 23 (Enclosed Circuit Breakers)	CB 1200	YES	OSP		All	Square D / Schneider Electric	T80	
	Section 26 28 19 (Enclosed Switches)	100A/250V/F/N1/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	52
B	Section 26 28 19 (Enclosed Switches)	100A/600V/F/N3/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	52
	Section 26 28 19 (Enclosed Switches)	100A/600V/NF/N3/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	52
	Section 26 28 19 (Enclosed Switches)	200A/250V/F/N1/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	55
	Section 26 28 19 (Enclosed Switches)	200A/600V/F/N1/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	55
	Section 26 28 19 (Enclosed Switches)	200A/600V/F/N3/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	55
	Section 26 28 19 (Enclosed Switches)	200A/600V/NF/N3/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	55
	Section 26 28 19 (Enclosed Switches)	30A/250V/F/N1/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	18
	Section 26 28 19 (Enclosed Switches)	30A/600V/F/N1/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	18
	Section 26 28 19 (Enclosed Switches)	30A/600V/F/N3/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	18
	Section 26 28 19 (Enclosed Switches)	400A/600V/F/N1/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	181
A	Section 26 28 19 (Enclosed Switches)	400A/600V/F/N3/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	181
	Section 26 28 19 (Enclosed Switches)	400A/600V/NF/N1/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	181
	Section 26 28 19 (Enclosed Switches)	60A/250V/F/N1/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	20
	Section 26 28 19 (Enclosed Switches)	60A/600V/F/N3/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	20
	Section 26 28 19 (Enclosed Switches)	60A/600V/NF/N3/H/D	YES	OSP	0047-10	All	Square D / Schneider Electric	Safety Switches	20
	Section 26 31 00 (Fire Detection and Alarm)	Fire Alarm Control Panel	YES	OSP	0057-10	LL	Siemens	T80	88
Elevators									
29	Elevator 14	Elevator Controller-14	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	TAC 50-4	600 lbs

DA Number	EQUIPMENT TYPE	EQUIPMENT NUMBER	Special Seismic Certification Required per CAN 2-1708A.5 section 2.1?	Intended Method for Obtaining SSC: OSP - Proj Spec (PS) Test - PS Analysis - PS Test+ Analysis - Rugged per CAN 2-1708A.5 section 2.2	OSHPD Special Seismic Certification Number	Floor Level of Installation	Manufacturer (reference only)	Model No. (reference only)	Operating Weight (lbs) (reference only)
Plumbing									
29	Elevator 15	Elevator Controller-15	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	TAC 50-4	600 lbs
29	Elevator 16	Elevator Controller-16	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	TAC 50-4	600 lbs
29	Elevator 17	Elevator Controller-17	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	TAC 50-4	600 lbs
29	Elevator 18	Elevator Controller-18	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	TAC 50-4	600 lbs
29	Elevator 19	Elevator Controller-19	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	TAC 50-4	600 lbs
	Elevator 14 - 142400	Elevator Machine	YES	Rugged (motor)		Roof - Machine Room	Thyssen Krupp	GD300	6500 lbs
	Elevator 15, 16, 17, 18, 19 - 142400	Elevator Machine	YES	Rugged (motor)		Roof - Machine Room	Thyssen Krupp	GD2	4300 lbs
	Elevator 14 - 142400	Elevator Cab	NO	N/A		Roof - Machine Room	Thyssen Krupp	Elevator Cab	4117 lbs
	Elevator 15-16 - 142400	Elevator Cab	NO	N/A		Hoistway	Thyssen Krupp	Elevator Cab	4117 lbs
	Elevator 15 - 16 - 142400	Elevator Cab	NO	N/A		Hoistway	Thyssen Krupp	Elevator Cab	3355 lbs
	Elevator 17, 18, & 19 142400	Elevator Cab	NO	N/A		Hoistway	Thyssen Krupp	Elevator Cab	3333 lbs
29	Elevator 14	5501AA - Governor-14	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	Governor	183 lbs
29	Elevator 15	5501AA - Governor-15	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	Governor	183 lbs
29	Elevator 16	5501AA - Governor-16	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	Governor	183 lbs
29	Elevator 17	5501AA - Governor-17	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	Governor	183 lbs
29	Elevator 18	5501AA - Governor-18	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	Governor	183 lbs
29	Elevator 19	5501AA - Governor-19	YES	PS Testing		Roof - Machine Room	Thyssen Krupp	Governor	183 lbs
29	Elevator 20	Elevator Controller-20	YES	PS Testing		Elevator Machine Room	Thyssen Krupp	Tac 20	150 lbs
29	Elevator 21	Elevator Controller-21	YES	PS Testing		Elevator Machine Room	Thyssen Krupp	Tac 20	150 lbs
29	Elevator 22	Elevator Controller-22	YES	PS Testing		Elevator Machine Room	Thyssen Krupp	Tac 20	150 lbs
29	Elevator 23	Elevator Controller-23	YES	PS Testing		Elevator Machine Room	Thyssen Krupp	Tac 20	150 lbs
29	Elevator 20	Power Unit-AP300-20	YES	PS Testing		Elevator Machine Room	Thyssen Krupp	AP300-350 - Power Unit	4,920
29	Elevator 21	Power Unit-AP300-21	YES	PS Testing		Elevator Machine Room	Thyssen Krupp	AP300-350 - Power Unit	4,920
29	Elevator 22	Power Unit-AP350-22	YES	PS Testing		Elevator Machine Room	Thyssen Krupp	AP300-350 - Power Unit	5,620
29	Elevator 23	Power Unit-AP350-23	YES	PS Testing		Elevator Machine Room	Thyssen Krupp	AP300-350 - Power Unit	5,620
	Elevator 20, 21, 22	Elevator Cab	NO	N/A		Hoistway	Thyssen Krupp	Elevator Cab	3301 lbs
	Elevator 23	Elevator Cab	NO	N/A		Hoistway	Thyssen Krupp	Elevator Cab	3240 lbs
MEDICAL EQUIPMENT									
38	X-Ray: Digital R&F System with Spot Film Device, with 15" Image Intensifier, 90/45 Tilting Table, Complete with Overhead Tube Suspension Fluoro Monitor Bridge, Wall Bucky, 100kW	X226	YES			Level 1	Siemens Medical Systems	Lumines TF (Replaces Sireskop)	6207
	X-Ray: Digital R&F System with Spot Film Device, with 15" Image Intensifier, 90/45 Tilting Table, Complete with Overhead Tube Suspension Fluoro Monitor Bridge, Wall Bucky, 100kW	X226	No			Level 1	Siemens Medical Systems	Lumines TF (Replaces Sireskop)	6207
	X-Ray: Cath Lab, 2-Plane Radiographic System with Digital Imaging, Ceiling and Floor Mounted C-Arm, with Flat Panel Detectors	X248	No			Level 3	Toshiba - America Medical Systems	Infero C/FU/ BP	6800



FKP Architects


ARCHITECT OF RECORD
Paul C. Glorio



REVISIONS

02/05/10	INFORMATION BULLETIN #5
05/19/10	CHANGE ORDER #236

APPROVAL

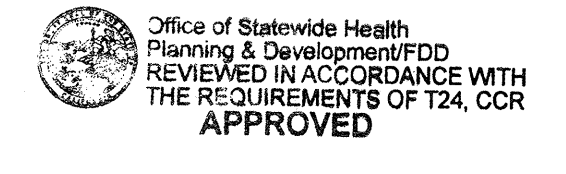

MAY 25 2010
CHANGE ORDER #236
OSHPD PERMIT
JEFFREY APPROVALS
10060001

PROJECT NAME
**CHILDREN'S HOSPITAL
OF ORANGE COUNTY**
455 S. Main St.
Orange, CA 92668-3874

TOWER II



PROJECT NUMBER
**12011.00
Increment #7**

OSHPD - PROJECT NUMBER
IL 072072-30

ISSUE
OSHPD PERMIT

DATE
01/27/2010

SCALE

DRAWING TITLE
OSHPD CAN-2

DRAWING NUMBER
A0.4D