

E

D

C

B


A

ROOM AIR BALANCE TABLE - TOWER II - FIFTH FLOOR SOUTH

ROOM NUMBER/NAME	ROOM AREA (FT.) ²	CEILING HEIGHT (FT.)	CMC		PRESSURE +/-	OSA AC/HR	SUPPLY CFM	RETURN CFM	EXHAUST CFM	INFILTRATION CFM	EXFILTRATION CFM
			AC/HR.	REQUIRED SUPPLY AC/HR.							
5.132 Patience Rm.	237	9	12	427	P	4	500	325	0	0	175
5.132.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.130 Patience Rm.	237	9	12	427	P	4	500	325	0	0	175
5.130.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.128 Patience Rm.	237	9	12	427	P	4	500	325	0	0	175
5.128.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.126 Patience Rm.	237	9	12	427	P	4	500	325	0	0	175
5.126.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.124 Patience Rm.	237	9	12	427	P	4	500	325	0	0	175
5.124.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.122 Patience Rm.	237	9	12	427	P	4	500	325	0	0	175
5.122.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.120 Patience Rm.	237	9	12	427	P	4	500	325	0	0	175
5.120.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.118 Patience Rm.	333	9	12	599	P	3	500	325	0	0	175
5.118.01 toilet	63	9	10	95	N	0	0	0	75	75	0
5.117 Conference	283	9	4	170	E	4	500	500	0	0	0
5.135 TLT Staff	61	9	10	92	N	3	100	0	175	75	0
5.111.01 Office CNS	117	9	4	70	E	3	200	200	0	0	0
5.111.02 Office Nurse MGR	118	9	4	71	E	3	200	200	0	0	0
5.131 Office Social worker child life	132	9	4	79	E	3	200	200	0	0	0
5.107 Office educator	158	9	4	95	E	3	200	200	0	0	0
5.133 Office charge Nurse	130	9	4	78	E	3	200	200	0	0	0
5.125 Elect. Room	84	9	4	50	E	24	1,000	1000	0	0	0
5.111/5.111.00.A Admin Aast./ Copy Alcove	146	9	4	88	E	3	200	200	0	0	0
5.115 Supply Room	95	9	4	57	E	6	300	300	0	0	0
5.127 Resident. workroom	114	9	4	68	E	8	300	300	0	0	0
5.111.03 Office Director	115	9	4	69	E	4	200	200	0	0	0
5.129 Soiled Workroom	96	9	10	144	N	3	200	0	300	100	0
5.109 Med. Station	198	9	4	119	E	10	500	500	0	0	0
5.109.01 Office Pharmacy	105	9	4	63	E	2	200	200	0	0	0
5.123 IS Room.	120	9	4	72	E	24	1,250	1250	0	0	0
5.113 Clean Utility/linen	393	9	10	590	P	15	800	650	0	0	150
5.121 Supply Room	106	9	10	159	E	5	300	300	0	0	0
5.105 Toilet Staff	75	9	10	113	N	3	100	0	175	75	0
5.102 Patient room.	241	9	12	434	E	4	500	325	0	0	175
5.102.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.104 Patient room.	241	9	12	434	E	4	500	325	0	0	175
5.104.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.106 Patient room.	241	9	12	434	E	4	500	325	0	0	175
5.106.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.108 Patient Room.	241	9	12	434	E	4	500	325	0	0	175
5.108.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.110 Patient Room.	241	9	12	434	E	4	500	325	0	0	175
5.110.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.112 Patient room.	241	9	12	434	E	4	500	325	0	0	175
5.112.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.114 Patient room.	241	9	12	434	E	4	500	325	0	0	175
5.114.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.116 Patient Room.	241	9	12	434	E	4	500	325	0	0	175
5.116.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.116.02 Parent Children Room	298	9	12	536	E	4	600	600	0	0	0
5.090.00.C Corridor/ 5.108.00.A Alcove stretch											
5.109.00.A Alcove Emergency Cart/5.104.00.A Alcove eq.	1152	9	4	691	E	2	1,200	600	1,200	875	275
5.093.00.C Corridor/5.109.00.B Nurse Station											
5.127.00.B Nurse Station/5.127.00.A Phialcion Chart. dict.	790	9	4	474	E	2	800	800	0	0	0
5.094.00.C Corridor/5.123.00.A Alcove Equipment											
5.129.00.A Alcove WC	1268	9	4	761	E	2	1,200	600	1,100	875	375
5.092.00.C Corridor/5.116.00Alcove family Nour.	348	9	4	209	E	2	400	400	0	0	0

ROOM AIR BALANCE TABLE - TOWER II - FIFTH FLOOR NORTH

ROOM NUMBER/NAME	ROOM AREA (FT.) ²	CEILING HEIGHT (FT.)	CMC		PRESSURE +/-	OSA AC/HR	SUPPLY CFM	RETURN CFM	EXHAUST CFM	INFILTRATION CFM	EXFILTRATION CFM
			AC/HR.	REQUIRED SUPPLY AC/HR.							
5.088.00.L Patient Staff Elevator Lobby	428	9	4	257	E	2	500	0	500	0	0
5.000.00.L Public Elevator Lobby	452	9	4	271	E	3	600	0	600	0	0
5.083.02 Consult	95	9	4	57	E	3	150	0	150	0	0
5.081 Storage equipment	197	9	4	118	E	2	150	0	150	0	0
5.083.01 TLT Public	49	9	10	74	N	2	50	0	150	100	0
5.083/5.083.00.A Visitor Waiting/Reception	700	9	4	420	E	2	800	0	700	0	100
5.140.02 TLT Accessible	63	9	10	95	N	0	0	0	75	75	0
5.140 Ante Rm.	57	9	15	128	N	5	150	0	0	0	150
5.140.01 Patience Airborn Infectious Room	227	9	15	511	P	5	600	0	675	150	75
5.138.02 TLT Accessible	63	9	10	95	N	0	0	0	75	75	0
5.138 Ante Rm.	55	9	15	124	N	5	150	0	0	0	150
5.138.01 Patience Airborn Infectious Room	241	9	15	542	P	5	600	0	675	150	75
5.136 Patience Rm.	238	9	12	428	P	4	500	325	0	0	175
5.136.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.134 Patience Rm.	237	9	12	427	P	4	500	325	0	0	175
5.134.01 toilet	40	9	10	60	N	0	0	0	75	75	0
5.101 IS Room.	120	9	6	108	E	21	1,250	1250	0	0	0
5.137 Supply Room	110	9	4	66	E	5	300	300	0	0	0
5.135.02 Multi Purpose Consult	124	9	4	74	E	3	200	200	0	0	0
5.141 Elect. Rm.	108	9	6	97	E	19	1,000	1000	0	0	0
5.103.02 Office Case Mgrs.	213	9	4	128	E	2	250	250	0	0	0
5.103.01 House keeping.	85	9	10	128	E	1	75	0	150	75	0
5.082 Lounge Family	239	9	4	143	E	3	400	0	400	0	0
5.139 Toilet Public	73	9	10	110	N	2	75	0	150	75	0
5.099 Storage general	256	9	10	384	E	2	300	300	0	0	0
5.139.01 TRSH Linen	55	9	10	83	E	4	100	0	175	75	0
5.097 Soiled Workroom	131	9	10	197	E	3	200	0	300	100	0
5.101.01 Exam Treatment	191	9	6	172	E	3	250	250	0	0	0
5.143 Storage equipment Apherisis	171	9	4	103	E	2	200	0	200	0	0
5.087.01 On-Call Room	102	9	4	61	E	4	200	200	0	0	0
5.087 Hall	121	9	4	73	E	3	200	200	0	0	0
5.087.02 On-Call Room	100	9	4	60	E	4	200	200	0	0	0
5.095 Supply Room	123	9	4	74	E	5	300	300	0	0	0
5.145 Clean Utility/linen	442	9	10	663	P	4	800	650	0	0	150
5.089 House keeping	69	9	10	104	N	3	100	0	175	75	0
5.087.04 Toilet Shower	100	9	10	150	N	2	75	0	150	75	0
5.087.03 On-Call Room	100	9	4	60	E	3	150	150	0	0	0
5.085 TLT Staff	71	9	10	107	N	3	100	0	175	75	0
5.084 Ante Room.	156	9	15	351	N	4	300	0	0	0	300
5.084.01 Patient Room Airborn Infectious Room	241	9	16	578	P	5	600	0	675	150	75
5.084.01.A TLT	40	9	10	60	N	0	0	0	75	75	0
5.084.02 Patient Room Airborn Infectious Room	222	9	15	500	P	5	600	0	675	75	0
5.084.02.A TLT	40	9	10	60	N	0	0	0	75	75	0
5.086 Staff Lounge/Lockers	660	9	4	396	E	2	700	0	700	0	0
5.090 Patient room.	236	9	12	425	P	4	500	325	0	0	175
5.090.01 TLT	40	9	10	60	N	0	0	0	75	75	0
5.092 Patient room.	241	9	12	434	P	4	500	325	0	0	175
5.092.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.094 Patient Room.	241	9	12	434	P	4	500	325	0	0	175
5.090.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.096 Patient room.	241	9	12	434	P	4	500	325	0	0	175
5.096.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.098 Patient room.	241	9	12	434	P	4	500	325	0	0	175
5.098.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.100 Patient room.	241	9	12	434	P	4	500	325	0	0	175
5.091 Storage Floor Nour.	117	9	6	105	P	5	300	300	0	0	0
5.100.01 Toilet	40	9	10	60	N	0	0	0	75	75	0
5.075.00.C Corridor/5.085.00.A Alcove family Nour.	963	9	4	578	E	2	1,000	900	0	0	100
5.088.00.C Corridor/5.091.00.A Nurse Station	955	9	4	573	E	2	1,000	1575	0	675	100
5.091.00.C Corridor	409	9	4	245	E	2	400	400	0	0	0
5.079.00.C Corridor	394	9	4	236	E	2	400	400	0	0	0
5.074.00.C Corridor	419	9	4	251	E	2	400	0	400	0	0

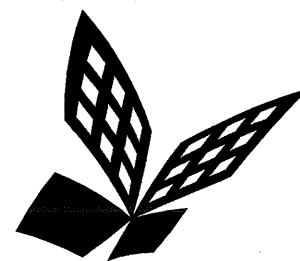

FKP Architects

ARCHITECT OF RECORD

*Architect of Record signature line only; this drawing was not prepared under the direct supervision of the Architect of Record. The direct responsibility for preparation of this sheet lies with its corresponding professional stamp and signature. The signature of the Architect of Record in