


FKP Architects


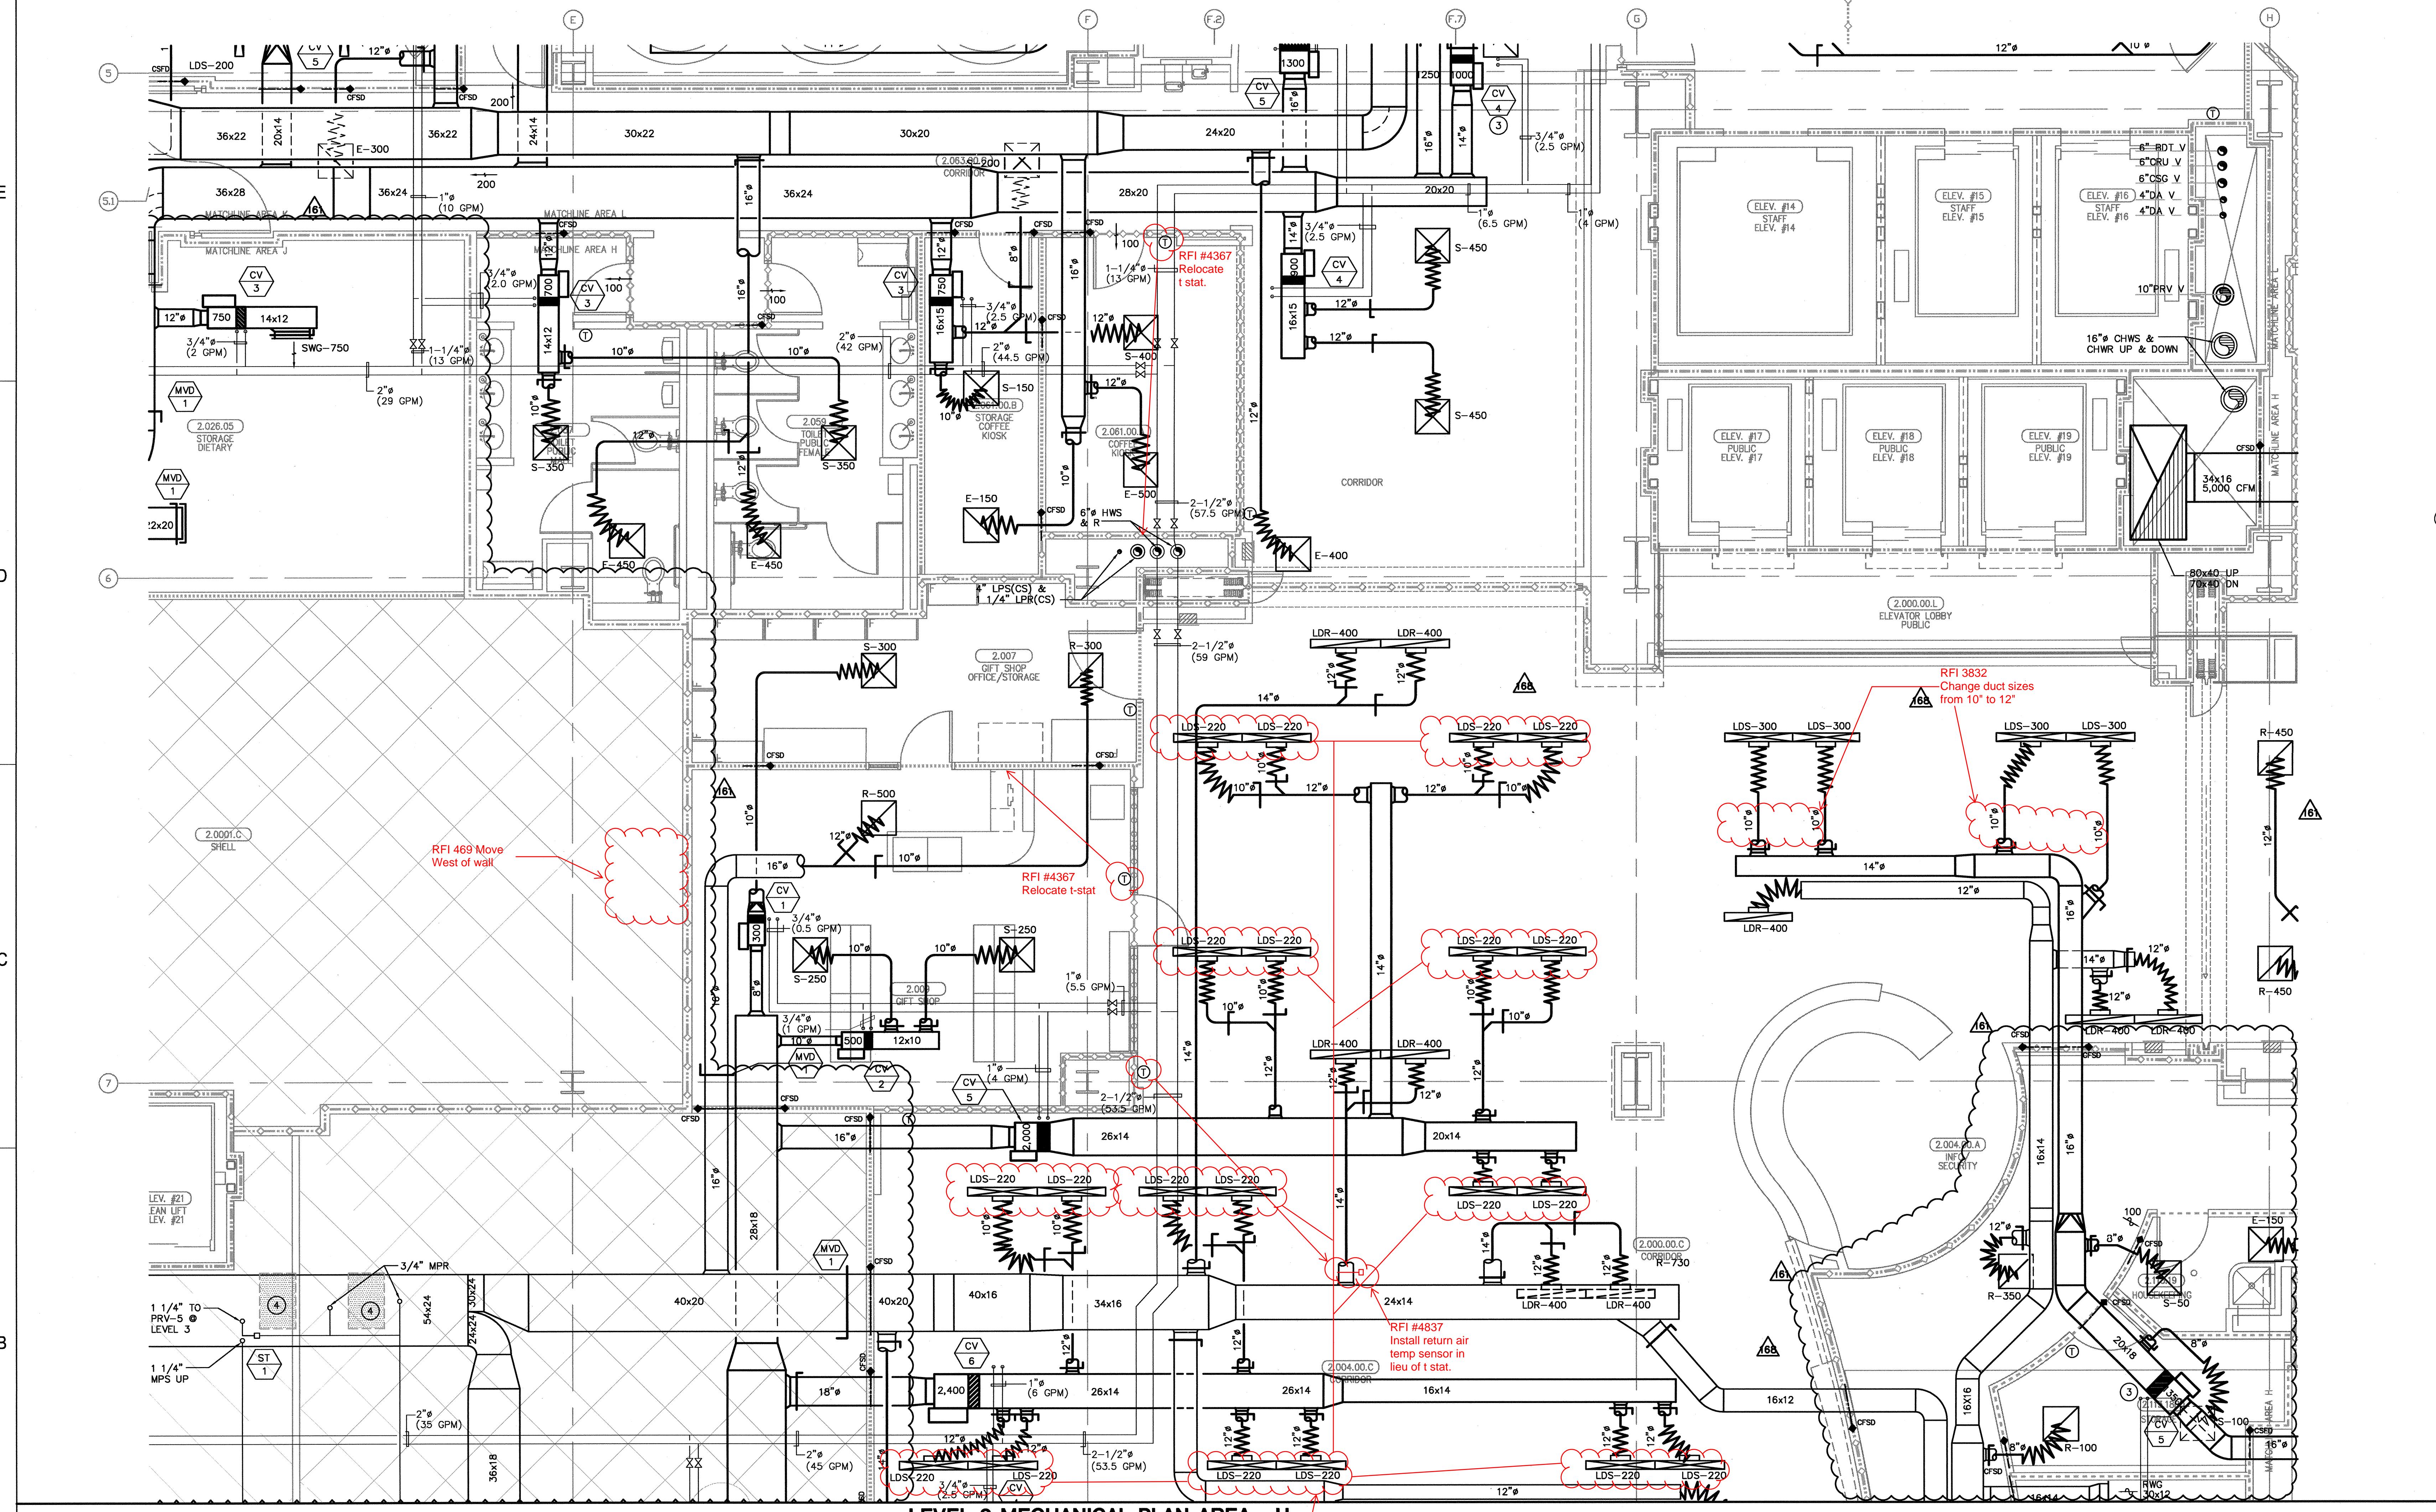


LEVEL 2 MECHANICAL PLAN AREA - H

DESIGN KEY NOTES

- 1 DDC CONTROL PANEL (PER CONTRACT & PROJECT REQUIREMENTS)
- 2 ALL WELDED SS CONSTRUCTION WITH 2 HR. FIRE RATED DUCT SHAFT.
- 3 PROVIDE 3-WAY VALVE FOR REHEAT COIL.
- 4 STERILIZER LOCATED ON THE THIRD FLOOR. STEAM LINE SUPPLY AND CONDENSATE RETURN SERVING THE STERILIZERS FROM LEVEL 2.
- 5 COOLING ONLY CV BOX

RFI 3832
All ducts connecting to LDS-220 diffusers are to be 10" round.

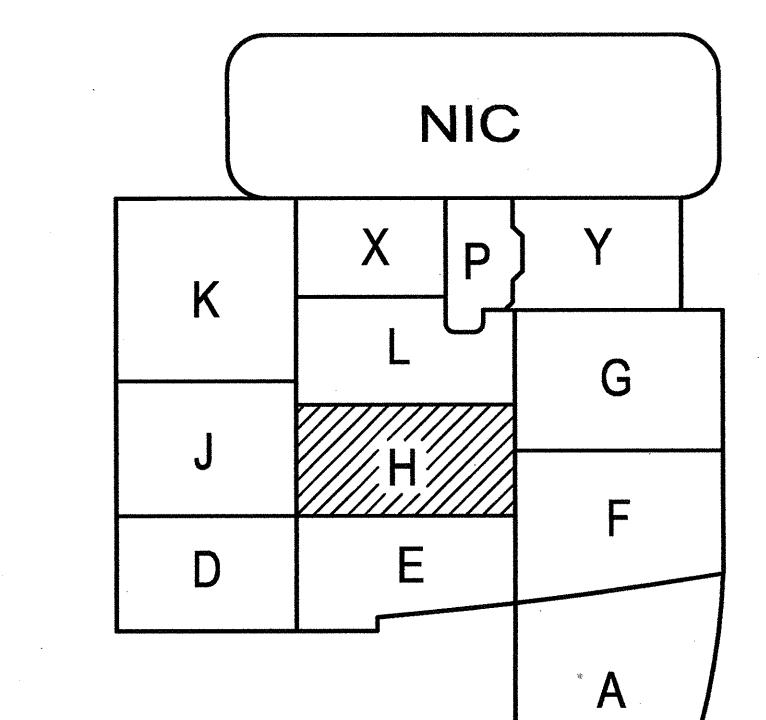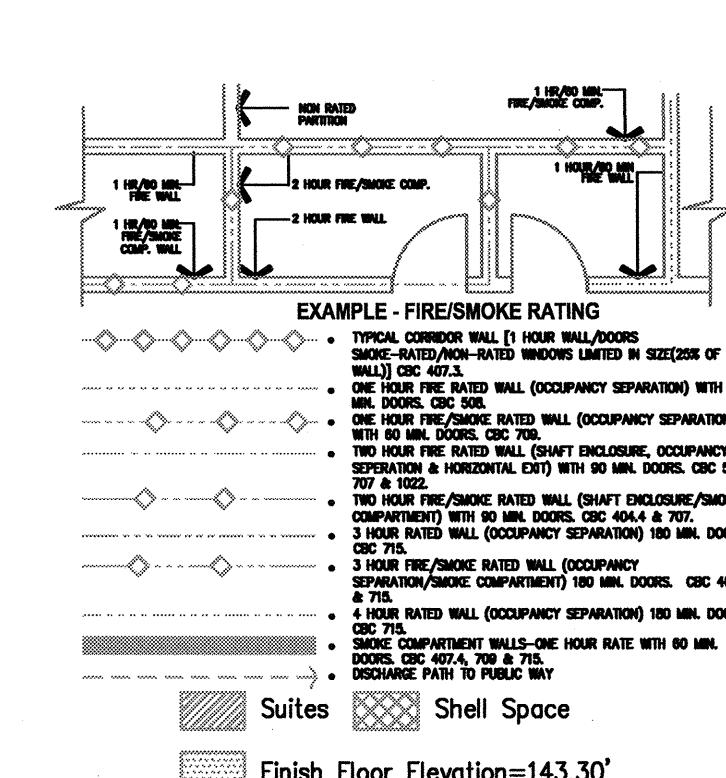

A1 Key Plan
N.T.S.

KEY PLAN

M3.2H