


KITCHEN EQUIPMENT SCHEDULE						
EQ #	EQUIPMENT NAME	VOLTAGE	AMPS	CONNECTION	CIRCUIT	FEEDER
0201	CONV. RECEPTACLE	120			1LA-12	2#12, 1#12 G.
0202	CONV. RECEPTACLE	120			1LA-14	2#12, 1#12 G.
0203	CONV. RECEPTACLE	120			1LA-33	2#12, 1#12 G.
8	ICE MAKER	120	19.9	HARD WIRED	1LA-10, 2#10	1#10 G. PROVIDE LOCKABLE CIRCUIT BREAKER.
12	TEA MAKER	120	14.8	RECEPTACLE	1LA-16	2#12, 1#12 G.
13	COFFEE MAKER	120/208	25.8	NEMA 14-30R	1LA-18,20	3#10, 1#10 G. VERIFY NEMA CONFIGURATION WITH EQUIPMENT.
19	CABINET WARMER	120	12	RECEPTACLE	1LA-22	2#12, 1#12 G.
20	REFRIGERATOR	120	9.1	RECEPTACLE	1LA-24	2#12, 1#12 G.

EQUIPMENT CALLOUTS CORRESPOND TO THE FOOD SERVICE PLANS.

- KEY NOTES:
- CONNECT TO EXHAUST FAN.
  - CONNECT TO FAN COIL UNIT.
  - REFER TO KITCHEN DRAWINGS FOR MOUNTING HEIGHTS AND EXACT LOCATIONS.
  - PROVIDE ALL 15A AND 20A 125V RECEPTACLES IN KITCHEN WITH GFI PROTECTION.
  - CONNECT TO BATTERY CHARGER. CIRCUIT TO 1E1A.
  - CONNECT TO JACKET WATER HEATER. CIRCUIT TO 1E1A.
  - CONNECT TO AHI.2.
  - STUB OUT TO CABLE TRAY. ROUTE 1" C. TIGHT TO SLAB.
  - CONNECT TO C02 AND C02 MANIFOLD. REFER TO P6001 FOR FURTHER INFORMATION.
  - CONNECT TO AV EQUIPMENT RACK.
  - PROVIDE ISOLATED GROUND.
  - CONNECT TO MECHANICAL CONTROLS.
  - CONNECT TO DOOR SECURITY XFMR.
  - INSTALL DOCK LEVELER CONTROL STATION. COORDINATE EXACT LOCATION WITH DOCK LEVELER SUBMITTAL DRAWINGS.
  - COORDINATE EXACT LOCATION WITH DOCK LEVELER SUBMITTAL DRAWINGS.
  - FROM JUNCTION BOX MAKE 120V CONNECTION TO CARD READER, DOOR CONTACT, AND REQUEST-TO-EXIT DEVICE AT ENTRY TO ANTE/ANTEMAIL.
  - CONNECT TO 750PM PUMP STATION. DISCONNECTS BY AQUANEERING. COORDINATE HEIGHT AND LOCATION WITH AQUANEERING CONNECTIONS:
    - 208V/1PH/3HP
    - 208V/1PH/1HP
    - 208V/1PH/1HP
    - 120V/12A
    - 120V/12A
  - CONNECT TO pH/SALINITY CONTROL THROUGH HP RATED SWITCH. COORDINATE LOCATION WITH AQUANEERING.
  - CONNECT TO FS THROUGH HP RATED SWITCH. COORDINATE LOCATION WITH AQUANEERING.
  - USE CORROSION RESISTANT MATERIALS, NEMA 4X STAINLESS.
- CONNECT TO 120V DISHWASHER.

SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE  
2880 TORREY PINES SCENIC DRIVE  
LA JOLLA, CALIFORNIA 92037

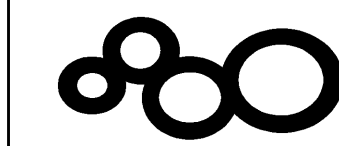

CONSULTANT  
**xyth**  
Sanford Consortium for Regenerative Medicine  
3070 Torrey Pines Drive, Suite 100  
La Jolla, CA 92037  
Tel: 858.592.1234  
Fax: 858.592.1235  
www.xyth.com

Sanford/Phelps Consortium LLC  
415 Broadway, Denver, CO 80202  
303.733.0000  
www.sanfordphelps.com

FENTRESS ARCHITECTS  
415 Broadway, Denver, CO 80202  
303.733.0000  
www.fentressarchitects.com

DAVIS ARCHITECTS  
3001 Park Avenue, San Diego, CA 92103  
619.594.1234  
www.davisarchitects.com

STAMP  
REGISTERED PROFESSIONAL ARCHITECT  
No. 10000  
Exp. 08-30-11  
ELECTRICAL  
STATE OF CALIFORNIA

SHEET NAME  
PARTIAL POWER FIRST FLOOR  
PLAN - ZONE 4

DRAWN BY: Author  
PROJECT # 200725.000  
SHEET NUMBER

E3214

SCALE  
1/4" = 1'-0"

1

PARTIAL POWER FIRST FLOOR PLAN - ZONE 4

10/20/2008 4:22:10 PM  
F:\A\3214\3214.dwg  
F:\A\3214\3214.dwg

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed architect, to alter an item in any way. If an item in this document is altered, the altering architect, if other than the architect of record, shall affix the item his seal and the notation "altered by" followed by his signature and the date of such alteration, and the specific description of the alteration.