

ISSUED FOR	DATE
Pre-Schematic Design	07/14/2009
Schematic Design	07/28/2009
BID PK #1	10/08/2009
BID PK #1 80 CD	12/01/2009
BID PK #1 100 CD	02/16/2009
BID PK #2 100 CD	03/26/2009
100% CD	05/08/2009
CD 4	01/07/2010
COB 1	02/26/2010
COB 2	02/26/2010
CD 4	04/15/2010
RVI PERMIT	05/05/2010
ASIM008 R1	07/01/2010
ASIM003	07/06/2010
ASIM015	07/09/2010
ASIM004	07/12/2010
ASIM005	07/19/2010
ASIM010	08/13/2010

- GENERAL NOTES:
- SEE AV DRAWINGS FOR ADDITIONAL CONDUIT REQUIREMENTS.
 - MOUNT ELECTRICAL DEVICES IN LER AT 42" AFF.

- KEY NOTES:
- INSTALL IN AV BOX.
 - CONNECT TO MOTORIZED SCREEN.
 - PROVIDE JUNCTION BOX AND (1) 1" C FOR BMS ALARM MONITORING STUB INTO ACCESSIBLE CEILING SPACE. TYP. FOR EQUIPMENT SPACE.
 - CONNECT TO CER CONTROLS.
 - CONNECT TO CER CONDENSER UNIT.
 - PROVIDE SWITCH IN CEILING FOR DISCONNECTING MEANS. TYPICAL FOR POD SPLIT SYSTEM.
 - CONNECT TO HAND DRYER.
 - NOT USED.
 - CONNECT TO SYSTEMS FURNITURE.
 - CONNECT TO FUME HOOD.
 - NEMA 6-20R.
 - NEMA 6-30R. PROVIDE 2#10, 1#100.
 - NEMA 5-20R.
 - PROVIDE ISOLATED GROUND.
 - CONNECT TO SECURITY POWER SUPPLY.
 - WALL SWITCH FOR PROJECTION SCREEN. PROVIDED BY PROJECTOR VENDOR.
 - CEILING MOUNTED DISCONNECT FOR PROJECTION SCREEN.
 - MOUNT TO PROJECTOR MOUNTING PLATE AT CEILING. PROVIDE 10" WHP FOR INSTALLATION FLEXIBILITY.
 - CONNECT TO BMS CONTROLS. COORDINATE EXACT LOCATION WITH CONTROLS CONTRACTOR.


SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE



Sanford Consortium
2880 TORREY PINES SCENIC DRIVE
LA JOLLA, CALIFORNIA 92037


CONSULTANT
Lankford/Phelps Consortium LLC
415 Broadway, Denver, CO 80202
(303) 733-8888

FENTRESS ARCHITECTS
415 Broadway, Denver, CO 80202
(303) 733-8888

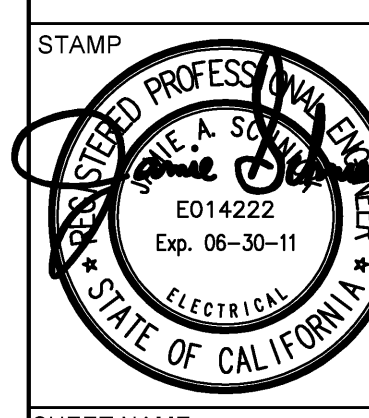

SHEET NAME
PARTIAL POWER FOURTH FLOOR PLAN - ZONE 1
DRAWN BY: Author
PROJECT # 200725.000
SHEET NUMBER

E3241

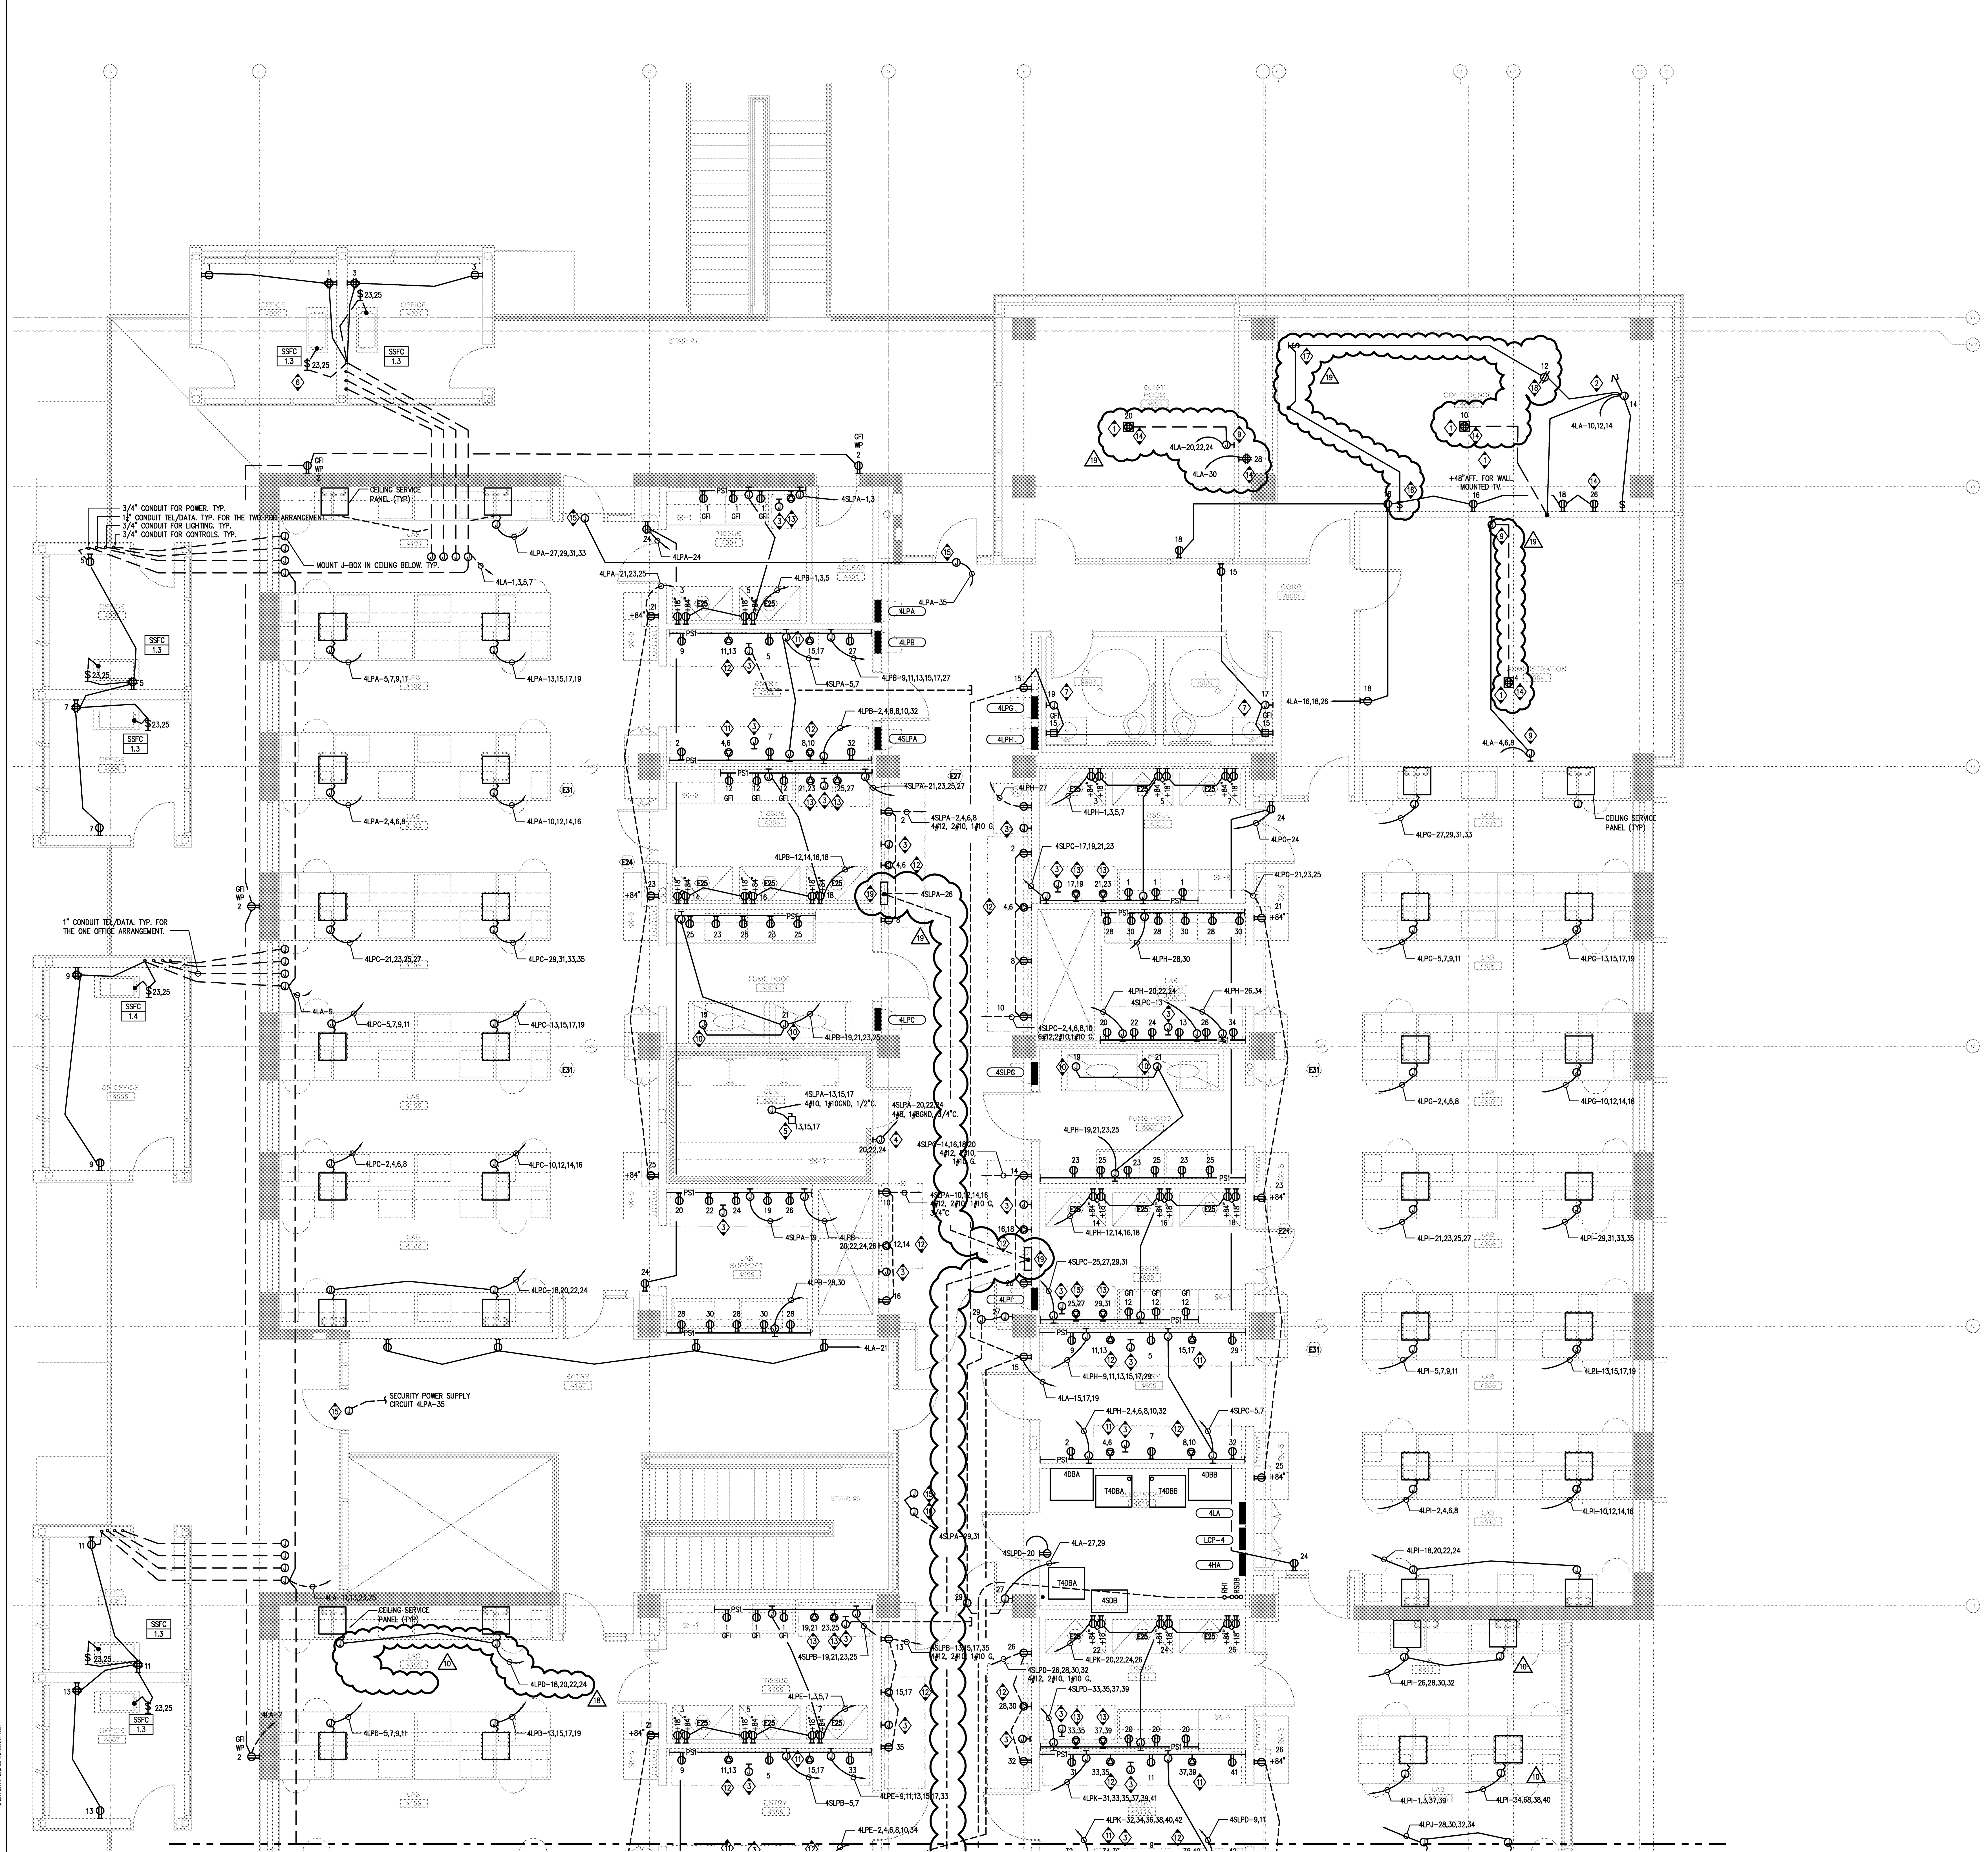

PARTIAL POWER FOURTH FLOOR PLAN - ZONE 1

SCALE 1/4" = 1'-0"

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed architect, to alter an item in any way. If an item in this document is altered, the altering architect, if other than the architect of record, shall affix the item his seal and the notation "altered by" followed by his signature and the date of such alteration, and the specific description of the alteration.