


ISSUED FOR	DATE
Pre-Schematic Design	07/14/2008
Schematic Design	07/28/2008
BID PK #1	10/09/2008
50% Program	10/24/2008
BID PK #1 80 CD	12/11/2008
BID PK #1 100 CD	02/18/2009
BID PK #2 100 CD	03/26/2009
100% CD	08/26/2009
CD 4	01/07/2010
COB 1	02/28/2010
COB 2	02/28/2010
CD 4	04/15/2010
RW PERMIT	05/05/2010
ASB1008 RT	07/01/2010
ASB1009	07/06/2010
ASB1015	07/09/2010
ASB1004	07/12/2010
ASB1008	07/16/2010
ASB1010	08/13/2010
ASB1011	08/27/2010
ASB1003	08/29/2010
ASB1018	11/17/2010
ASB1028	12/15/2010
ASB1028R2	01/14/2011
ASB1028	01/21/2011



- GENERAL NOTES:**
- PROVIDE (2) CAT-6 DATA DROPS FOR EACH DATA PORT LOCATION U.O.N.
  - ALL DEVICES AND SLEEVES IN FIRE RATED WALLS SHALL BE UL RATED FOR APPLICATION AND SHALL BE FIRESTOPPED WITH APPROPRIATE UL RATED SYSTEM.
  - PROVIDE 1" C.O. STUB WITH PULL STRING, TO ACCESSIBLE CEILING SPACE FOR ALL WALL MOUNTED DEVICES, U.O.N.
  - REFER TO ARCHITECTURAL AND ELECTRICAL SHEETS FOR ADDITIONAL MOUNTING INFORMATION, COORDINATE DEVICE MOUNTING HEIGHTS WITH ARCHITECTURAL ENLARGED PLANS AND OTHER TRADES IN THE FIELD.
  - ALL ACCESS CONTROL DOORS SHALL INTERFACE WITH FIRE ALARM CONTROL PANEL.
  - PROVIDE CONTROL RELAY(S) AS NEEDED, TO INTERFACE FIRE DOOR HOLDERS.
  - ALL LOW VOLTAGE CABLING SHALL BE PULLED TO MDF (ROOM 1906), U.O.N.
  - WIRELESS ACCESS POINTS: PROVIDE 4" x 4" JUNCTION BOX WITH SINGLE GANG TRM RING, MOUNTED IN THE ACCESSIBLE CEILING SPACE 6" TO 18" ABOVE FINISHED CEILING, WITH (2) CAT-6 DROPS AND 20' SERVICE LOOP PER LOCATION U.O.N.
- KEY NOTES:**
- SMOKE DETECTOR FOR ELEVATOR RECALL SERVICE.

**SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE**  
 2880 TORREY PINES SCENIC DRIVE  
 LA JOLLA, CALIFORNIA 92037

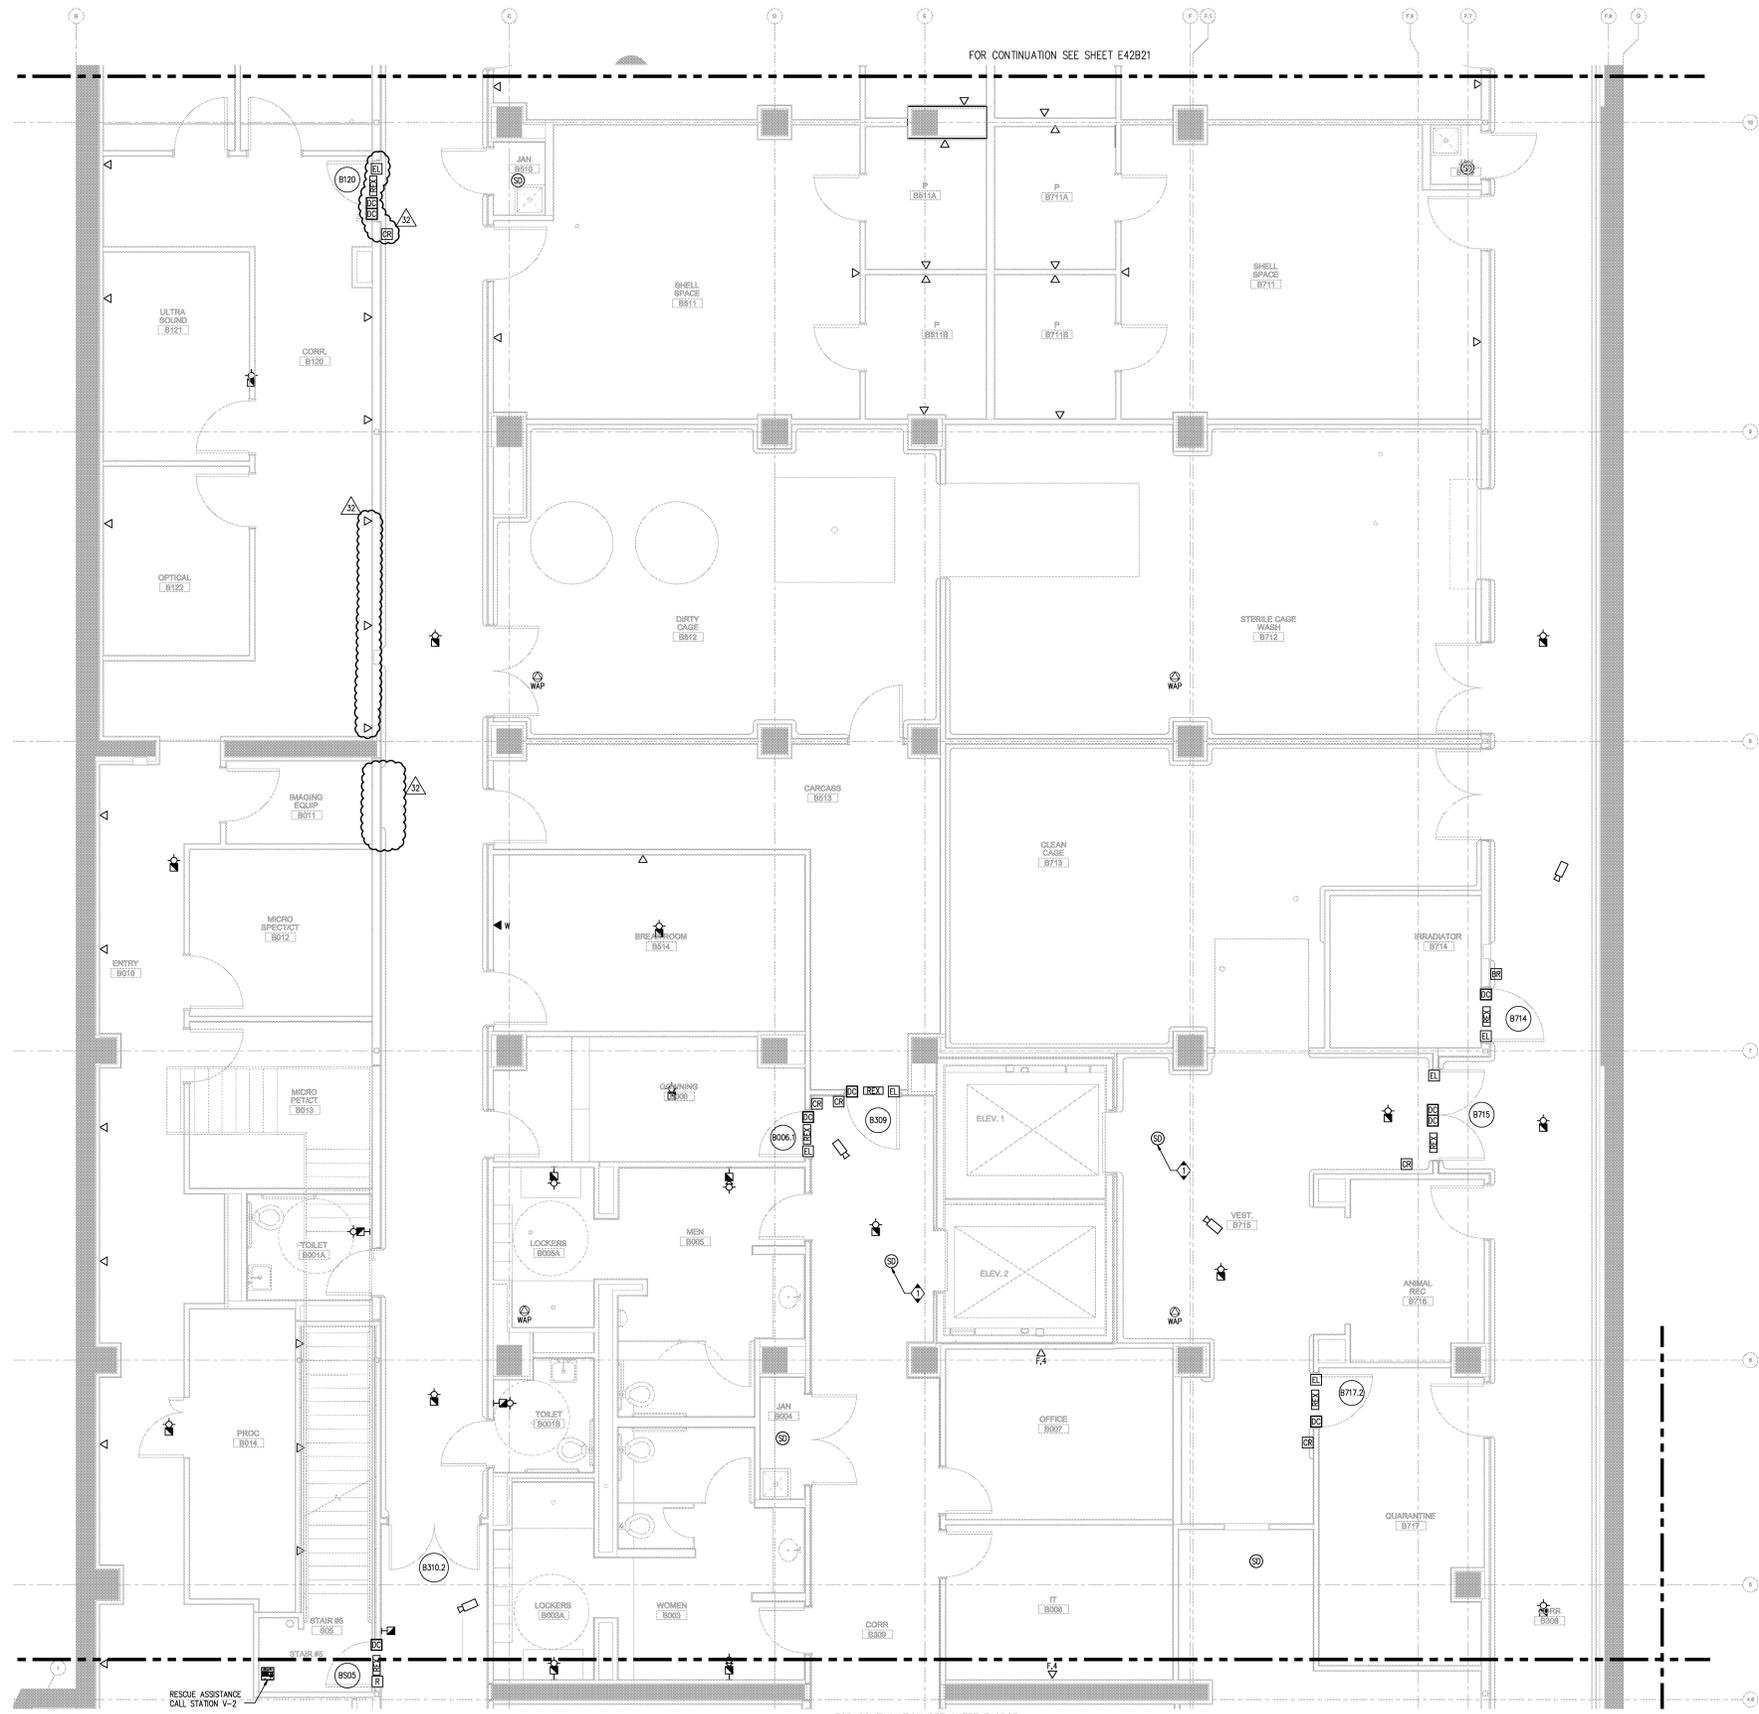


**CONSULTANT**  
 Landford/Phelps Consortium LLC  
 10000 Wilshire Blvd, Suite 1000  
 Beverly Hills, CA 90210  
 (310) 274-1111

**FENTRESS ARCHITECTS**  
 4000 Wilshire Blvd, Suite 1000  
 Beverly Hills, CA 90210  
 (310) 274-1111



**SHEET NAME**  
 PARTIAL SIGNAL VIVARIUM  
 PLAN - ZONE 2

**DRAWN BY:** Author  
**PROJECT #:** 200726.000  
**SHEET NUMBER**  
 E42B22



PARTIAL SIGNAL VIVARIUM PLAN - ZONE 2

10/25/2011 4:52:10 PM

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed architect, to alter an item in any way. If an item in this document is altered, the altering architect, if other than the architect of record, shall affix the item his seal and the notation "altered by" followed by his signature and the date of such alteration, and the specific description of the alteration.