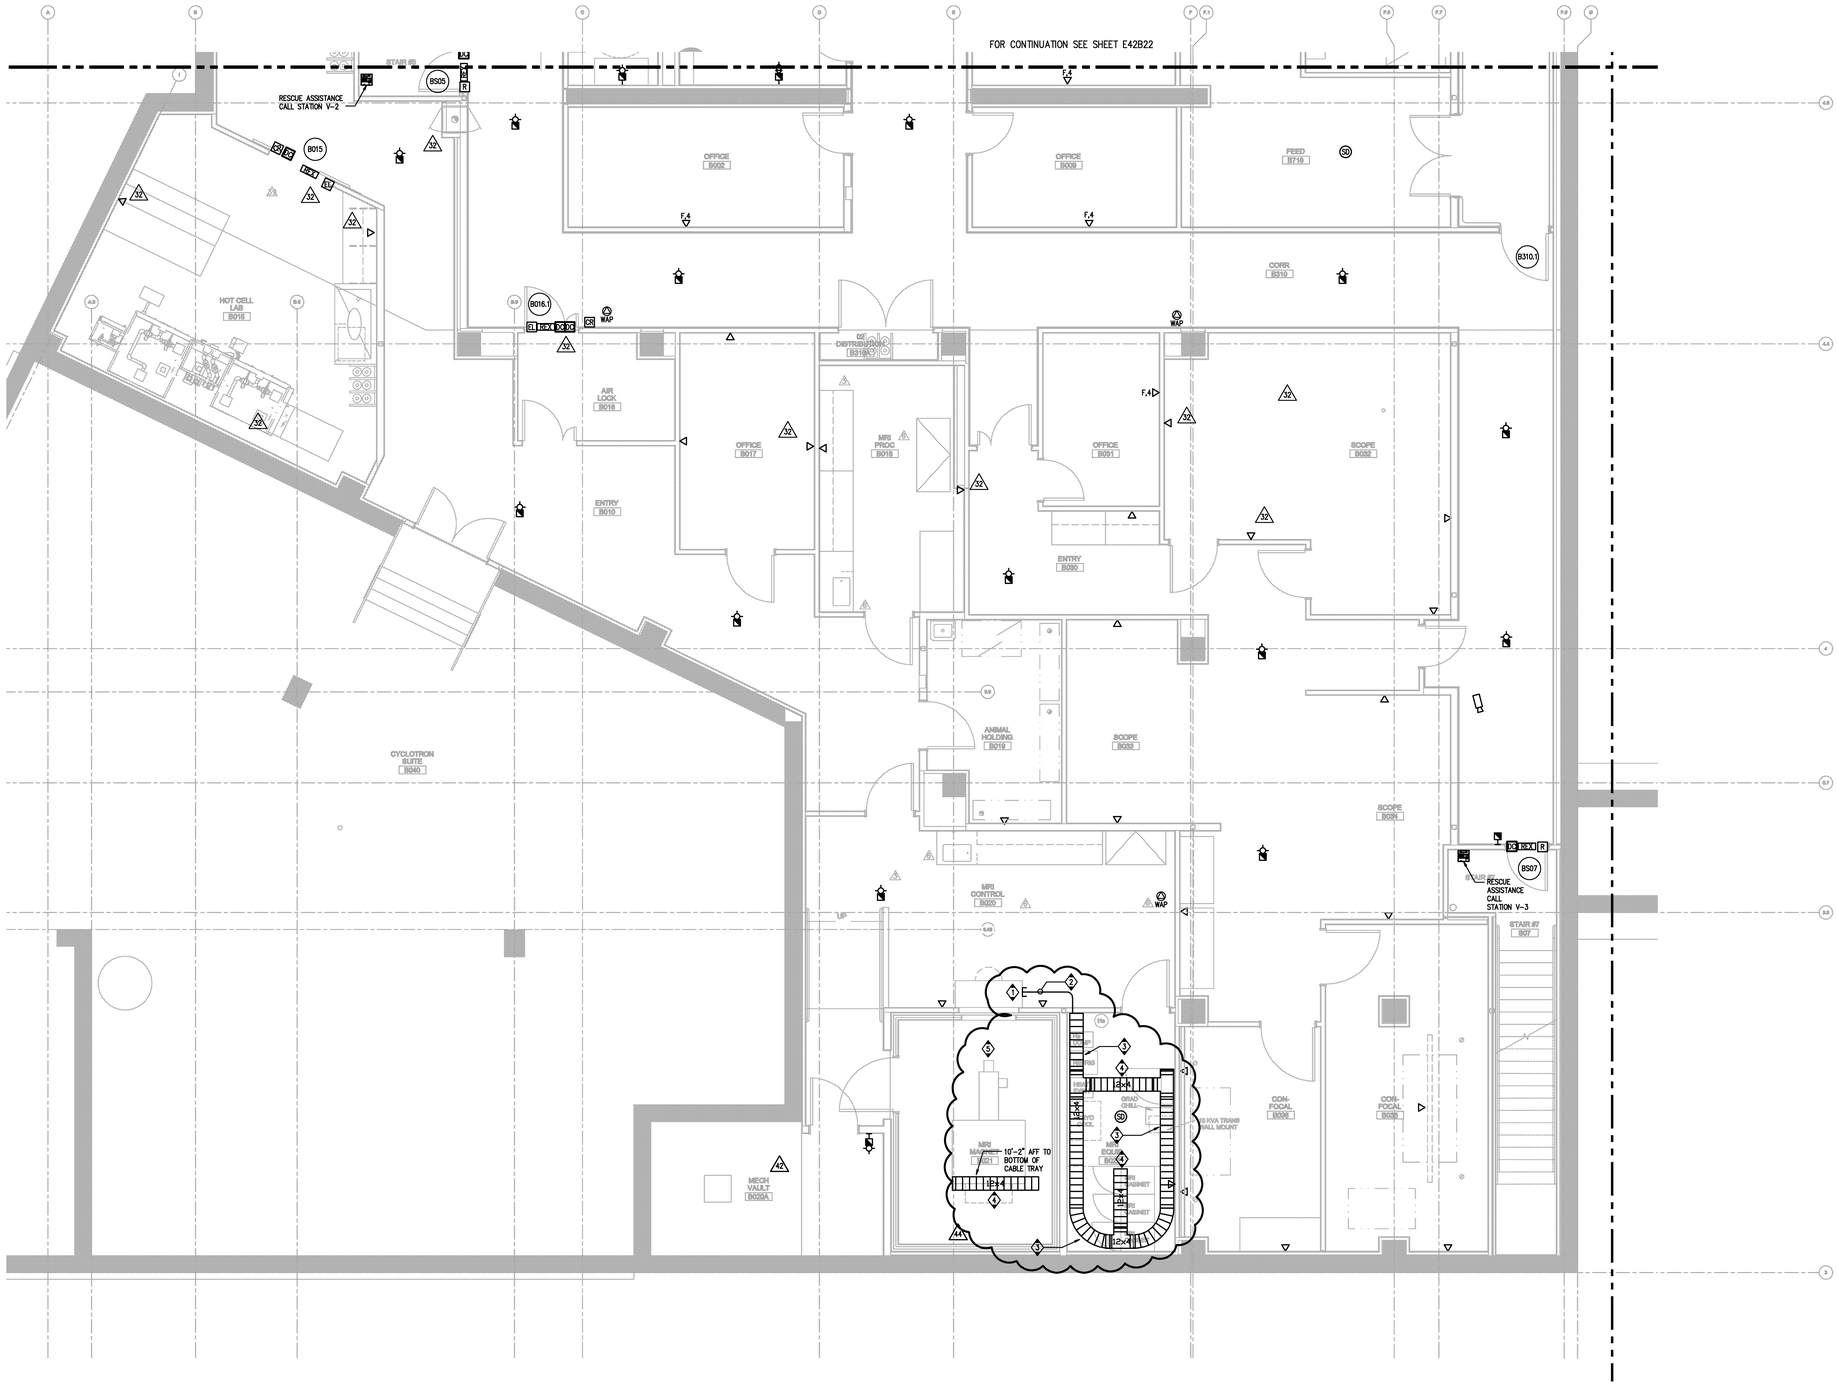

GENERAL NOTES:

1. PROVIDE (2) CAT-6 DATA DROPS FOR EACH DATA PORT LOCATION U.O.N.
2. ALL DEVICES AND SLEEVES IN FIRE RATED WALLS SHALL BE UL RATED FOR APPLICATION AND SHALL BE FIRESTOPPED WITH APPROPRIATE UL RATED SYSTEM.
3. PROVIDE 1" C.O. STUB WITH PULL STRING, TO ACCESSIBLE CEILING SPACE FOR ALL WALL MOUNTED DEVICES, U.O.N.
4. REFER TO ARCHITECTURAL AND ELECTRICAL SHEETS FOR ADDITIONAL MOUNTING INFORMATION, COORDINATE DEVICE MOUNTING HEIGHTS WITH ARCHITECTURAL ENLARGED PLANS AND OTHER TRADES IN THE FIELD.
5. ALL ACCESS CONTROL DOORS SHALL INTERFACE WITH FIRE ALARM CONTROL PANEL.
6. PROVIDE CONTROL RELAY(S) AS NEEDED, TO INTERFACE FIRE DOOR HOLDERS.
7. ALL LOW VOLTAGE CABLING SHALL BE PULLED TO MDF (ROOM 1906), U.O.N.
8. WIRELESS ACCESS POINTS. PROVIDE 4" X 4" JUNCTION BOX WITH SINGLE GANG TRIM RING, MOUNTED IN THE ACCESSIBLE CEILING SPACE 6" TO 18" ABOVE FINISHED CEILING, WITH (2) CAT-6 DROPS AND 20" SERVICE LOOP PER LOCATION U.O.N.

42

KEY NOTES:

1. (2) 2" C.O. STUBS TO DEVICE
2. 2" C.O. ROUTED FROM CABLE TRAY DOWN TO 12"AFF ADJACENT TO COMPUTER DESK LOCATION.
3. HALF RACK, WALL MOUNTED CABLE ALUMINUM CABLE TRAY WITH 9" RUNG SPACING. MOUNTED AT 7'-6" AFF TO BOTTOM OF CABLE TRAY.
4. CENTER HUNG ALUMINUM CABLE TRAY WITH 9" RUNG SPACING MOUNTED AT 7'-6" AFF TO BOTTOM OF CABLE TRAY. U.O.N.
5. ALL DEVICES IN THIS ROOM SHALL BE CONSTRUCTED OF NON FERROUS METAL INCLUDING CONDUIT, BOXES, ALL MOUNTING HARDWARE, SCREWS AND FASTENERS.

44

COPYRIGHT ©
FENTRESS ARCHITECTS

ISSUED FOR	DATE
50% Progress	10/24/2008
BID PK #1 60 CD	12/01/2008
BID PK #1 100 CD	02/16/2009
BID PK #2 100 CD	03/26/2009
100% CD	05/05/2009
CD 4	01/07/2010
COB 1	02/26/2010
COB 2	02/26/2010
BDA REVIEW	06/29/2009
RW PERMIT	05/05/2010
ASI#008 R1	07/01/2010
ASI#006	07/06/2010
ASI#016	07/08/2010
ASI#004	07/12/2010
ASI#002R2	07/19/2010
ASI#010	08/13/2010
ASI#011	08/27/2010
ASI#020	09/20/2010
ASI#016	11/17/2010
ASI#028	12/16/2010
ASI#028R2	01/14/2011
ASI#026	01/21/2011
ASI#028R1	01/28/2011
ASI#018R1	02/16/2011
RFI#1203	02/16/2011
ASI#030	06/10/2011
ASI#030R1	06/08/2011

SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE

2880 TORREY PINES SCENIC DRIVE
LA JOLLA, CALIFORNIA 92037

CONSULTANT

Landford/Phelps Consortium LLC

FENTRESS | ARCHITECTS

DAVIS DAVIS ARCHITECTS
3401 Fifth Avenue San Diego, CA 92103

STAMP

REGISTERED PROFESSIONAL ENGINEER
E. A. SCHMIDT
ED14222
Exp. 06-30-11
ELECTRICAL
STATE OF CALIFORNIA

SHEET NAME
PARTIAL SIGNAL VIVARIUM PLAN - ZONE 3

DRAWN BY: Author

PROJECT #: 200725.000

SHEET NUMBER
E42B23

PARTIAL SIGNAL VIVARIUM PLAN – ZONE 3

SCALE 1/4" = 1'-0"

1

10/22/2009 4:05:10 PM
File Name