

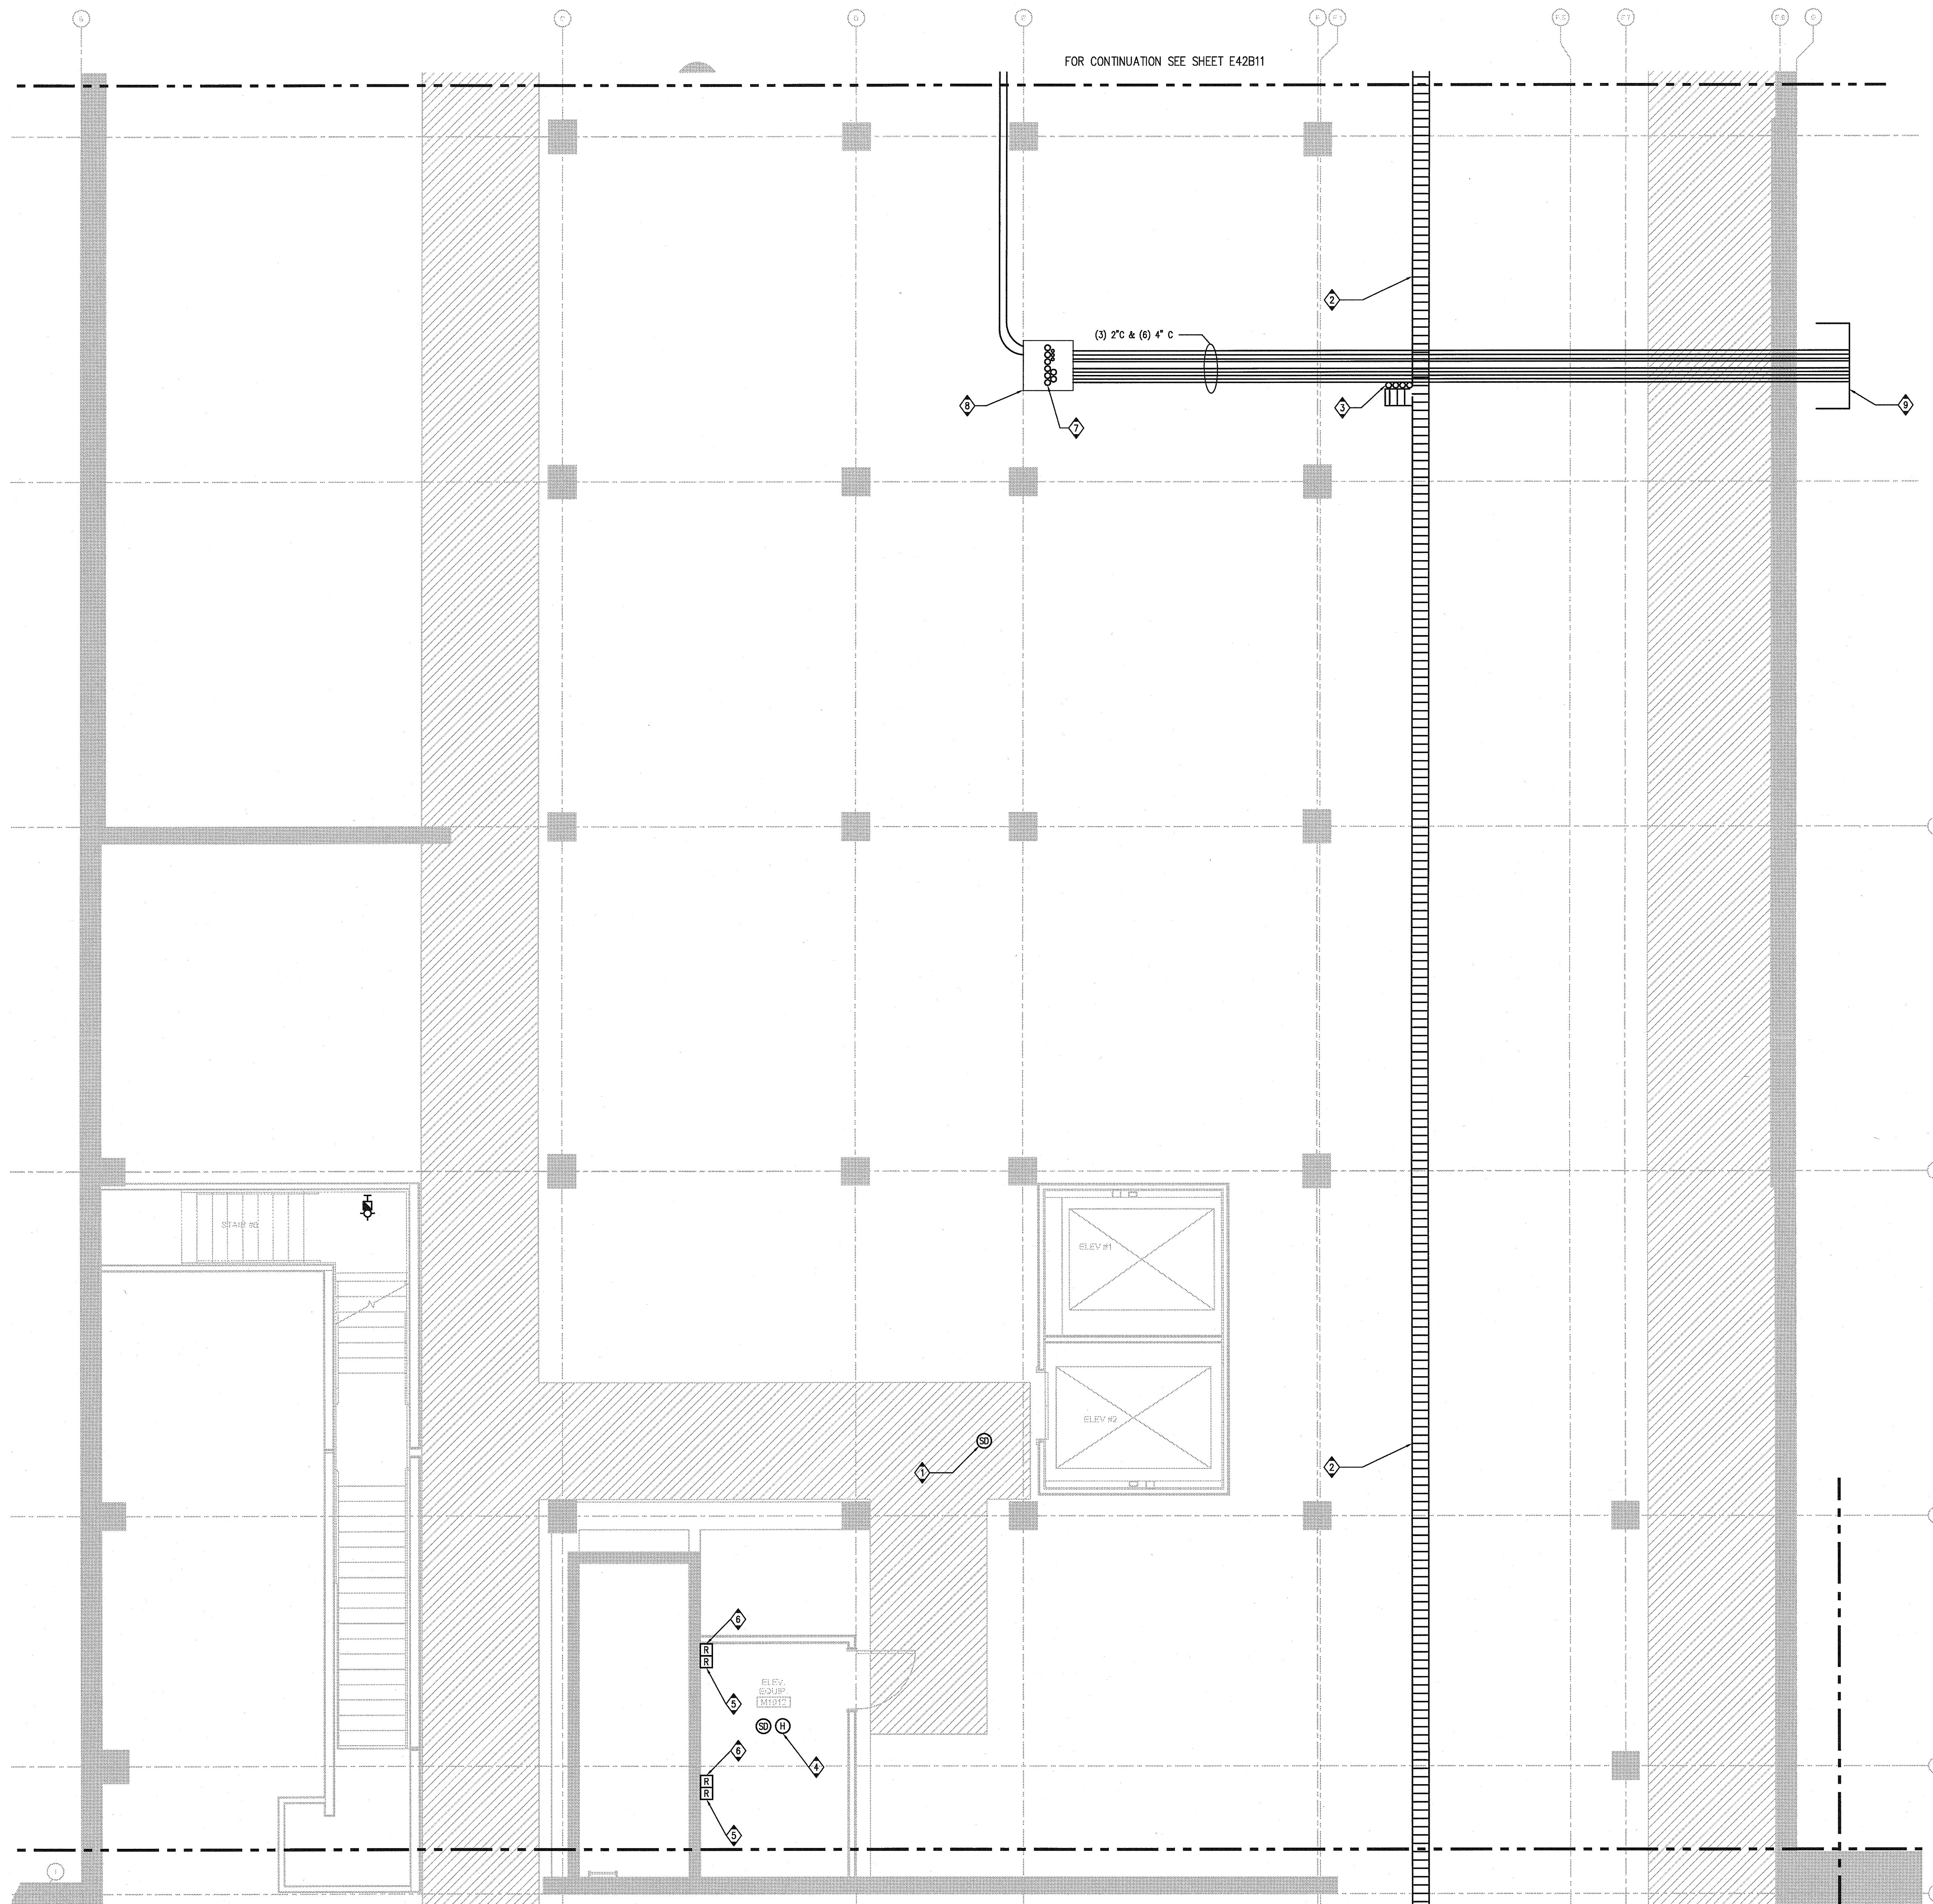


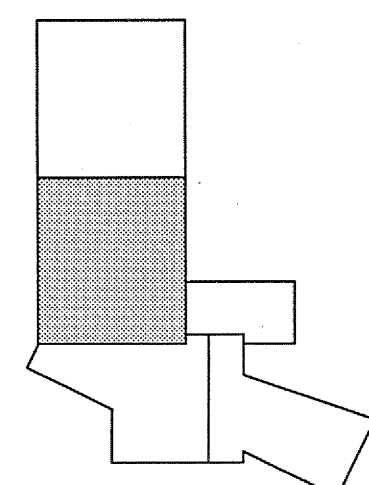

- GENERAL NOTES:**
1. PROVIDE (2) CAT-6 DATA DROPS FOR EACH DATA PORT LOCATION U.O.N.
 2. ALL DEVICES AND SLEEVES IN FIRE RATED WALLS SHALL BE UL RATED FOR APPLICATION AND SHALL BE FIRESTOPPED WITH APPROPRIATE UL RATED SYSTEM.
 3. PROVIDE 1" C.O. STUB WITH PULL STRING, TO ACCESSIBLE CEILING SPACE FOR ALL WALL MOUNTED DEVICES, U.O.N.
 4. REFER TO ARCHITECTURAL AND ELECTRICAL SHEETS FOR ADDITIONAL MOUNTING INFORMATION, COORDINATE DEVICE MOUNTING HEIGHTS WITH ARCHITECTURAL ENLARGED PLANS AND OTHER TRADES IN THE FIELD.
 5. ALL ACCESS CONTROL DOORS SHALL INTERFACE WITH FIRE ALARM CONTROL PANEL.
 6. ALL LOW VOLTAGE CABLING SHALL BE PULLED TO MDF (ROOM 1906), U.O.N.
- KEY NOTES:**
- 1. SMOKE DETECTOR FOR ELEVATOR RECALL SERVICE.
 - 2. 4" x 12" CABLE TRAY.
 - 3. (4) 4" C. SLEEVES TO MDF ROOM 1906, FOR VIVARUM COMMUNICATIONS CABLING.
 - 4. HEAT DETECTOR FOR ELEVATOR SHUNT TRIP SERVICE. INSTALL DETECTOR WITHIN 2FT OF SPRINKLER HEAD.
 - 5. RELAY MODULE FOR ELEVATOR RECALL. INSTALL MODULE WITHIN 3FT OF CONTROLLED CIRCUIT. TYPICAL OF (2).
 - 6. RELAY MODULE FOR ALTERNATE ELEVATOR RECALL. INSTALL MODULE WITHIN 3FT OF CONTROLLED CIRCUIT. TYPICAL OF (2).
 - 7. (3) 4" C. & (8) 4" C. SLEEVES TO MDF ROOM 1906, FOR COMMUNICATIONS CABLING.
 - 8. PROVIDE 35"x35"x2" JUNCTION BOX.
 - 9. TELECOM/SIGNAL CONDUITS TO TELECOMMUNICATIONS PULL BOXES. SEE SHEETS E1103 & E1104 FOR CONTINUATION.

Cler U.C.S.D.	
DATE	APR 15 2010
PRELIMINARY DRAWINGS	☐
PROGRESS DRAWINGS	☐
REVIEW DRAWINGS	☐
CONSTRUCTION DRAWINGS	☒

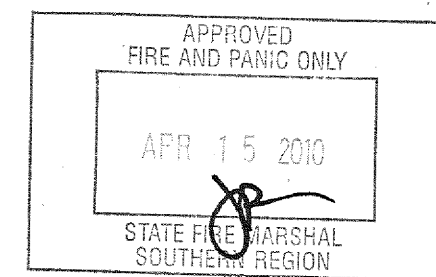

Sanford Consortium for Regenerative Medicine
2880 TORREY PINES SCENIC DRIVE
LA JOLLA, CALIFORNIA 92037

FENTRESS ARCHITECTS
47114
STATE OF CALIFORNIA
EXPIRES 05-30-11

DAVID DAVIDS ARCHITECTS
47114
STATE OF CALIFORNIA
EXPIRES 05-30-11

U.C.S.D.
PRELIMINARY DRAWINGS
PROGRESS DRAWINGS
REVIEW DRAWINGS
CONSTRUCTION DRAWINGS

APR 15 2010
FENTRESS ARCHITECTS
STATE OF CALIFORNIA

E42B12

1/22/2008 4:32:10 PM
F:\Projects\2008\Sanford\Drawings\Sheet\E42B12.dwg
User: fentress
Title: E42B12