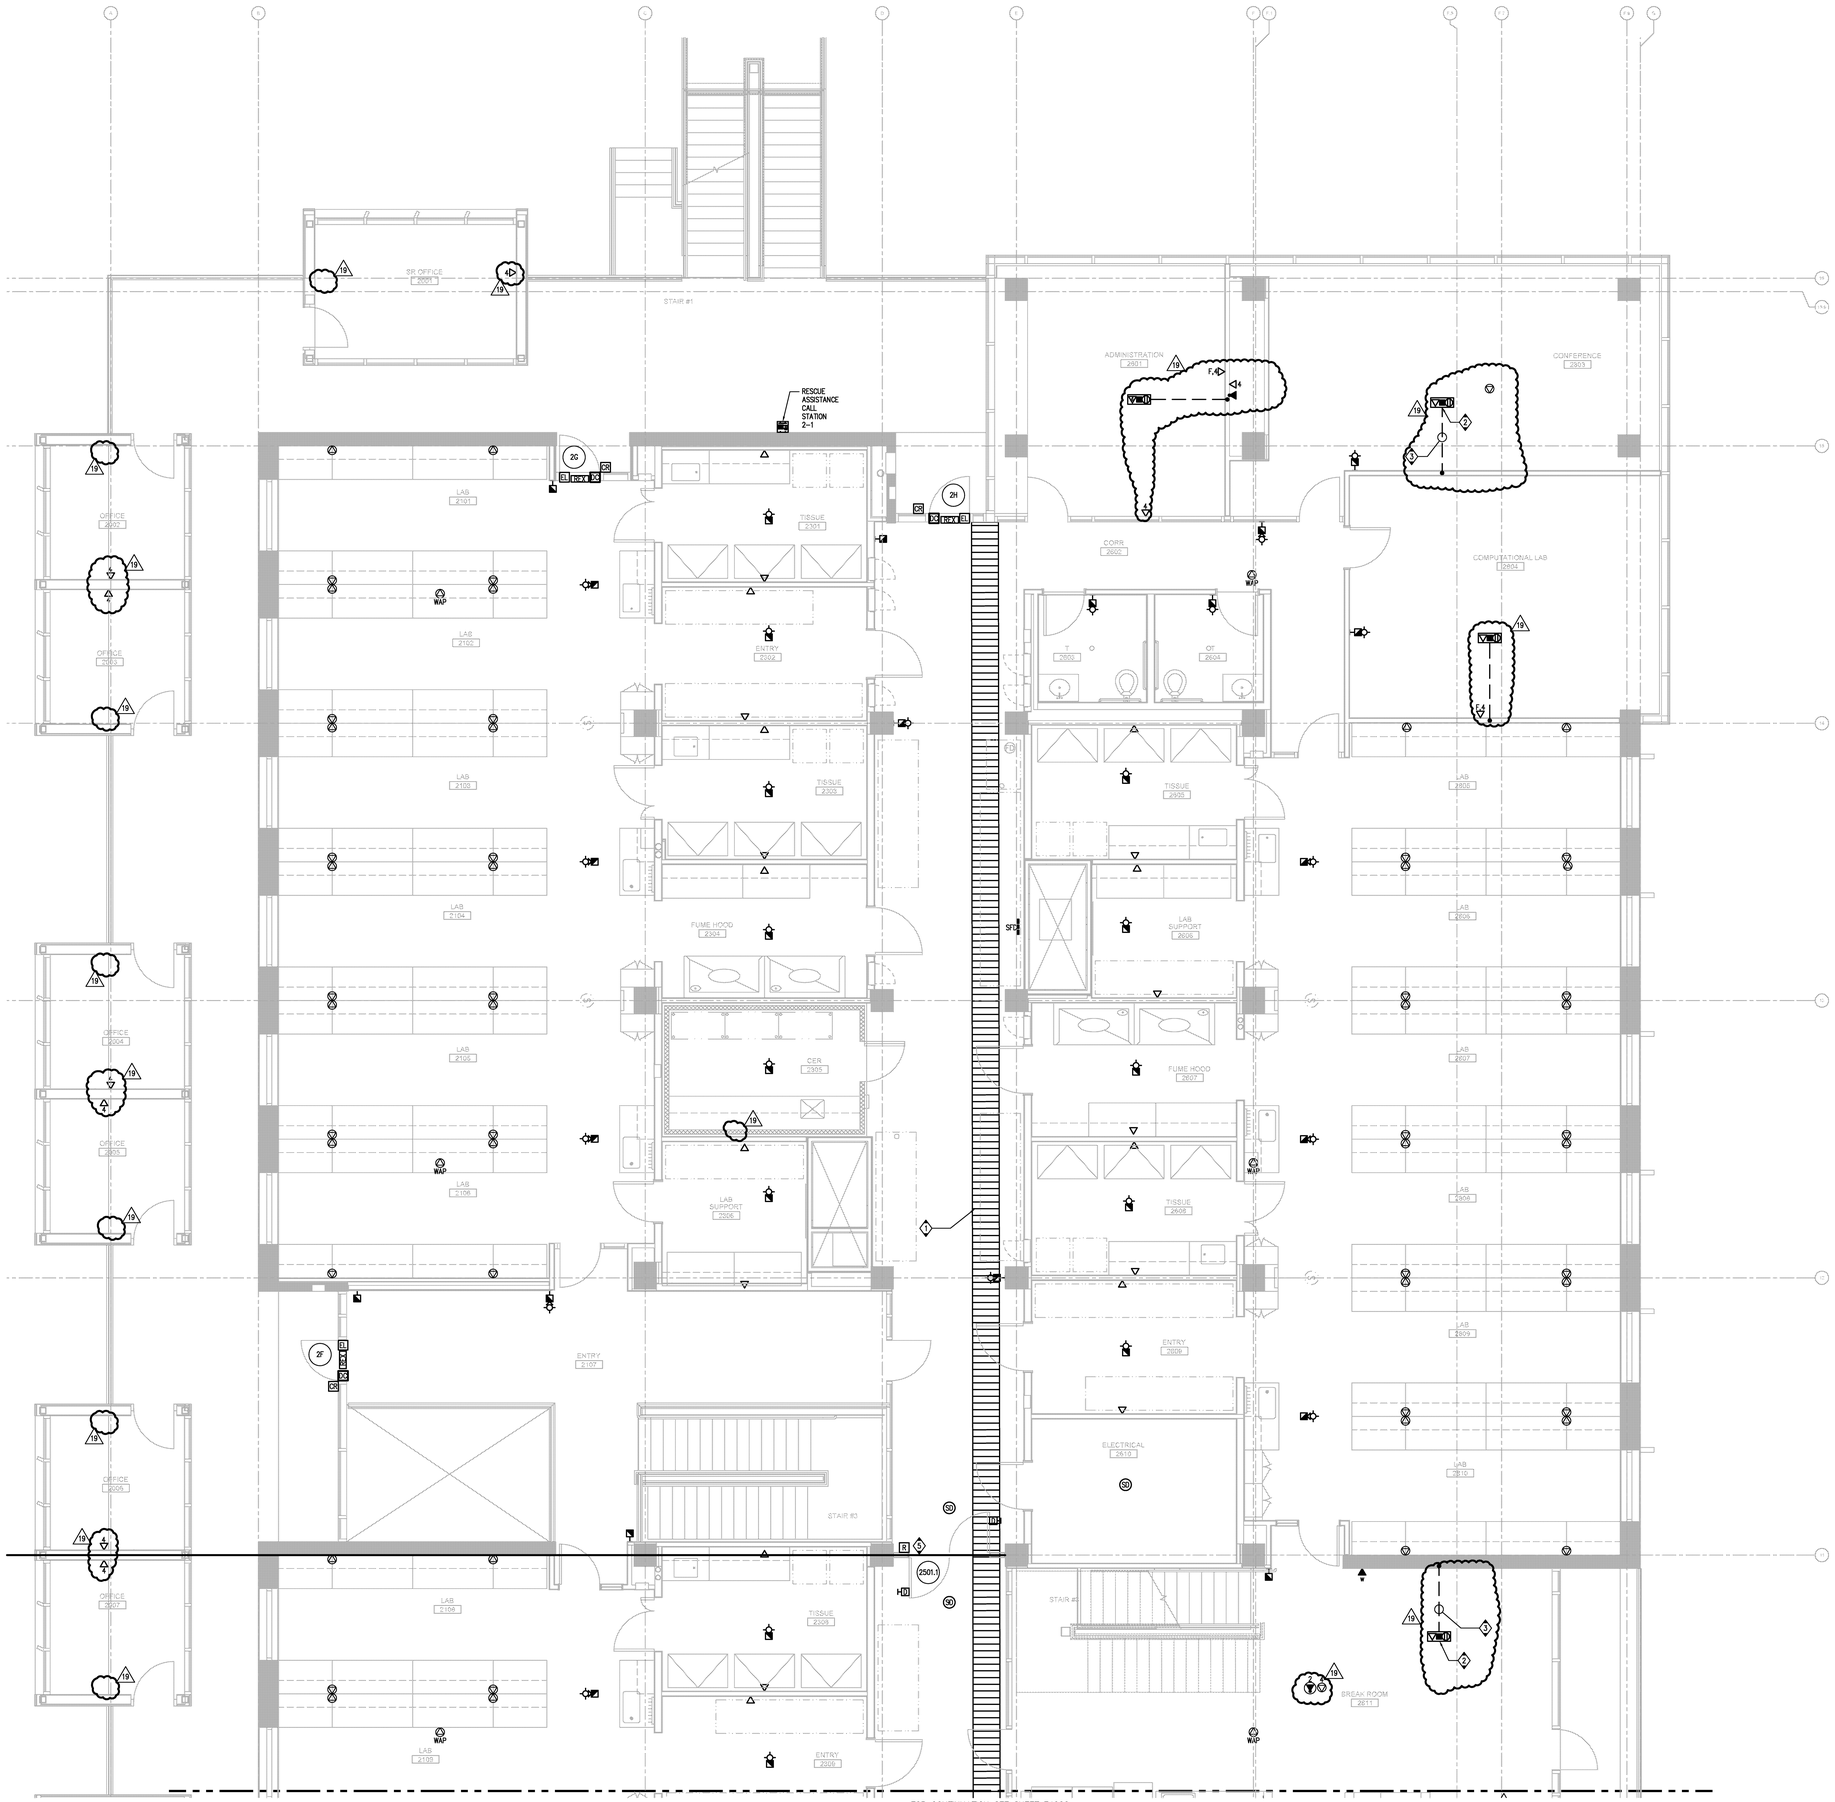

GENERAL NOTES:

1. PROVIDE (2) CAT-6 DATA DROPS FOR EACH DATA PORT LOCATION U.O.N.
2. ALL DEVICES AND SLEEVES IN FIRE RATED WALLS SHALL BE UL RATED FOR APPLICATION AND SHALL BE FIRESTOPPED WITH APPROPRIATE UL RATED SYSTEM.
3. PROVIDE 1" C.O. STUB WITH PULL STRING, TO ACCESSIBLE CEILING SPACE FOR ALL WALL MOUNTED DEVICES, U.O.N.
4. REFER TO ARCHITECTURAL AND ELECTRICAL SHEETS FOR ADDITIONAL MOUNTING INFORMATION, COORDINATE DEVICE MOUNTING HEIGHTS WITH ARCHITECTURAL ENLARGED PLANS AND OTHER TRADES IN THE FIELD.
5. ALL ACCESS CONTROL DOORS SHALL INTERFACE WITH FIRE ALARM CONTROL PANEL.
6. PROVIDE CONTROL RELAY(S) AS NEEDED, TO INTERFACE FIRE DOOR HOLDERS.
7. ALL LOW VOLTAGE CABLING SHALL BE PULLED TO IDF (ROOM 2612), U.O.N.
8. WIRELESS ACCESS POINTS. PROVIDE 4" X 4" JUNCTION BOX WITH SINGLE GANG TRM RING, MOUNTED IN THE ACCESSIBLE CEILING SPACE 6" TO 18" ABOVE FINISHED CEILING, WITH (2) CAT-6 DROPS AND 20' SERVICE LOOP PER LOCATION U.O.N.

KEY NOTES:

1. 4" X 24" CABLE TRAY.
2. INSTALL IN AV CONTRACTOR SUPPLIED BOX, REFER TO AV DRAWINGS FOR DETAILS.
3. PROVIDE (1) 1" C. FOR TELECOM TO ACCESSIBLE CEILING SPACE
4. 19
5. RELAY FOR SMOKE CONTROL DOOR HOLD OPEN, REFER TO ARCHITECTURAL AND ELECTRICAL SHEETS FOR ADDITIONAL MOUNTING INFORMATION, COORDINATE DEVICE MOUNTING LOCATION WITH ARCHITECTURAL ENLARGED PLANS AND OTHER TRADES IN THE FIELD.

COPYRIGHT © FENTRESS ARCHITECTS

ISSUED FOR	DATE
Pre-Schematic Design	07/14/2008
Schematic Design	07/28/2008
BID PK #1	10/06/2008
50% Progress	10/24/2008
BID PK #1 80 CD	12/01/2008
BID PK #1 100 CD	02/16/2009
BID PK #2 100 CD	03/26/2009
100% CD	05/08/2009
IBDA REVIEW	08/08/2009
COB 1 1	02/26/2010
COB 2 2	02/26/2010
CD 4	04/15/2010
PW PERMIT	05/05/2010
ASI#008 R1 1	07/01/2010
ASI#005 1	07/06/2010
ASI#015 1	07/09/2010
ASI#004 1	07/12/2010
ASI#008R2 1	07/19/2010
ASI#010 1	08/13/2010

SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE

2880 TORREY PINES SCENIC DRIVE
LA JOLLA, CALIFORNIA 92037

CONSULTANT

Kreth
Kreth Inc./ San Diego - North
3870 Oceanic Dr
Suite 100, Oceanside, CA 92056
Tel: (760) 631-1670 Fax: (760) 597 0665
Kreth # 2008054

Lankford/Phelps Consortium LLC
855 Oak Grove Avenue, Suite 1400 Menlo Park, CA 94025
650.326.8200

FENTRESS | ARCHITECTS
420 Broadway, Denver, CO 80203
303.722.2000

DAVIS DAVIS ARCHITECTS
2401 Fifth Avenue San Diego, CA 92101

STAMP

REGISTERED PROFESSIONAL ENGINEER
E014222
Exp. 06-30-11
ELECTRICAL
STATE OF CALIFORNIA

SHEET NAME
PARTIAL SIGNAL SECOND FLOOR PLAN - ZONE 1

DRAWN BY: Author

PROJECT #: 200725.000

SHEET NUMBER

E4221

PARTIAL SIGNAL SECOND FLOOR PLAN – ZONE 1

SCALE 1/4" = 1'-0"

1

1/22/2009 4:52:10 PM
Kreth

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed architect, to alter an item in any way. If an item in this document is altered, the altering architect, if other than the architect of record, shall affixto the item his seal and the notation "altered by" follows by his signture and the date of such alteration, and the specific description of the alteration.