COPYRIGHT ©
FENTRESS ARCHITECTS

ISSUED FOR	DATE
BID PK #1	10/06/2008
50% Progress	10/24/2008
BID PK #1 80 CD	12/01/2008
BID PK #1 100 CD	02/16/2009
BID PK #2 100 CD	03/26/2009
100% CD	05/08/2009
CD 4	01/07/2010
COB 1 (2)	02/26/2010
COB 2 (3)	02/26/2010
CD 4	04/15/2010
RW PERMIT	05/05/2010
ASI#008 R1 (4)	07/01/2010
ASI#005 (5)	07/06/2010
ASI#015 (6)	07/09/2010
ASI#004 (7)	07/12/2010
ASI#003R2 (8)	07/19/2010
ASI#010 (9)	08/13/2010
ASI#011 (10)	08/27/2010
ASI#020 (11)	09/20/2010
ASI#018 (12)	11/17/2010
ASI#026 (13)	12/15/2010
ASI#026R2 (14)	01/14/2011
ASI#028 (15)	01/21/2011
ASI#028R1 (16)	01/28/2011
ASI#018R1 (17)	02/16/2011
RFI#1203 R1 (18)	02/16/2011

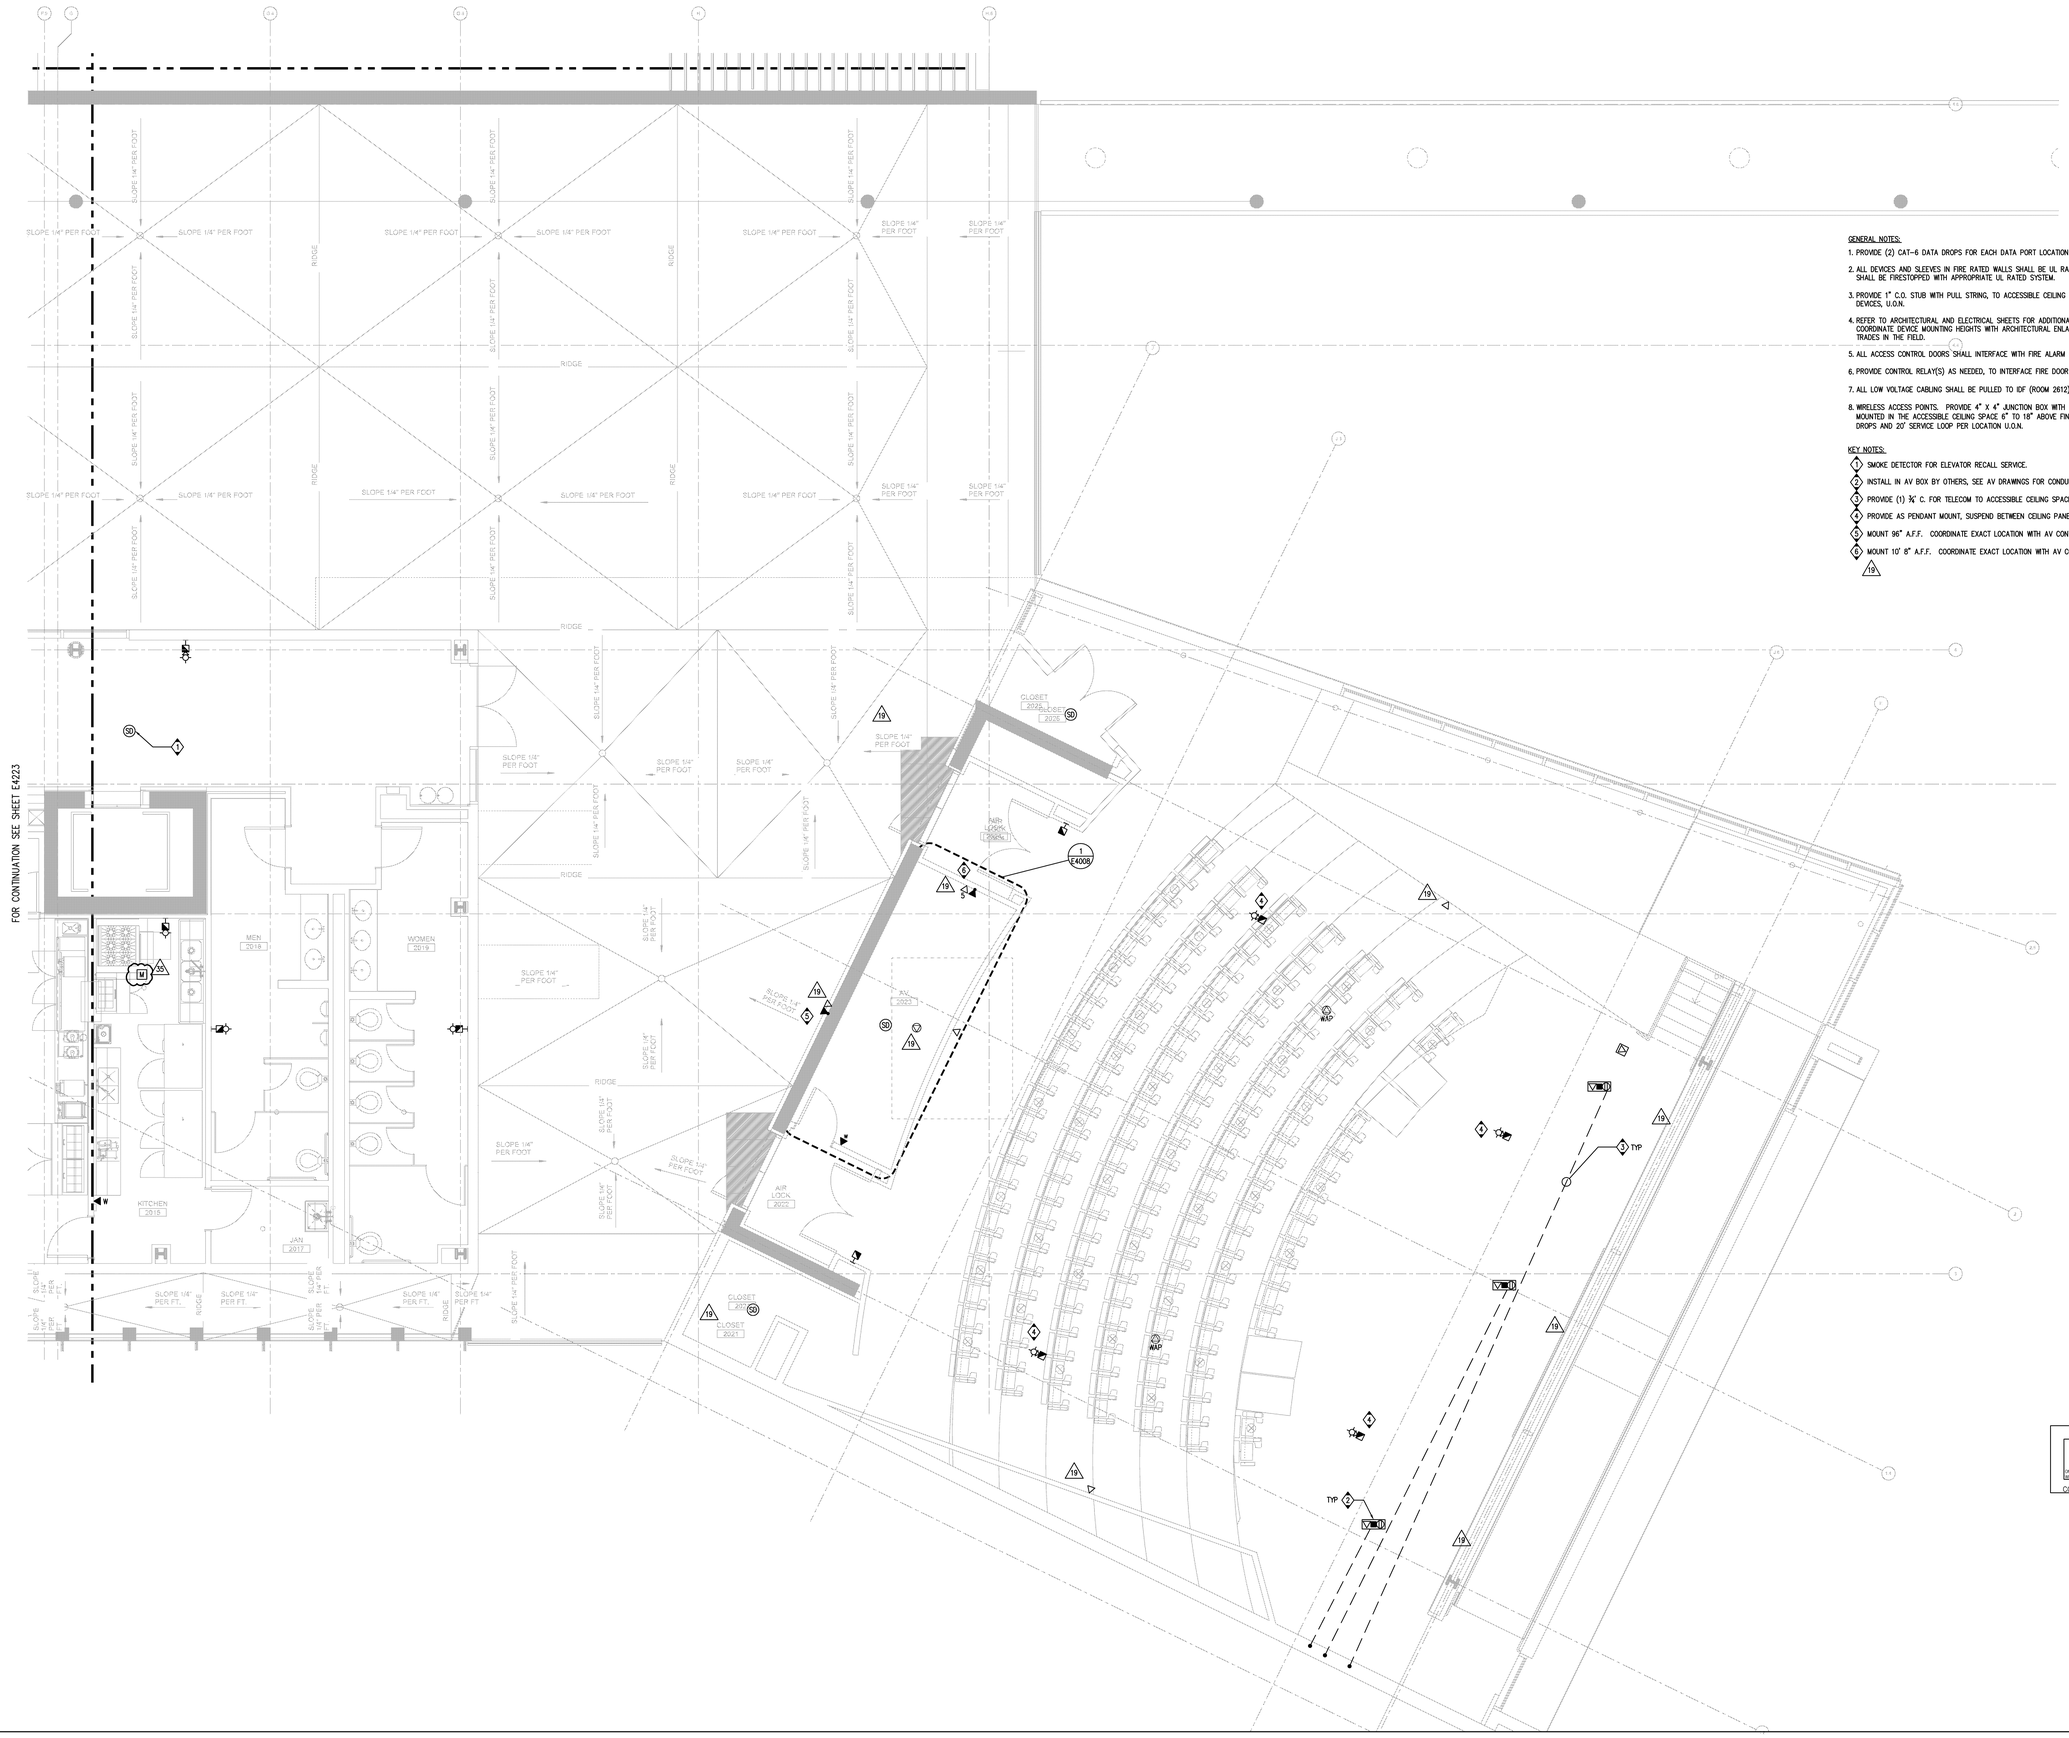

GENERAL NOTES:

1. PROVIDE (2) CAT-6 DATA DROPS FOR EACH DATA PORT LOCATION U.O.N.
2. ALL DEVICES AND SLEEVES IN FIRE RATED WALLS SHALL BE UL RATED FOR APPLICATION AND SHALL BE FIRESTOPPED WITH APPROPRIATE UL RATED SYSTEM.
3. PROVIDE 1" C.O. STUB WITH PULL STRING, TO ACCESSIBLE CEILING SPACE FOR ALL WALL MOUNTED DEVICES, U.O.N.
4. REFER TO ARCHITECTURAL AND ELECTRICAL SHEETS FOR ADDITIONAL MOUNTING INFORMATION, COORDINATE DEVICE MOUNTING HEIGHTS WITH ARCHITECTURAL ENLARGED PLANS AND OTHER TRADES IN THE FIELD.
5. ALL ACCESS CONTROL DOORS SHALL INTERFACE WITH FIRE ALARM CONTROL PANEL.
6. PROVIDE CONTROL RELAY(S) AS NEEDED, TO INTERFACE FIRE DOOR HOLDERS.
7. ALL LOW VOLTAGE CABLING SHALL BE PULLED TO IDF (ROOM 2612), U.O.N.
8. WIRELESS ACCESS POINTS. PROVIDE 4" X 4" JUNCTION BOX WITH SINGLE GANG TRIM RING, MOUNTED IN THE ACCESSIBLE CEILING SPACE 6" TO 18" ABOVE FINISHED CEILING, WITH (2) CAT-6 DROPS AND 20' SERVICE LOOP PER LOCATION U.O.N.

KEY NOTES:

1. SMOKE DETECTOR FOR ELEVATOR RECALL SERVICE.
2. INSTALL IN AV BOX BY OTHERS, SEE AV DRAWINGS FOR CONDUIT REQUIREMENTS.
3. PROVIDE (1) ¾" C. FOR TELECOM TO ACCESSIBLE CEILING SPACE. RFI#014R1
4. PROVIDE AS PENDANT MOUNT, SUSPEND BETWEEN CEILING PANELS AT CEILING HEIGHT.
5. MOUNT 96" A.F.F. COORDINATE EXACT LOCATION WITH AV CONTRACTOR.
6. MOUNT 10' 8" A.F.F. COORDINATE EXACT LOCATION WITH AV CONTRACTOR.
19.

APPROVED
FIRE AND PANIC ONLY
03 16 2011
ONLY VALID
WHEN STAMPED
STATE FIRE MARSHAL
CONSTRUCTION SERVICES

SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE

2880 TORREY PINES SCENIC DRIVE
LA JOLLA, CALIFORNIA 92037

CONSULTANT

xnth
Xnth Inc / San Diego - North
5970 Oberlin Dr
San Diego, CA 92121
858.597.1000 / 858.597.1505
Xnth# 200808A

Lankford/Phelps Consortium LLC
615 Westbourne Drive, Suite 1400 Los Angeles, CA 90069
310.652.0000

FENTRESS | ARCHITECTS
420 Broadway, Denver, CO 80203
303.712.0800

DAVIS DAVIS ARCHITECTS
2667 Fifth Avenue San Diego, CA 92103

STAMP

REGISTERED PROFESSIONAL ENGINEER
E. A. SOLIS
E014222
Exp. 06-30-11
ELECTRICAL
STATE OF CALIFORNIA

SHEET NAME:
PARTIAL SIGNAL SECOND FLOOR PLAN - ZONE 4

DRAWN BY: Author

PROJECT #: 200725.000

SHEET NUMBER

E4224

PARTIAL SIGNAL SECOND FLOOR PLAN – ZONE 4

SCALE 1/4" = 1'-0"

1

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed architect, to alter an item in any way. If an item in this document is altered, the altering architect, if other than the architect of record, shall affixto the item his seal and the notation "altered by" follows by his signiture and the date of such alteration, and the specific description of the alteration.