


1/22/2008 4:22:10 PM
P:\DWG\DWG\431587.dwg
File Path:

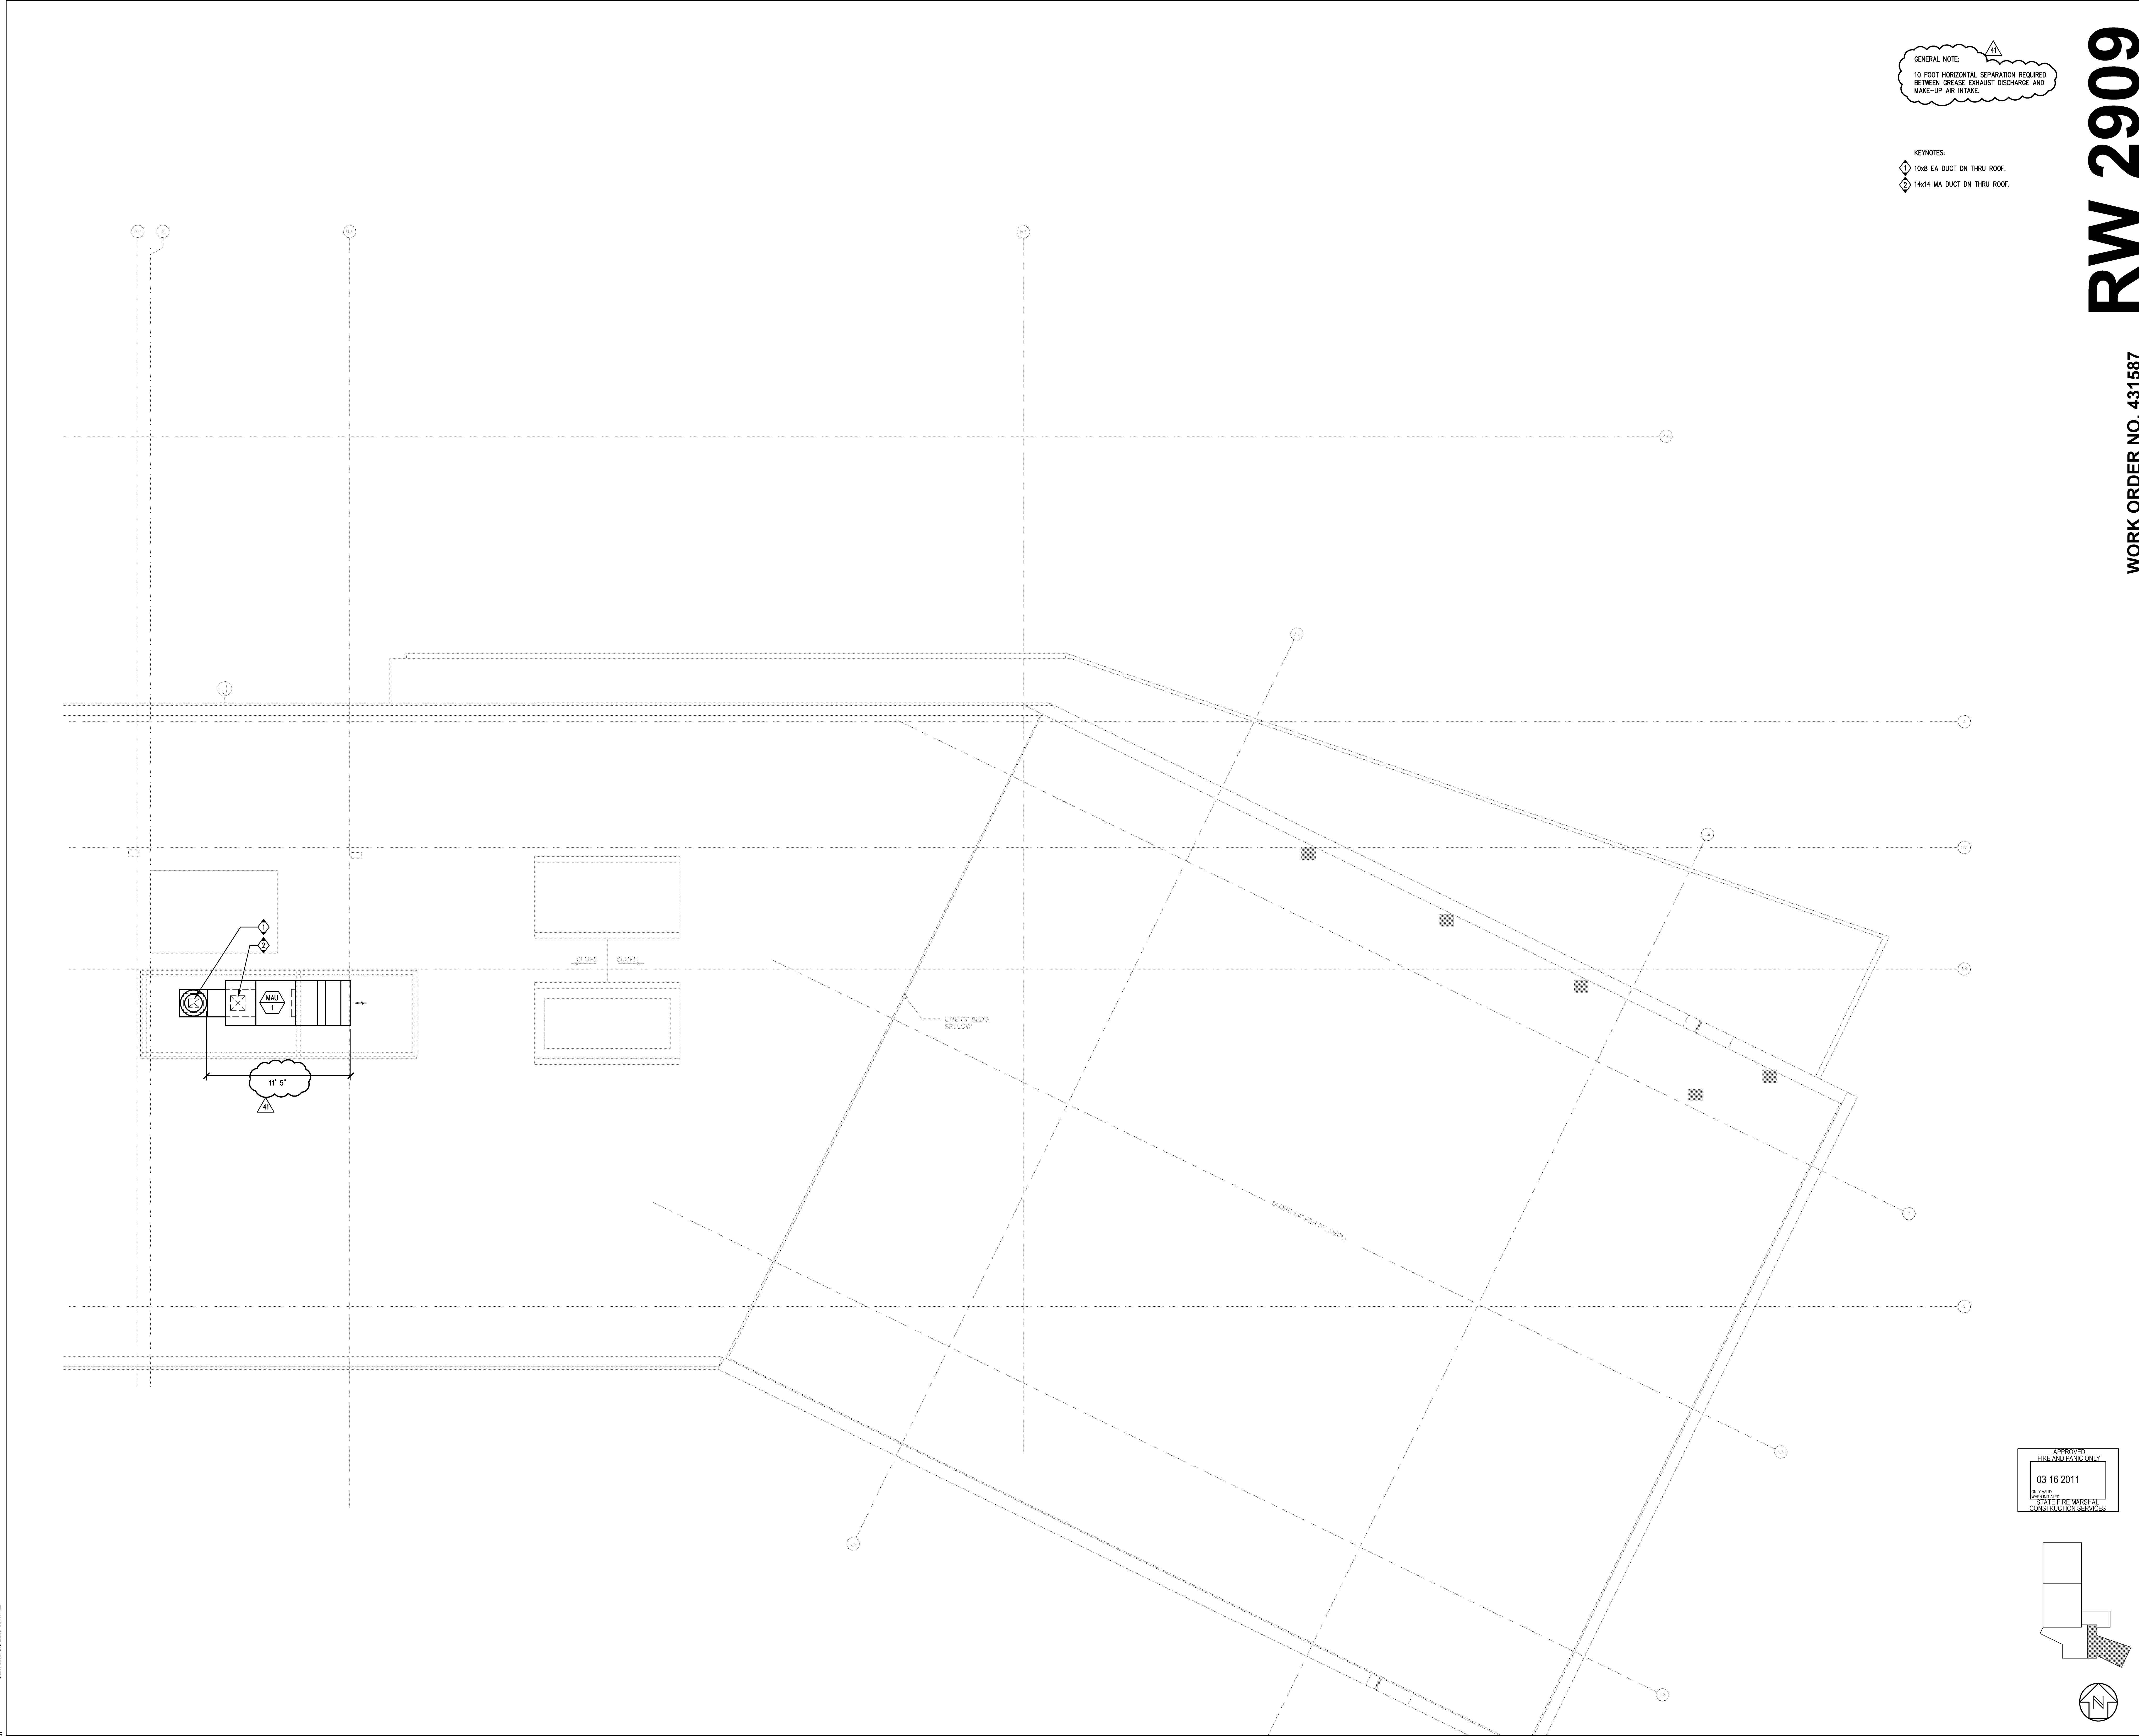

GENERAL NOTE:
10 FOOT HORIZONTAL SEPARATION REQUIRED
BETWEEN ORGASE EXHAUST DISCHARGE AND
MAKE-UP AIR INTAKE.


KEYNOTES:
1 10x8 EA DUCT ON THRU ROOF.
2 14x14 MA DUCT ON THRU ROOF.

COPYRIGHT © FENTRESS ARCHITECTS	
ISSUED FOR	DATE
BID PK #1	10/07/2008
50% Progress	10/24/2008
BID PK #1 80 CD	12/01/2008
BID PK #1 100 CD	02/16/2009
BID PK #2 100 CD	03/26/2009
100% CD	05/08/2009
CD 4	01/07/2010
COB 1	02/26/2010
COB 2	02/26/2010
CD 4	04/15/2010
RAW PERMIT	05/05/2010
ASI#008 R1	07/01/2010
ASI#005	07/08/2010
ASI#015	07/09/2010
ASI#004	07/12/2010
ASI#008R2	07/19/2010
ASI#010	08/13/2010
ASI#011	08/27/2010
ASI#020	09/20/2010
ASI#018	11/17/2010
ASI#026	12/15/2010
ASI#026R2	01/14/2011
ASI#028	01/21/2011
ASI#028R2	01/28/2011
ASI#018R1	02/16/2011
RFI#1203	02/16/2011
ASI-018R2	03/16/2011

WORK ORDER NO. 431587

SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE


2880 TORREY PINES SCENIC DRIVE
LA JOLLA, CALIFORNIA 92037



CONSULTANT
xrth
xRTH Inc. for design team
3071 Decatur Dr.
San Diego, CA 92108
619.597.0551 FAX 619.597.0555
Xrth-020804

Lanford/Phelps Consortium LLC
10000 La Jolla Village Drive, Suite 100
La Jolla, CA 92037
619.597.0551 FAX 619.597.0555

FENTRESS ARCHITECTS
418 Broadway, Denver, CO 80202
303.733.0400
FENTRESS ARCHITECTS
3001 Foothill Avenue, San Diego, CA 92108

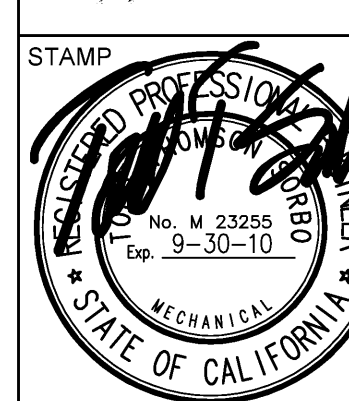

SHEET NAME
PARTIAL MECHANICAL THIRD
FLOOR PLAN - ZONE 4

DRAWN BY: Author
PROJECT # 200725.000

SHEET NUMBER
M2234

SCALE
1/4" = 1'-0"

1

PARTIAL MECHANICAL THIRD FLOOR PLAN - ZONE 4

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed architect, to alter an item in any way. If an item in this document is altered, the altering architect, if other than the architect of record, shall affix the item his seal and the notation "altered by" follows by his signature and the date of such alteration, and the specific description of the alteration.