


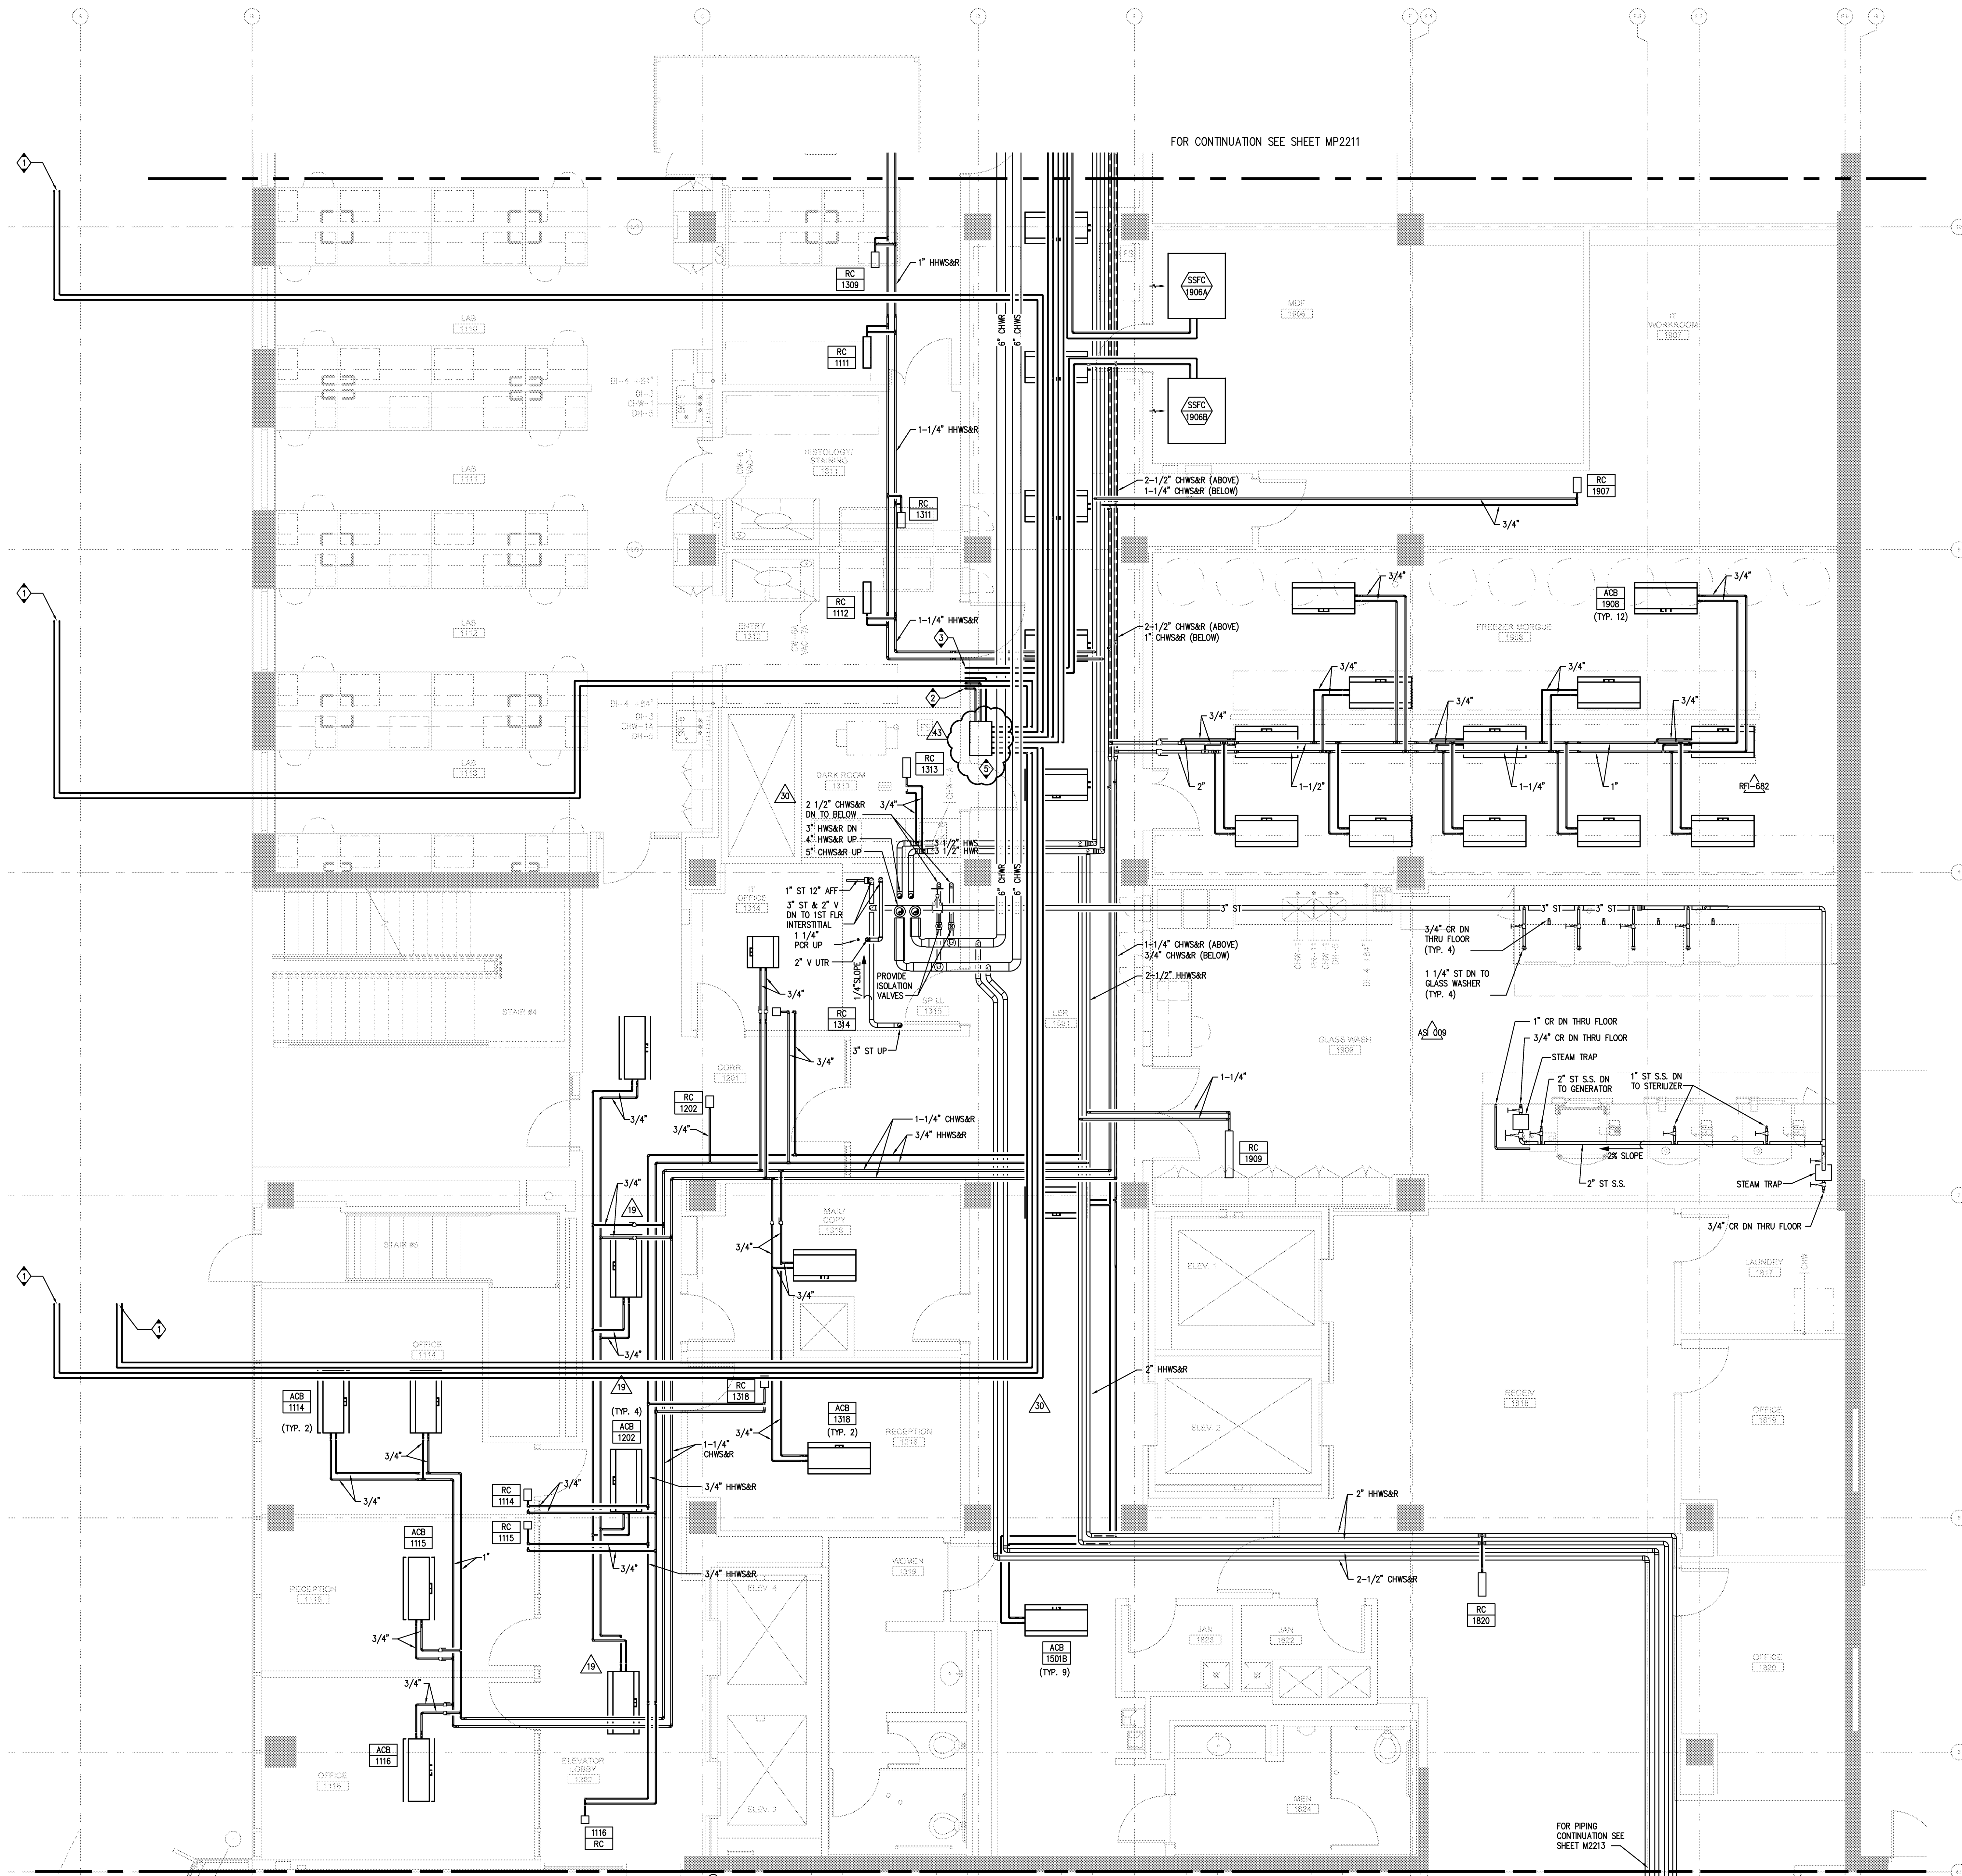


- REVISIONS:
- 1 1/2" RG & 1/4" RL UP TO 2ND FLOOR.
 - 2 3/4" & 5/8" RG OR RL PIPE UP TO 3RD FLOOR. ABANDON 3/8" LINE.
 - 3 3/4" RG & 3/8" RL UP TO 2ND FLOOR.
 - 4 12" DOWN TO 6" FUME HOOD. BALANCE TO 785 CFM.
 - 5 REPLACE SUB BC PANEL WITH BC PANEL AND RECONNECT REFRIG. LINES.

ISSUED FOR DATE	
BID PK #1	10/06/2008
50% Progress	10/24/2008
BID PK #1 RO CD	12/01/2008
BID PK #1 100 CD	02/16/2009
BID PK #2 100 CD	03/26/2009
100% CD	05/08/2009
CD 4	01/07/2010
CD 8	02/26/2010
CD 2	02/26/2010
CD 4	04/15/2010
RW PERMIT	05/06/2010
ASIM08 R1	07/01/2010
ASIM005	07/06/2010
ASIM015	07/09/2010
ASIM004	07/12/2010
ASIM002R2	07/19/2010
ASIM010	08/13/2010
ASIM011	08/27/2010
ASIM020	08/20/2010
ASIM018	11/17/2010
ASIM028	12/15/2010
ASIM028R2	01/14/2011
ASIM028	01/21/2011
ASIM028R2	01/28/2011
ASIM018R1	02/16/2011
RFI#1203	02/16/2011
ASIM031	04/01/2011

SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE

2880 TORREY PINES SCENIC DRIVE
LA JOLLA, CALIFORNIA 92037

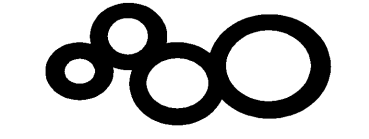

CONSULTANT

Architectural
Kendrick Associates, Inc.
3070 La Jolla Village Drive, Suite 200
La Jolla, CA 92037
Tel: 858.592.1555
Fax: 858.592.1556
www.kendrickassoc.com

CONSULTANT


Lankford/Phelps Consortium LLC
1000 Camino del Rio South, Suite 200
San Diego, CA 92108
Tel: 619.594.1100
Fax: 619.594.1101
www.lankfordphelps.com

FENTRESS ARCHITECTS

425 Broadway, Suite 200, San Diego, CA 92101
Tel: 619.594.1100
Fax: 619.594.1101
www.fentressarchitects.com

DAVIS ARCHITECTS

1000 Camino del Rio South, Suite 200
San Diego, CA 92108
Tel: 619.594.1100
Fax: 619.594.1101
www.davisarchitects.com

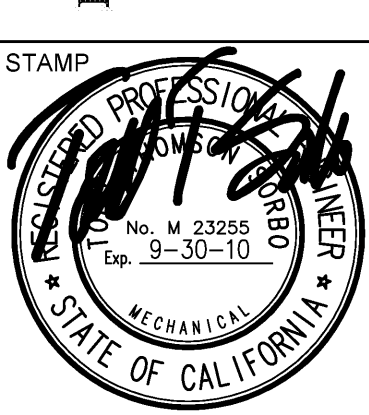

SHEET NAME
PARTIAL MECHANICAL PIPING
FIRST FLOOR PLAN - ZONE 2

DRAWN BY: Author

PROJECT # 200725.000

SHEET NUMBER

MP2212

SCALE
1/4" = 1'-0"

1

PARTIAL MECHANICAL PIPING FIRST FLOOR PLAN - ZONE 2

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed architect, to alter an item in any way. If an item in this document is altered, the altering architect, if other than the architect of record, shall affix the item his seal and the notation "altered by" followed by his signature and the date of such alteration, and the specific description of the alteration.