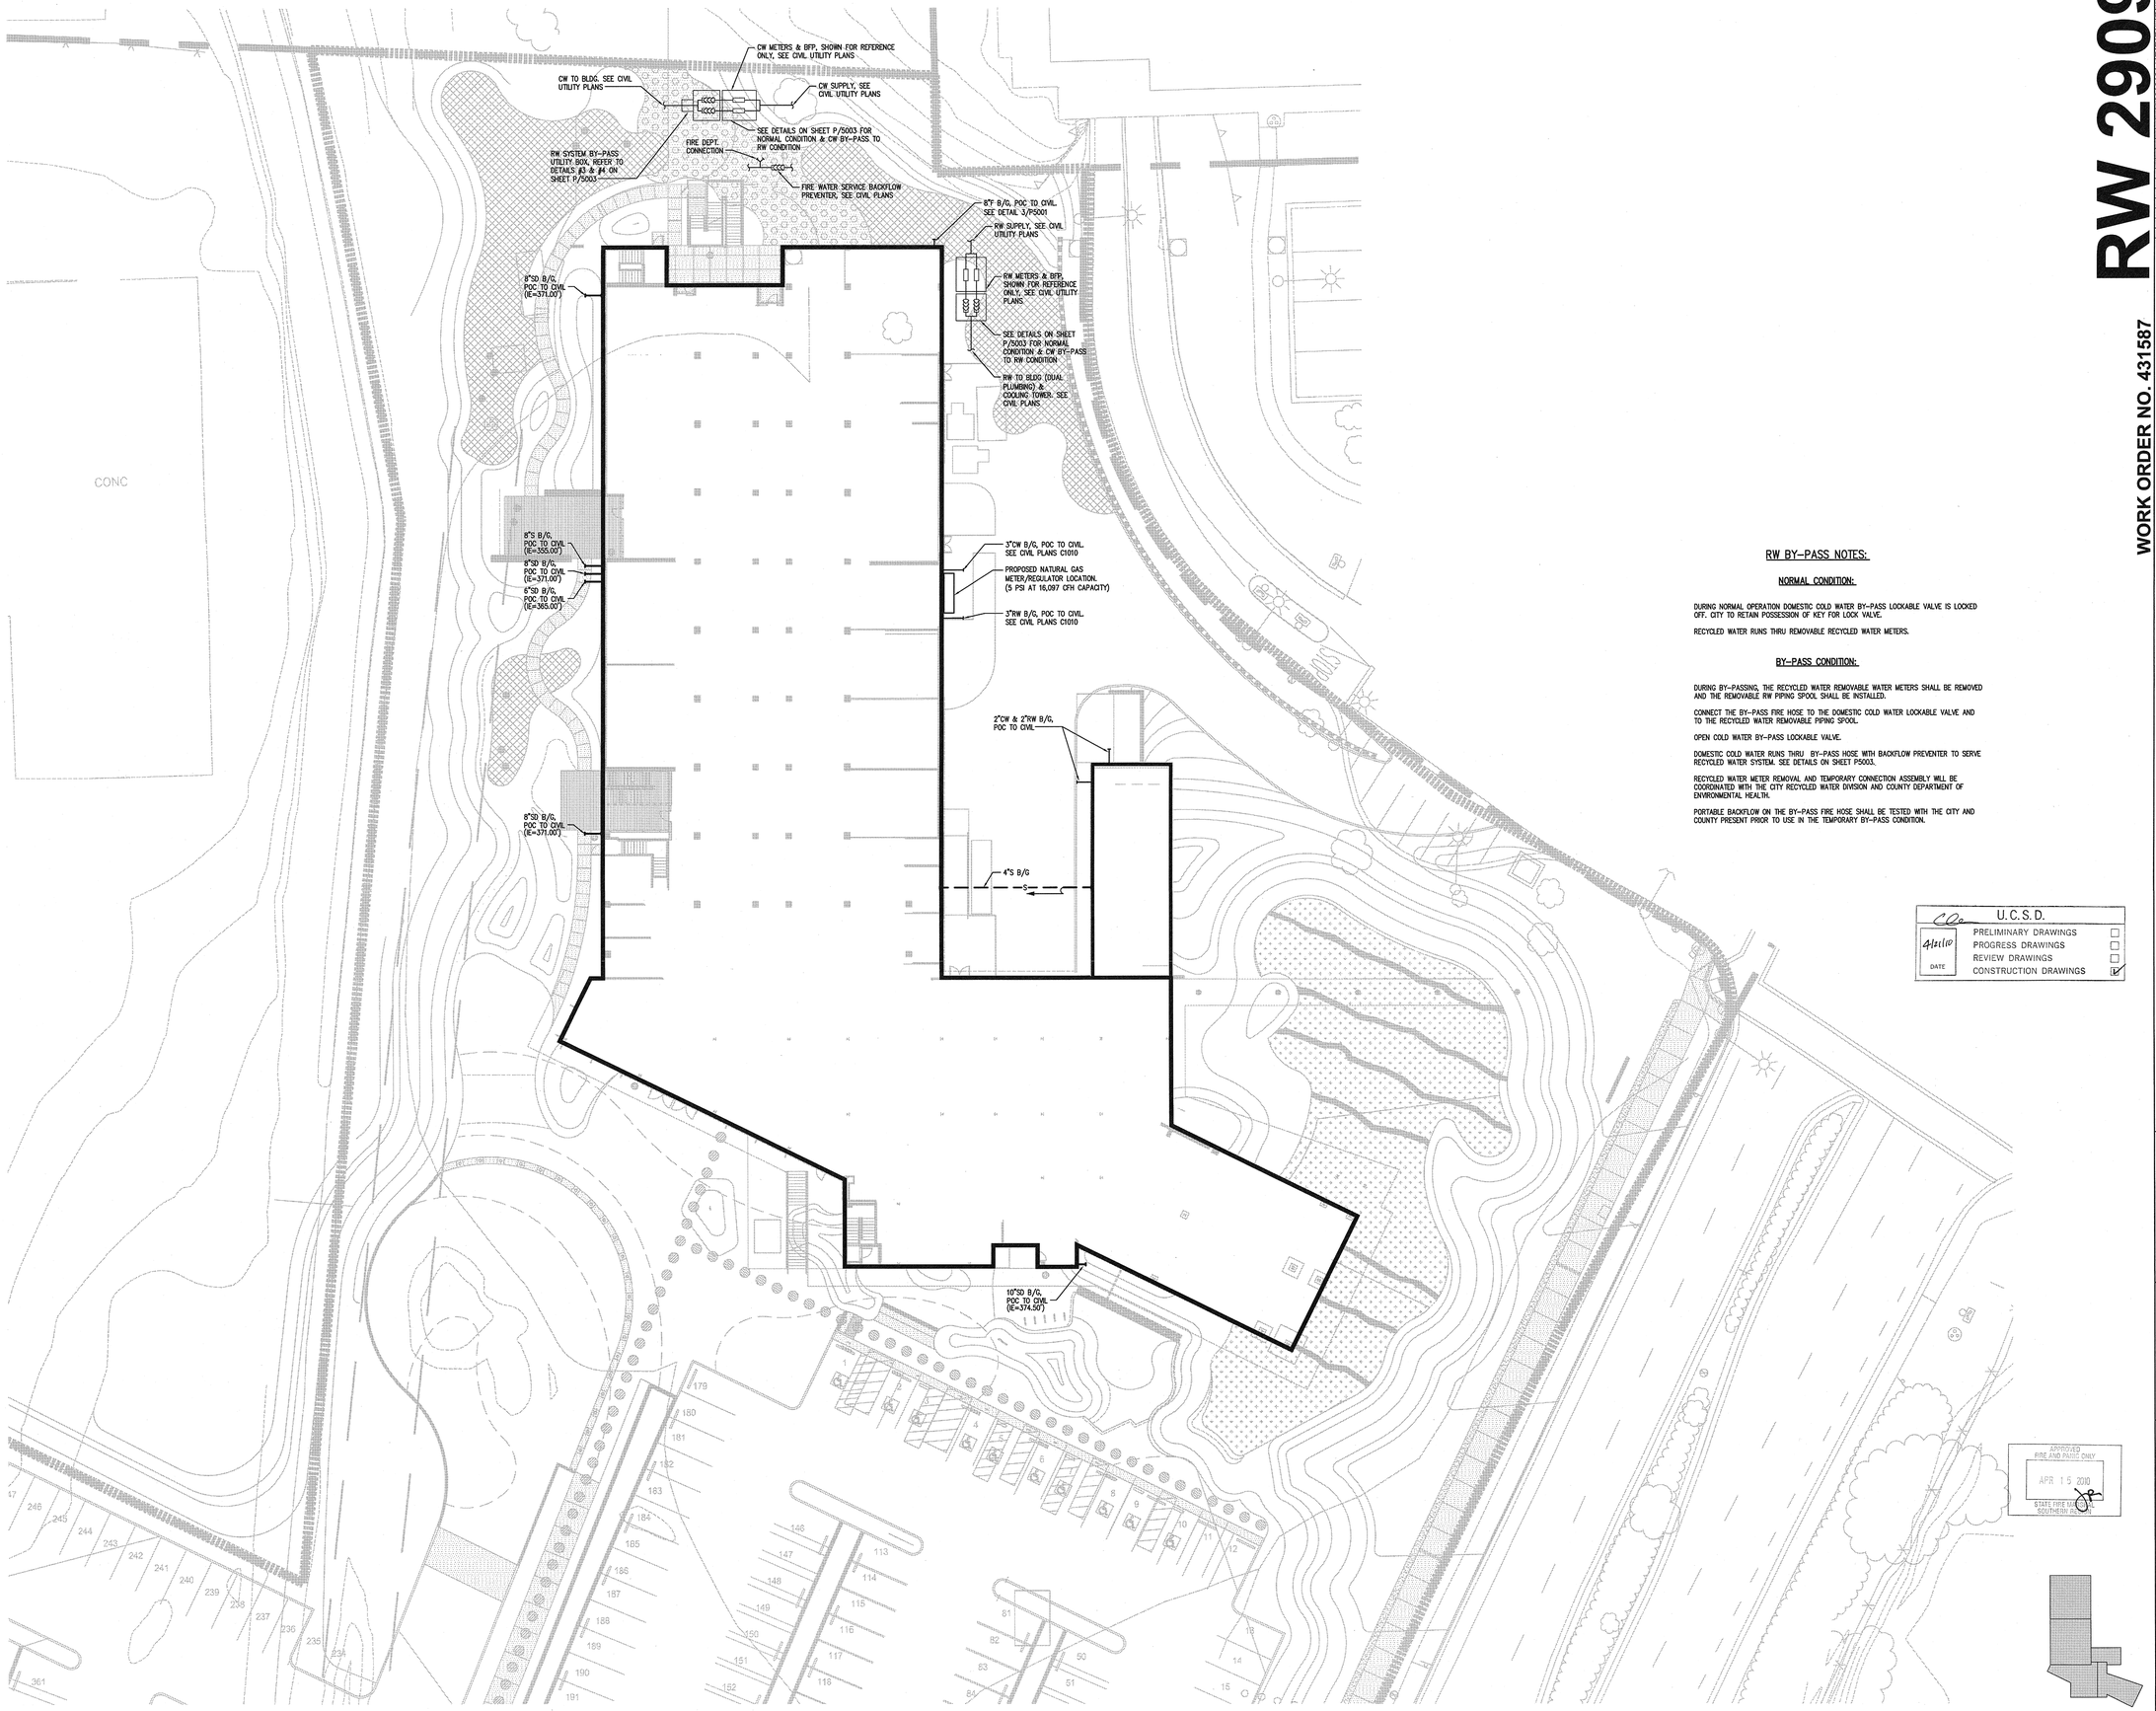

RW BY-PASS NOTES:

NORMAL CONDITION:

DURING NORMAL OPERATION DOMESTIC COLD WATER BY-PASS LOCKABLE VALVE IS LOCKED OFF. CITY TO RETAIN POSSESSION OF KEY FOR LOCK VALVE.

RECYCLED WATER RUNS THRU REMOVABLE RECYCLED WATER METERS.

BY-PASS CONDITION:

DURING BY-PASSING, THE RECYCLED WATER REMOVABLE WATER METERS SHALL BE REMOVED AND THE REMOVABLE RW PIPING SPOOL SHALL BE INSTALLED.

CONNECT THE BY-PASS FIRE HOSE TO THE DOMESTIC COLD WATER LOCKABLE VALVE AND TO THE RECYCLED WATER REMOVABLE PIPING SPOOL.

OPEN COLD WATER BY-PASS LOCKABLE VALVE.

DOMESTIC COLD WATER RUNS THRU BY-PASS HOSE WITH BACKFLOW PREVENTER TO SERVE RECYCLED WATER SYSTEM. SEE DETAILS ON SHEET P5003.

RECYCLED WATER METER REMOVAL AND TEMPORARY CONNECTION ASSEMBLY WILL BE COORDINATED WITH THE CITY RECYCLED WATER DIVISION AND COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH.

PORTABLE BACKFLOW ON THE BY-PASS FIRE HOSE SHALL BE TESTED WITH THE CITY AND COUNTY PRESENT PRIOR TO USE IN THE TEMPORARY BY-PASS CONDITION.

PLUMBING SITE PLAN

SCALE 1"=20'-0" 1

COPYRIGHT © FENTRESS ARCHITECTS

ISSUED FOR	DATE
Pre-Schematic Design	07/14/2008
Schematic Design	07/28/2008
BID PK #1	10/06/2008
50% Progress	10/24/2008
BID PK #1 80 CD	12/01/2008
BID PK #1 100 CD	02/16/2009
BID PK #2 100 CD	03/26/2009
100% CD	05/08/2009
CO 3	01/07/2010
COS 1 1	02/26/2010
COS 2 1	02/26/2010
CD 4	04/15/2010

RW 2909

WORK ORDER NO. 431587

SANFORD CONSORTIUM FOR REGENERATIVE MEDICINE

2880 TORREY PINES SCENIC DRIVE
LA JOLLA, CALIFORNIA 92037

CONSULTANT
Kpath
V. ath Ave | San Diego - Meath
5270 Oberlin Dr.
San Diego, CA 92121
858.597.7655 | 858.597.7655
www.kpath.com

Lankford/Phelps Consortium LLC
655 West Broadway, Suite 1400 San Diego, CA 92101
619.702.5000 | 619.702.5001

FENTRESS | ARCHITECTS
431 Broadway, Denver, CO 80203
303|722|8000

DAVIS LANGDON ADAM
Architects
2401 Fifth Avenue Suite 700 San Diego, CA 92101

STAMP
REGISTERED PROFESSIONAL ENGINEER
MEW 42026
Exp. 06/30/2011
MECHANICAL
STATE OF CALIFORNIA

SHEET NAME
PLUMBING SITE PLAN

DRAWN BY: Author
PROJECT #: 200725.000
SHEET NUMBER
P1000

1/22/2008 4:52:10 PM
File Path

Warning: It is a violation of the law for any person, unless acting under the direction of a licensed architect, to alter an item in any way. If an item in this document is altered, the altering architect, if other than the architect of record, shall affixto the item his seal and the notation "altered by" follows by his signiture and the date of such alteration, and the specific description of the alteration.