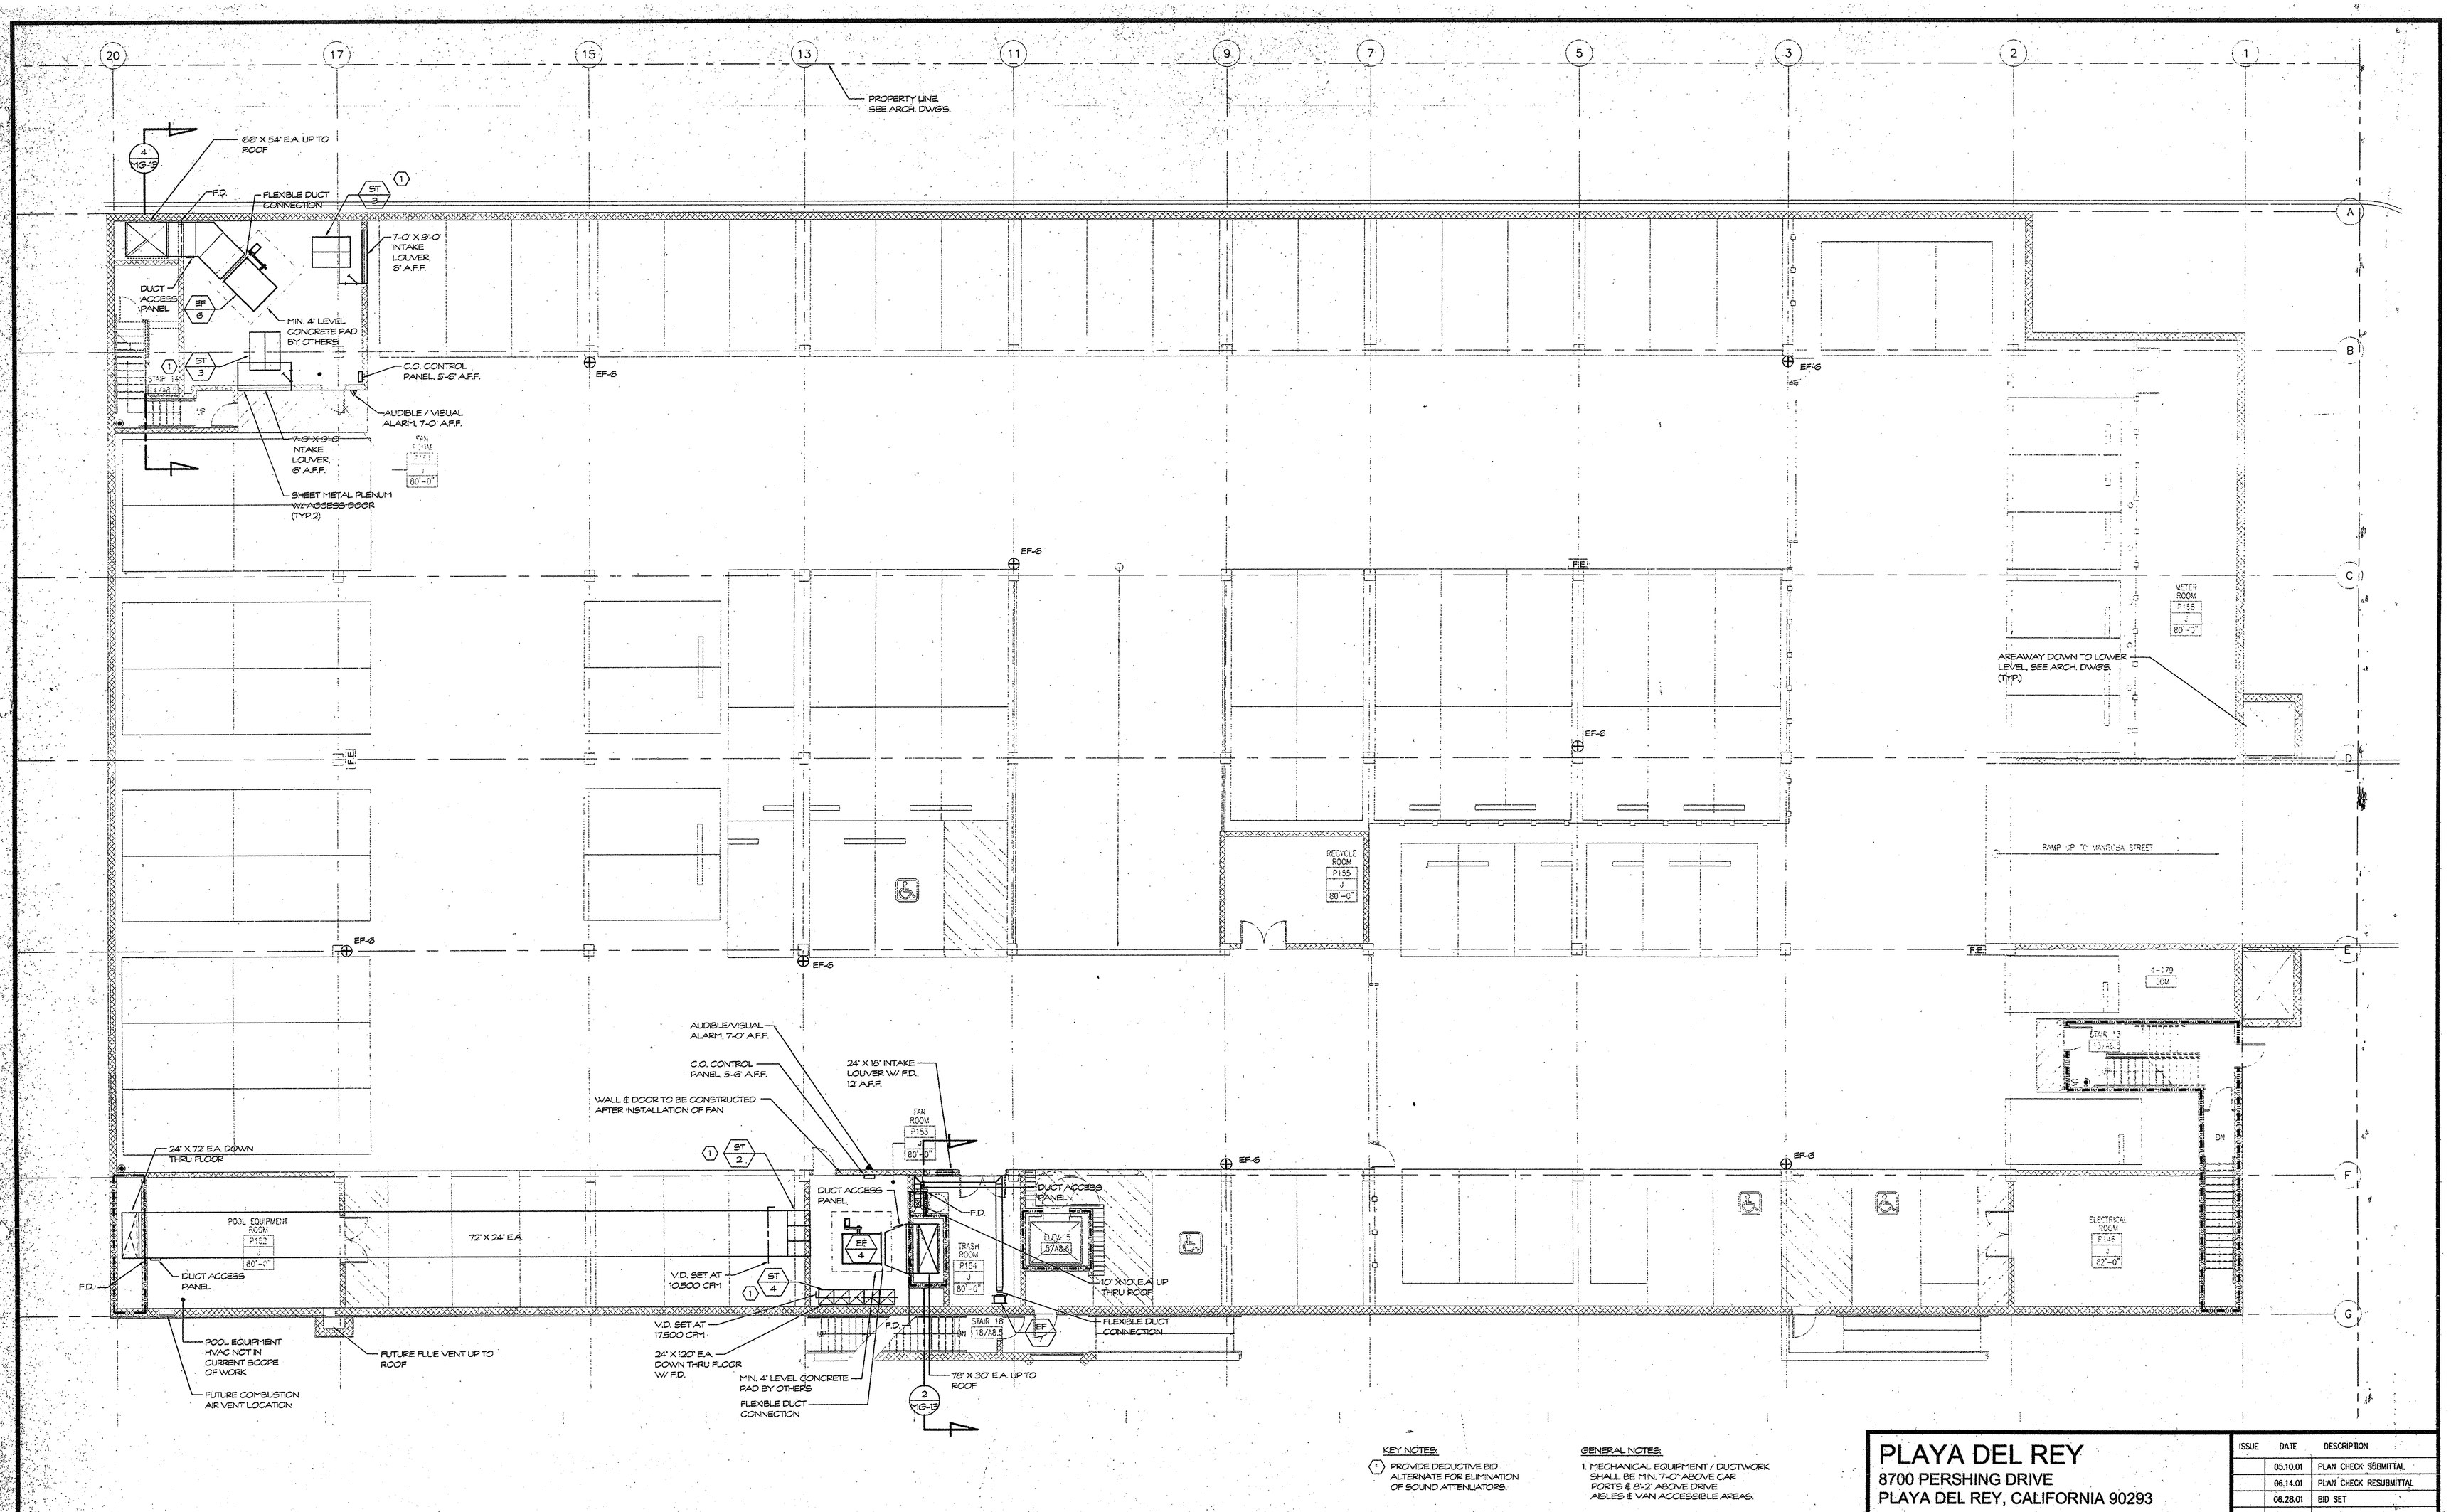

KEY NOTES:

(1) PROVIDE DEDUCTIVE BID ALTERNATE FOR ELIMINATION OF SOUND ATTENUATORS.

GENERAL NOTES:

1. MECHANICAL EQUIPMENT / DUCTWORK SHALL BE MIN. 7'-0" ABOVE CAR PORTS & 8'-2" ABOVE DRIVE AISLES & VAN ACCESSIBLE AREAS.

H.V.A.C. NOTES:

⊕ CARBON MONOXIDE SENSORS SHALL BE MOUNTED IN STANDARD 4 X 4 BOX AT 5'-0" ABOVE FINISH FLOOR. ALL SENSOR WIRING SHALL HOME RUN BACK TO C.O. CONTROL PANEL. ALL CONDUIT AND BOXES TO BE PROVIDED BY THE ELECTRICAL CONTRACTOR.

GARAGE EXHAUST CALCULATION:
104 SPACES X 14,000 X 0.025 = 36,400 CFM

PLAN NORTH

PLAYA DEL REY

8700 PERSHING DRIVE
PLAYA DEL REY, CALIFORNIA 90293

ARCHSTONE COMMUNITIES
217 Technology Drive, Second Floor
Irvine, California 92618

ISSUE	DATE	DESCRIPTION
	05.10.01	PLAN CHECK SUBMITTAL
	06.14.01	PLAN CHECK RESUBMITTAL
	06.28.01	BID SET
A	10.05.01	GMAX SET
1		

AMPAM
LDI Mechanical
1740 DELILAH STREET CORONA, CA 92879
(909) 340-9685 (909) 340-9688 FAX
CA.LIC. # 784740

REGISTERED PROFESSIONAL ENGINEER
LUIS A. GARCIA
Exp date
Jun 30 2002
No. M30574
MECHANICAL
STATE OF CALIFORNIA

PROJECT:	9985	SCALE:	1/8" = 1'-0"
DRAWN:	T.L.A.	CHECKED:	L.G.

BUILDING 5
UPPER GARAGE LEVEL

MG-11

DELTA 1 SFT