
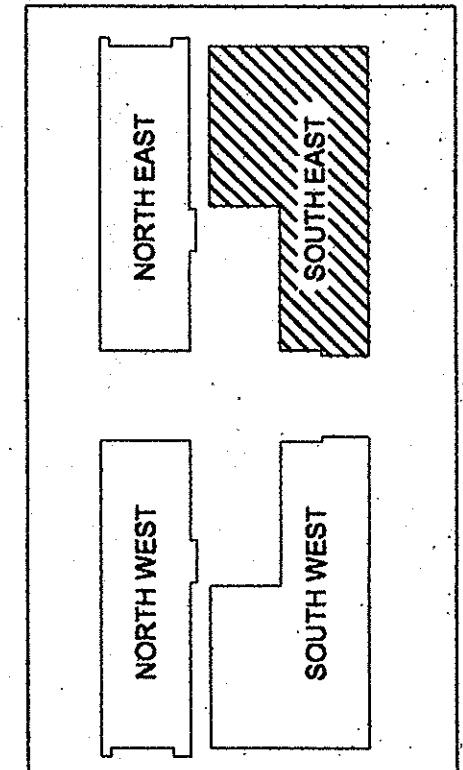


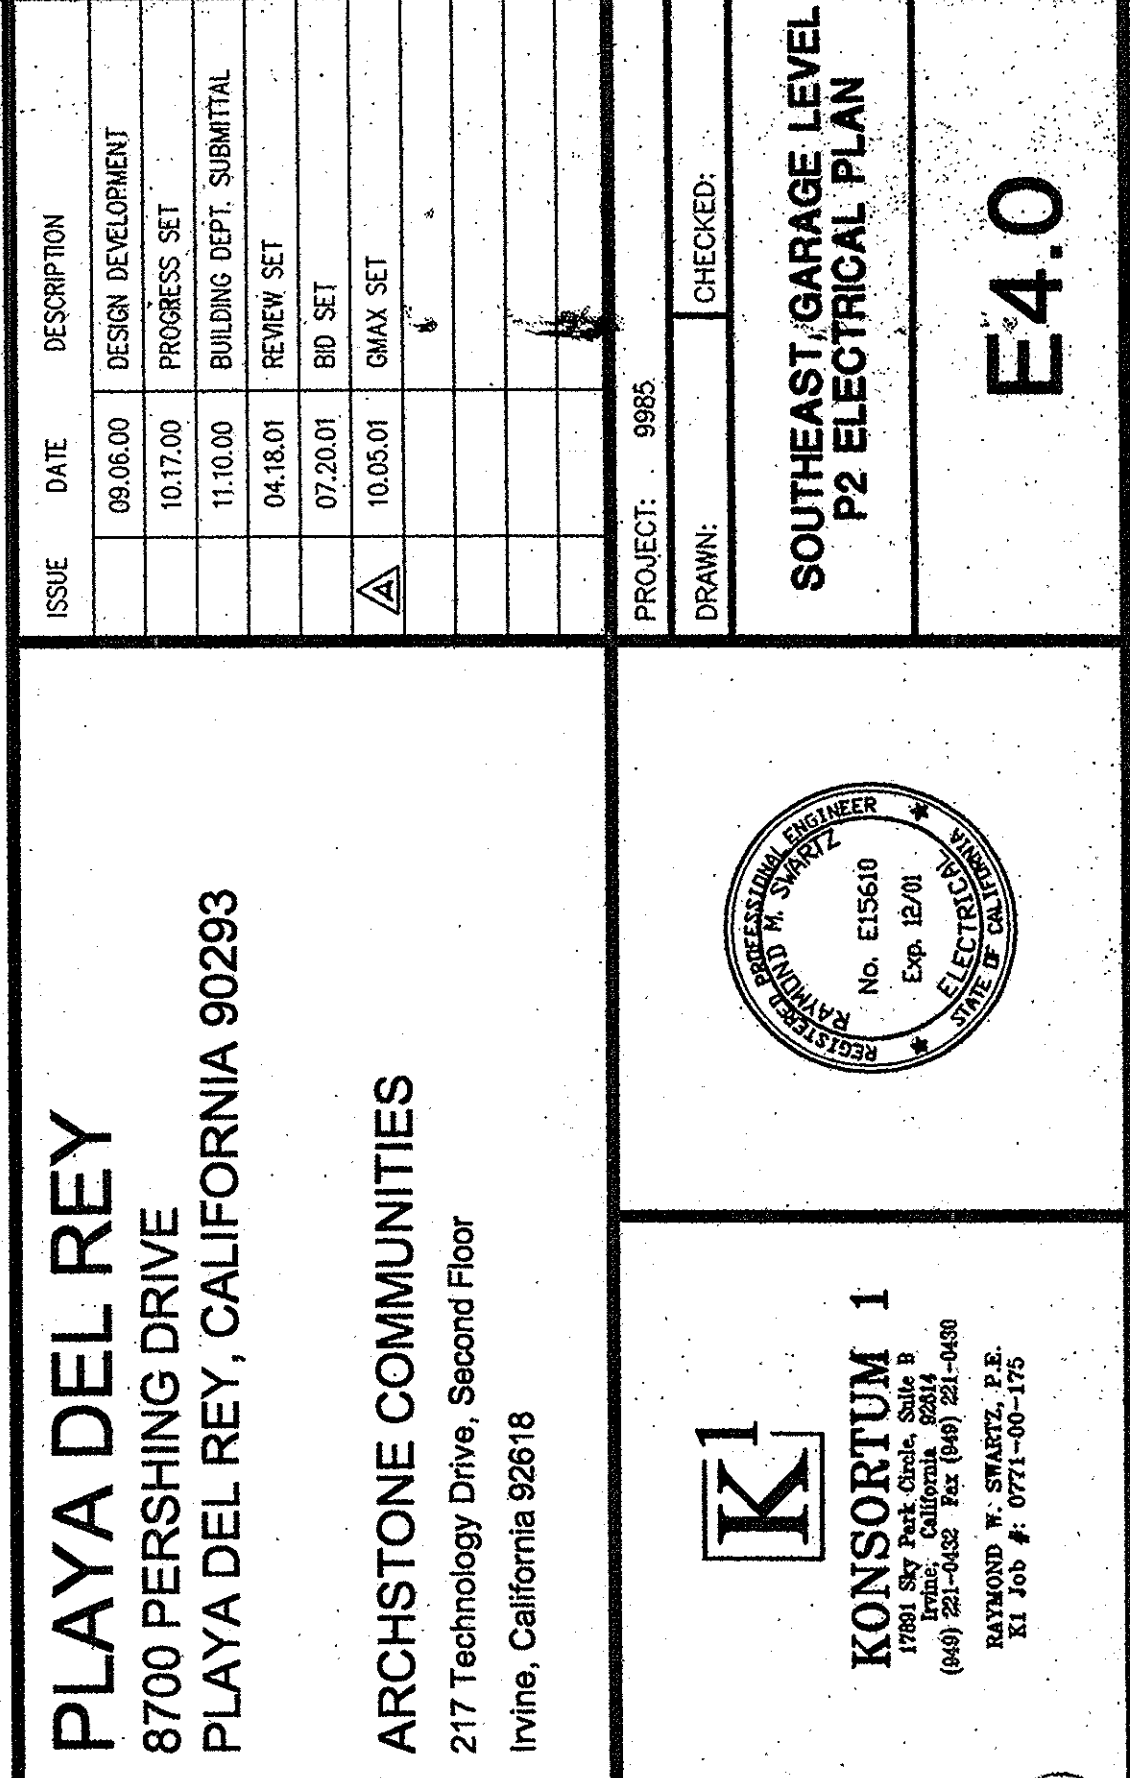

SCALE: $\frac{1}{8}" = 1' - 0"$

- 1 SHUT PUMP CONTROL PANEL. BY PLUMBING CONTRACTOR REFER TO PLUMBING PLAN DETAIL SHEET FOR CONNECTION TO SHUT PUMP.
- 2 TO MONOXIDE CONTROL PANEL 3/4" CONDUIT ONLY.
- 3 CARBON MONOXIDE SENSORS SHALL BE MOUNTED IN STANDARD 4 x 4 BOX AT 5'-0" AHT.
- 4 ELEVATOR SHUT PUMP ALARM POWER. VERIFY LOCATION WITH PLUMBING CONTRACTOR PRIOR TO ROUGH-IN.

PLAN NOTES