



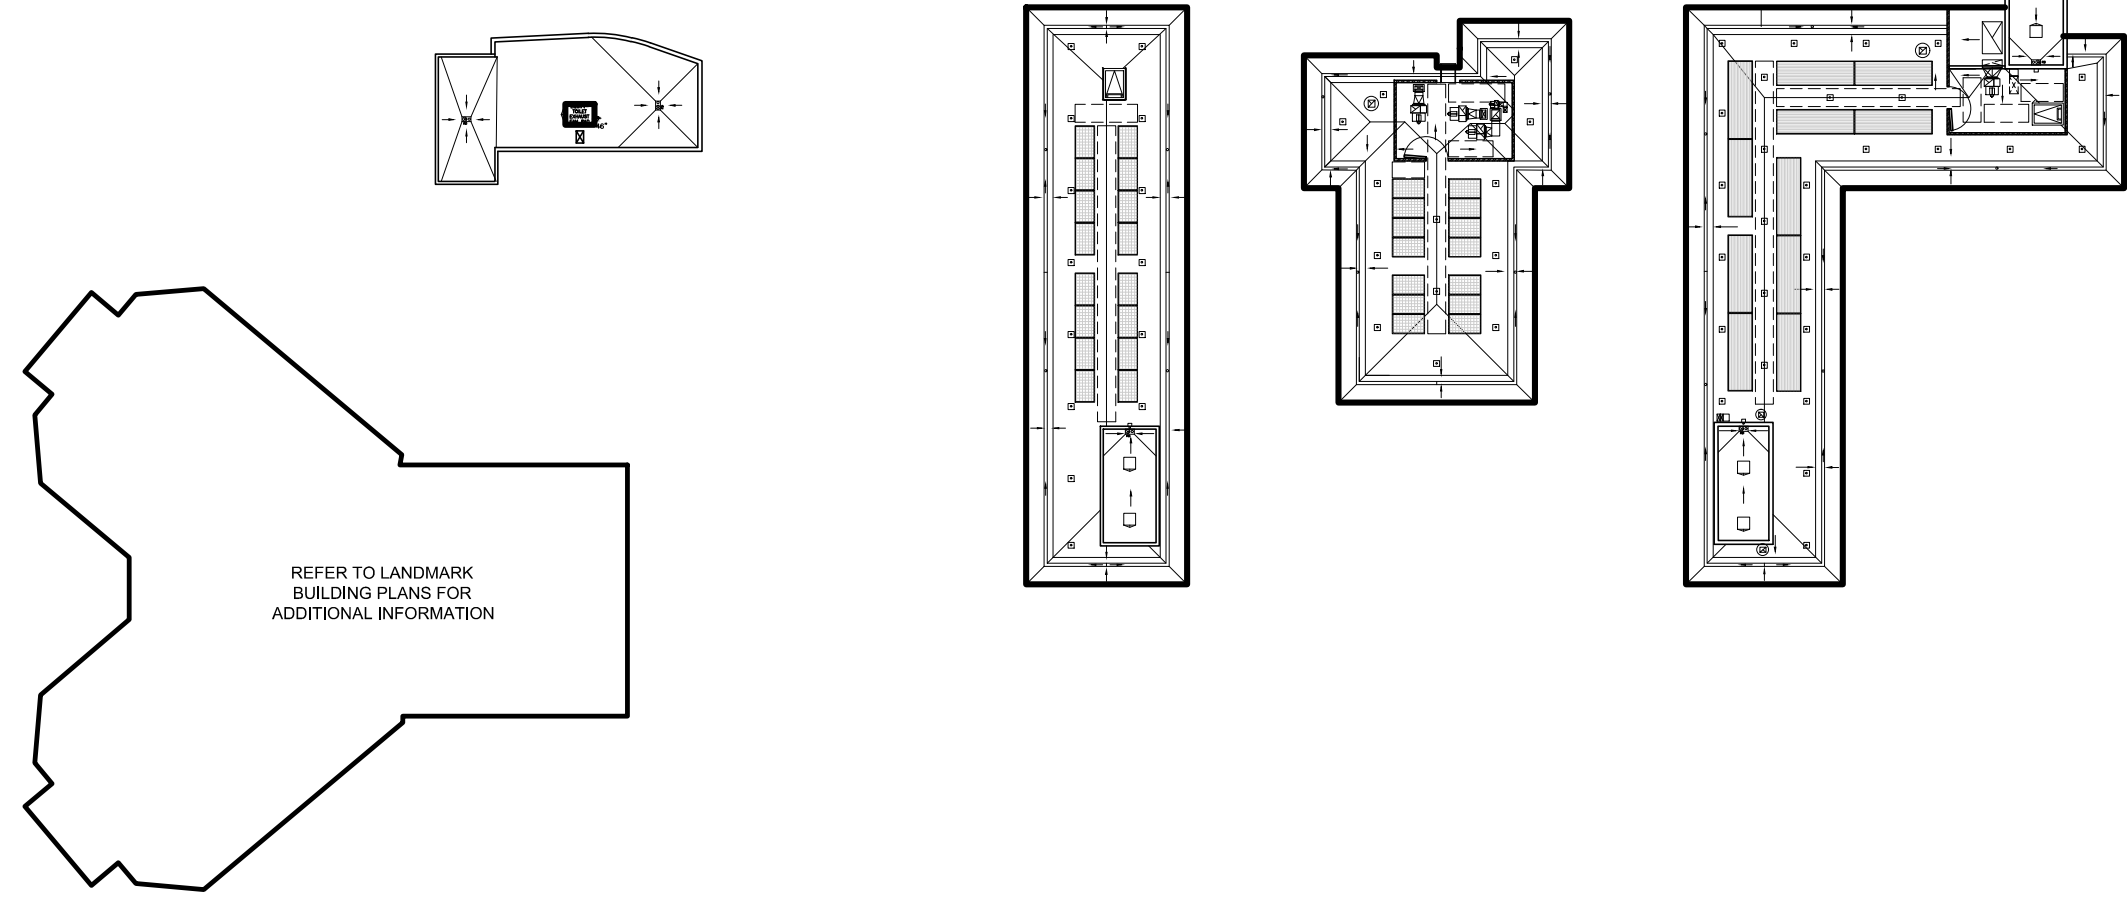


ROOF PLAN

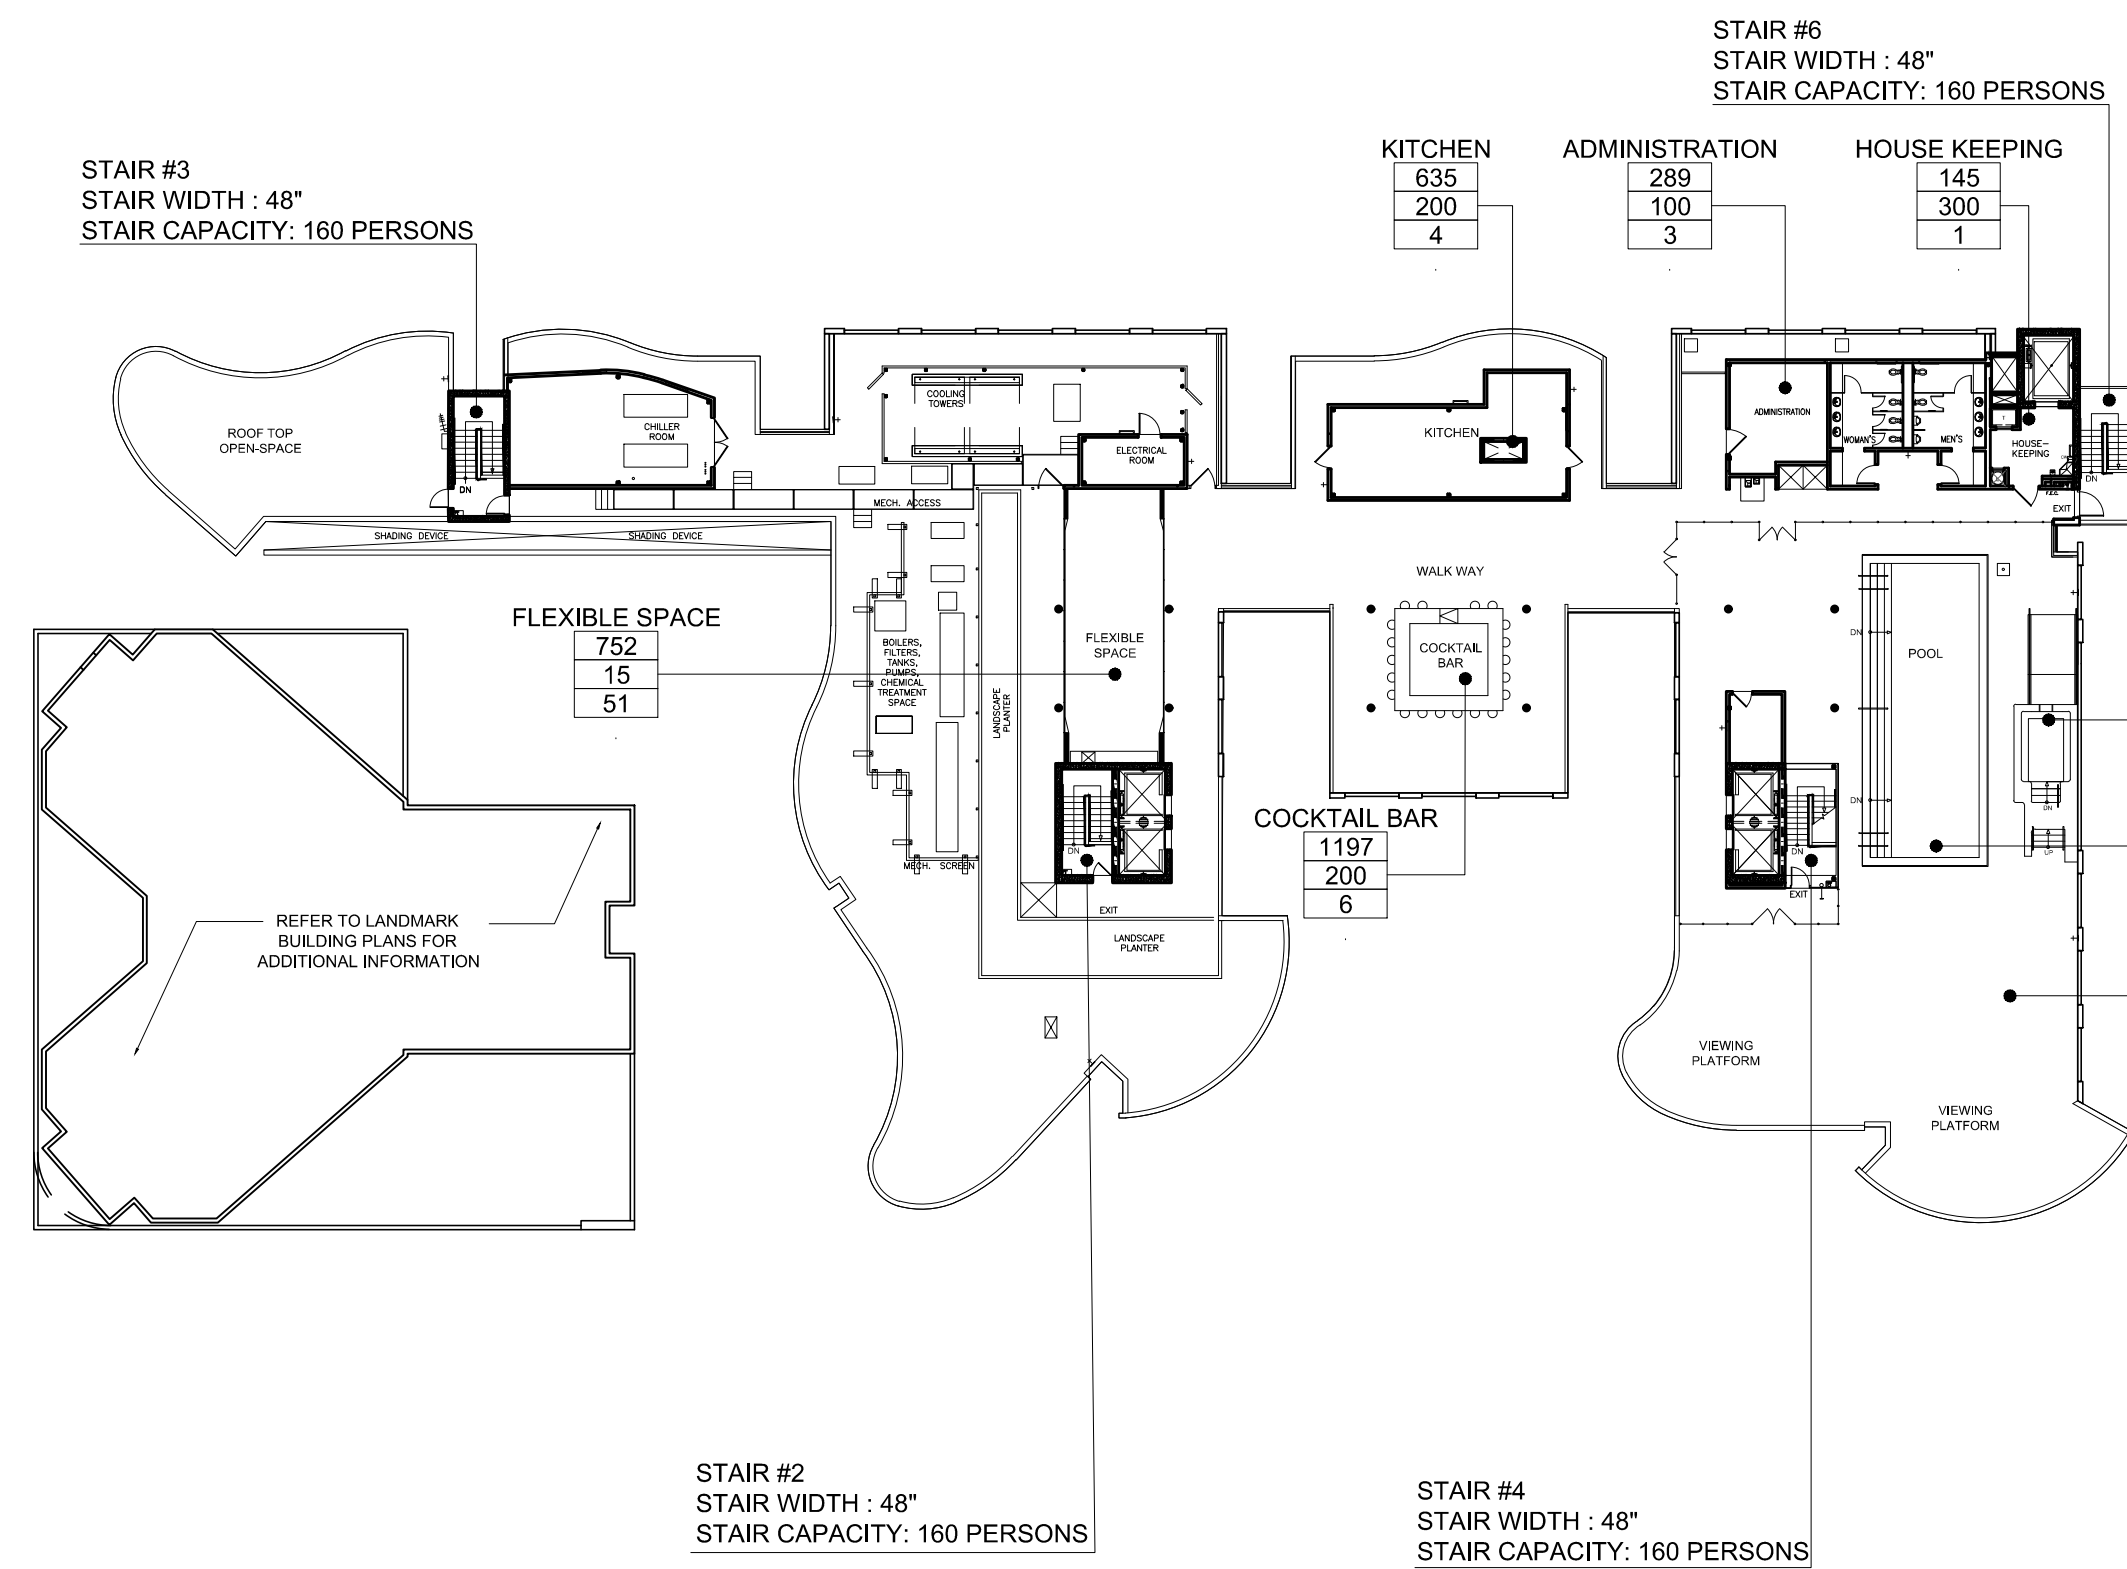


MAX TRAVEL DISTANCE TO AN EXIT: 143'-0"
MAX PERMITTED TRAVEL DISTANCE: 400'
FULLY SPRINKLED STRUCTURE

SEVENTH FLOOR PLAN
OCCUPANCY: R1 - GROSS AREA: 19,686 S.F.
TOTAL OCCUPANTS: 99 : 4 STAIRS = 25
REQUIRED AVERAGE STAIR WIDTH: 76 X .3= 22.8"
PROVIDED STAIR WIDTH: 48"
REQUIRED EXIT DOOR WIDTH: 76 X .2= 15.2"
PROVIDED NOMINAL EXIT DOOR WIDTH: 36" DOOR

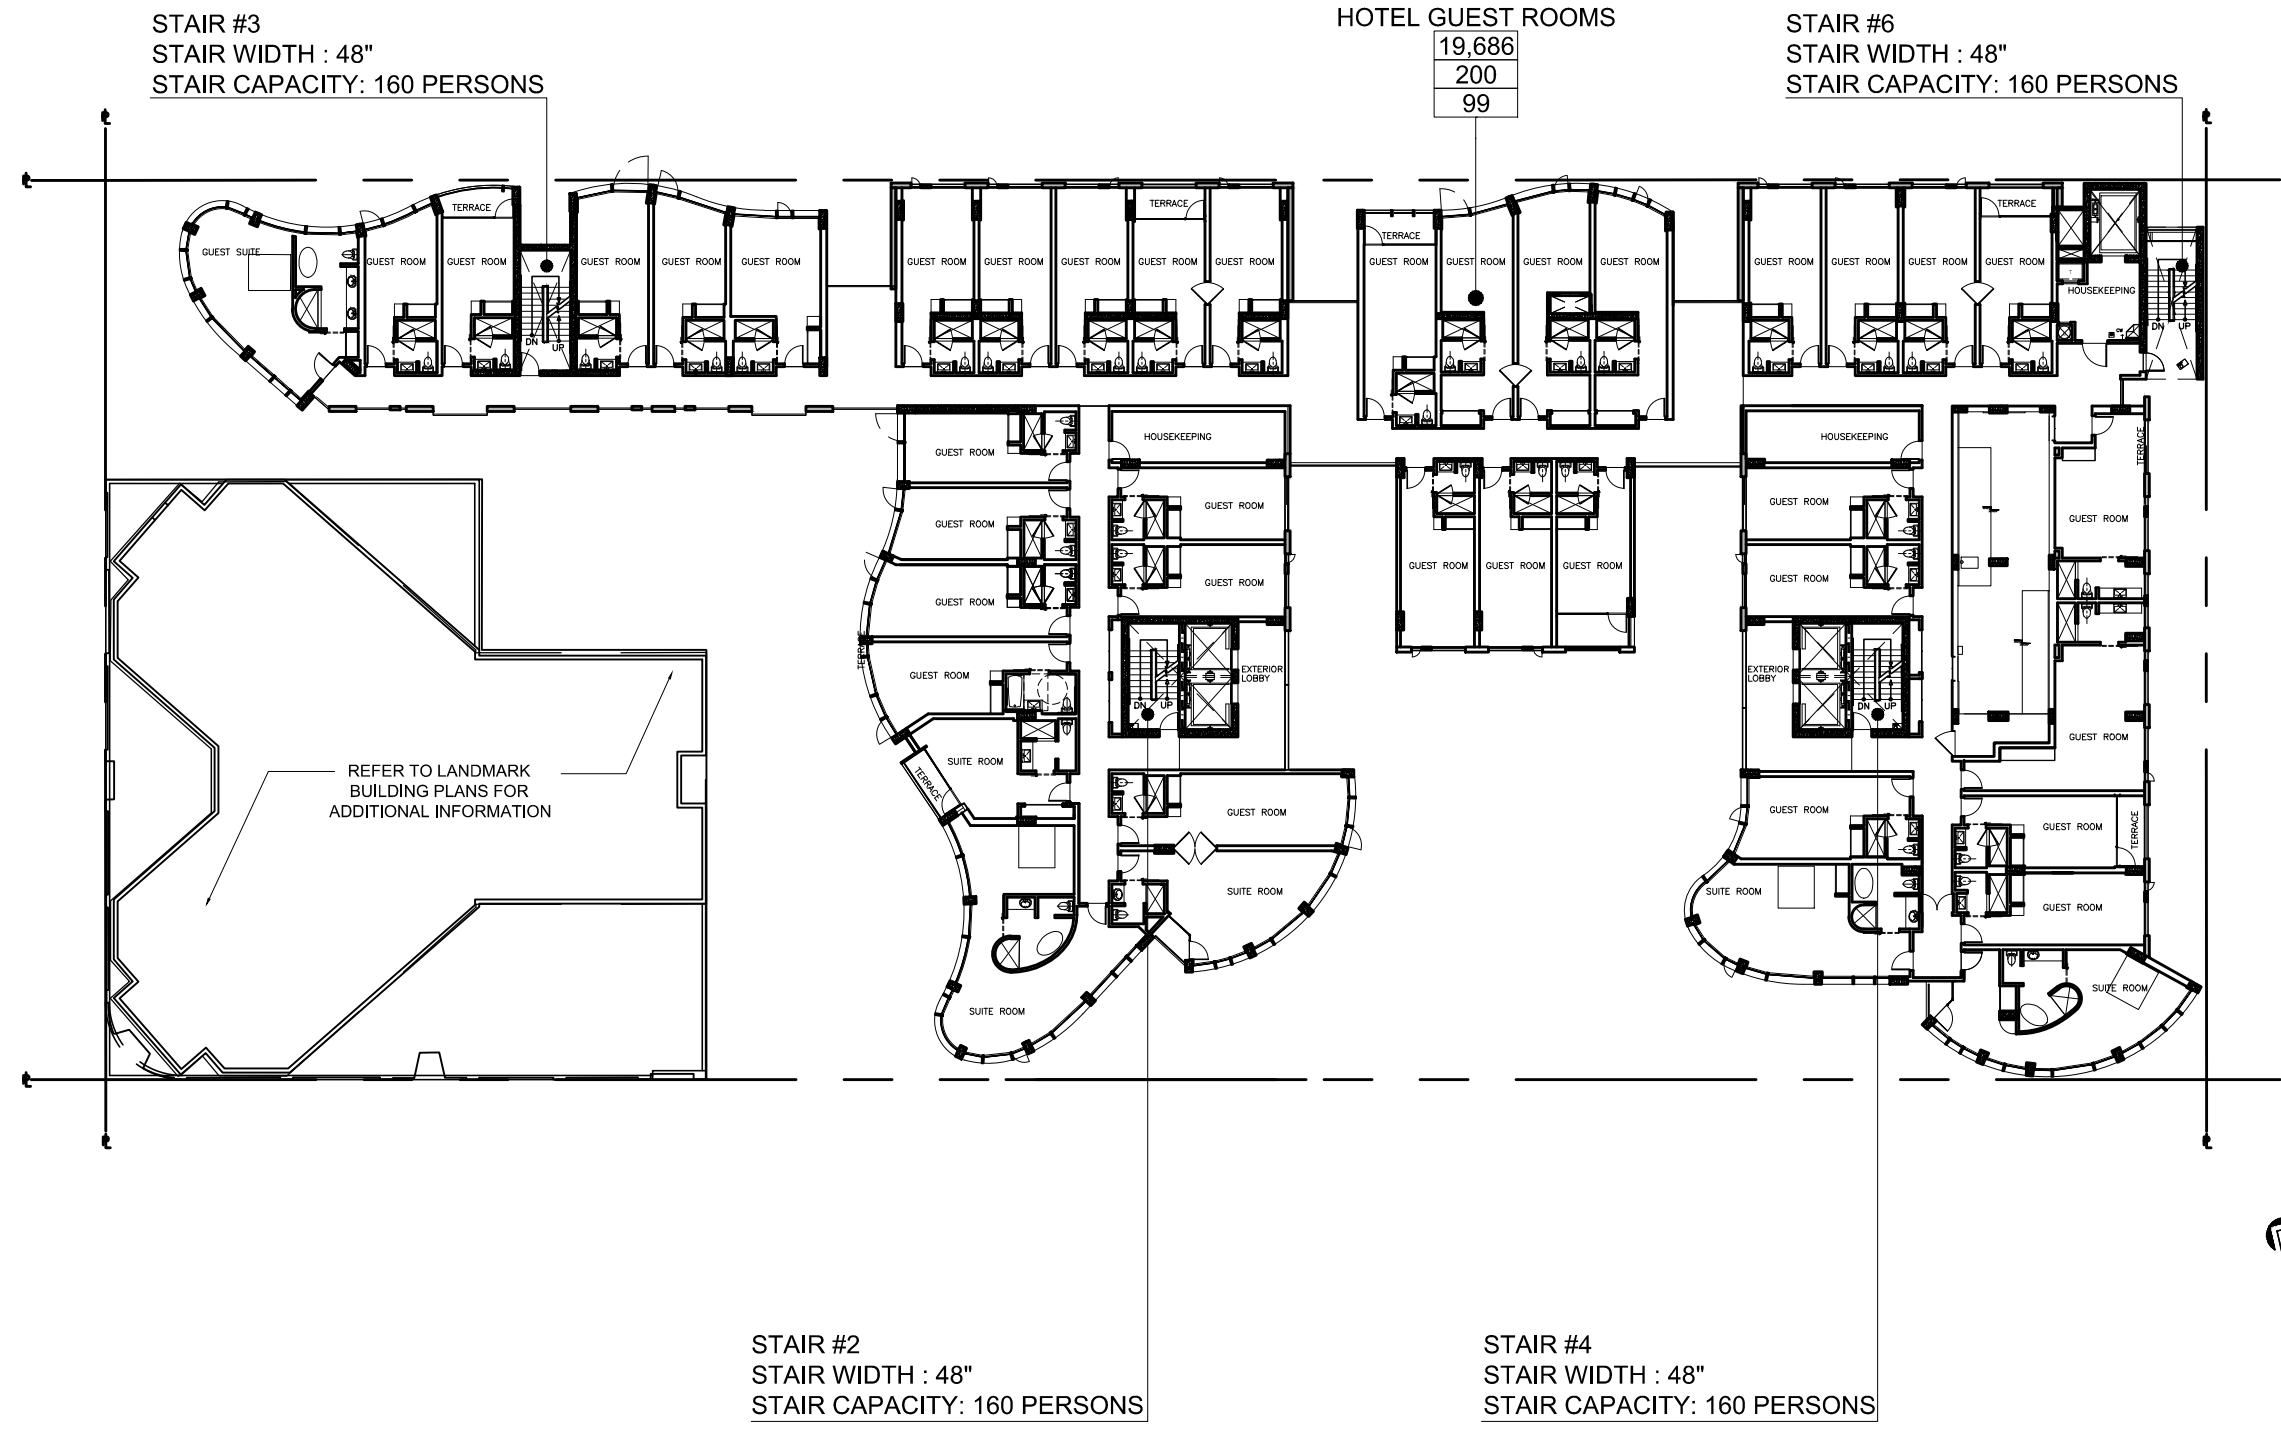


MAX TRAVEL DISTANCE TO AN EXIT: 72'-0"
MAX PERMITTED TRAVEL DISTANCE: 400'
FULLY SPRINKLED STRUCTURE

SIXTH FLOOR PLAN
OCCUPANCY: R1 - GROSS AREA: 19,686 S.F.
TOTAL OCCUPANTS: 99 : 4 STAIRS = 25
REQUIRED STAIR WIDTH: 25 x 0.3 = 7.5"
PROVIDED STAIR WIDTH: 48"
REQUIRED EXIT DOOR WIDTH: 25 x 0.2 = 5"
PROVIDED EXIT DOOR WIDTH: 36" NOMINALLY

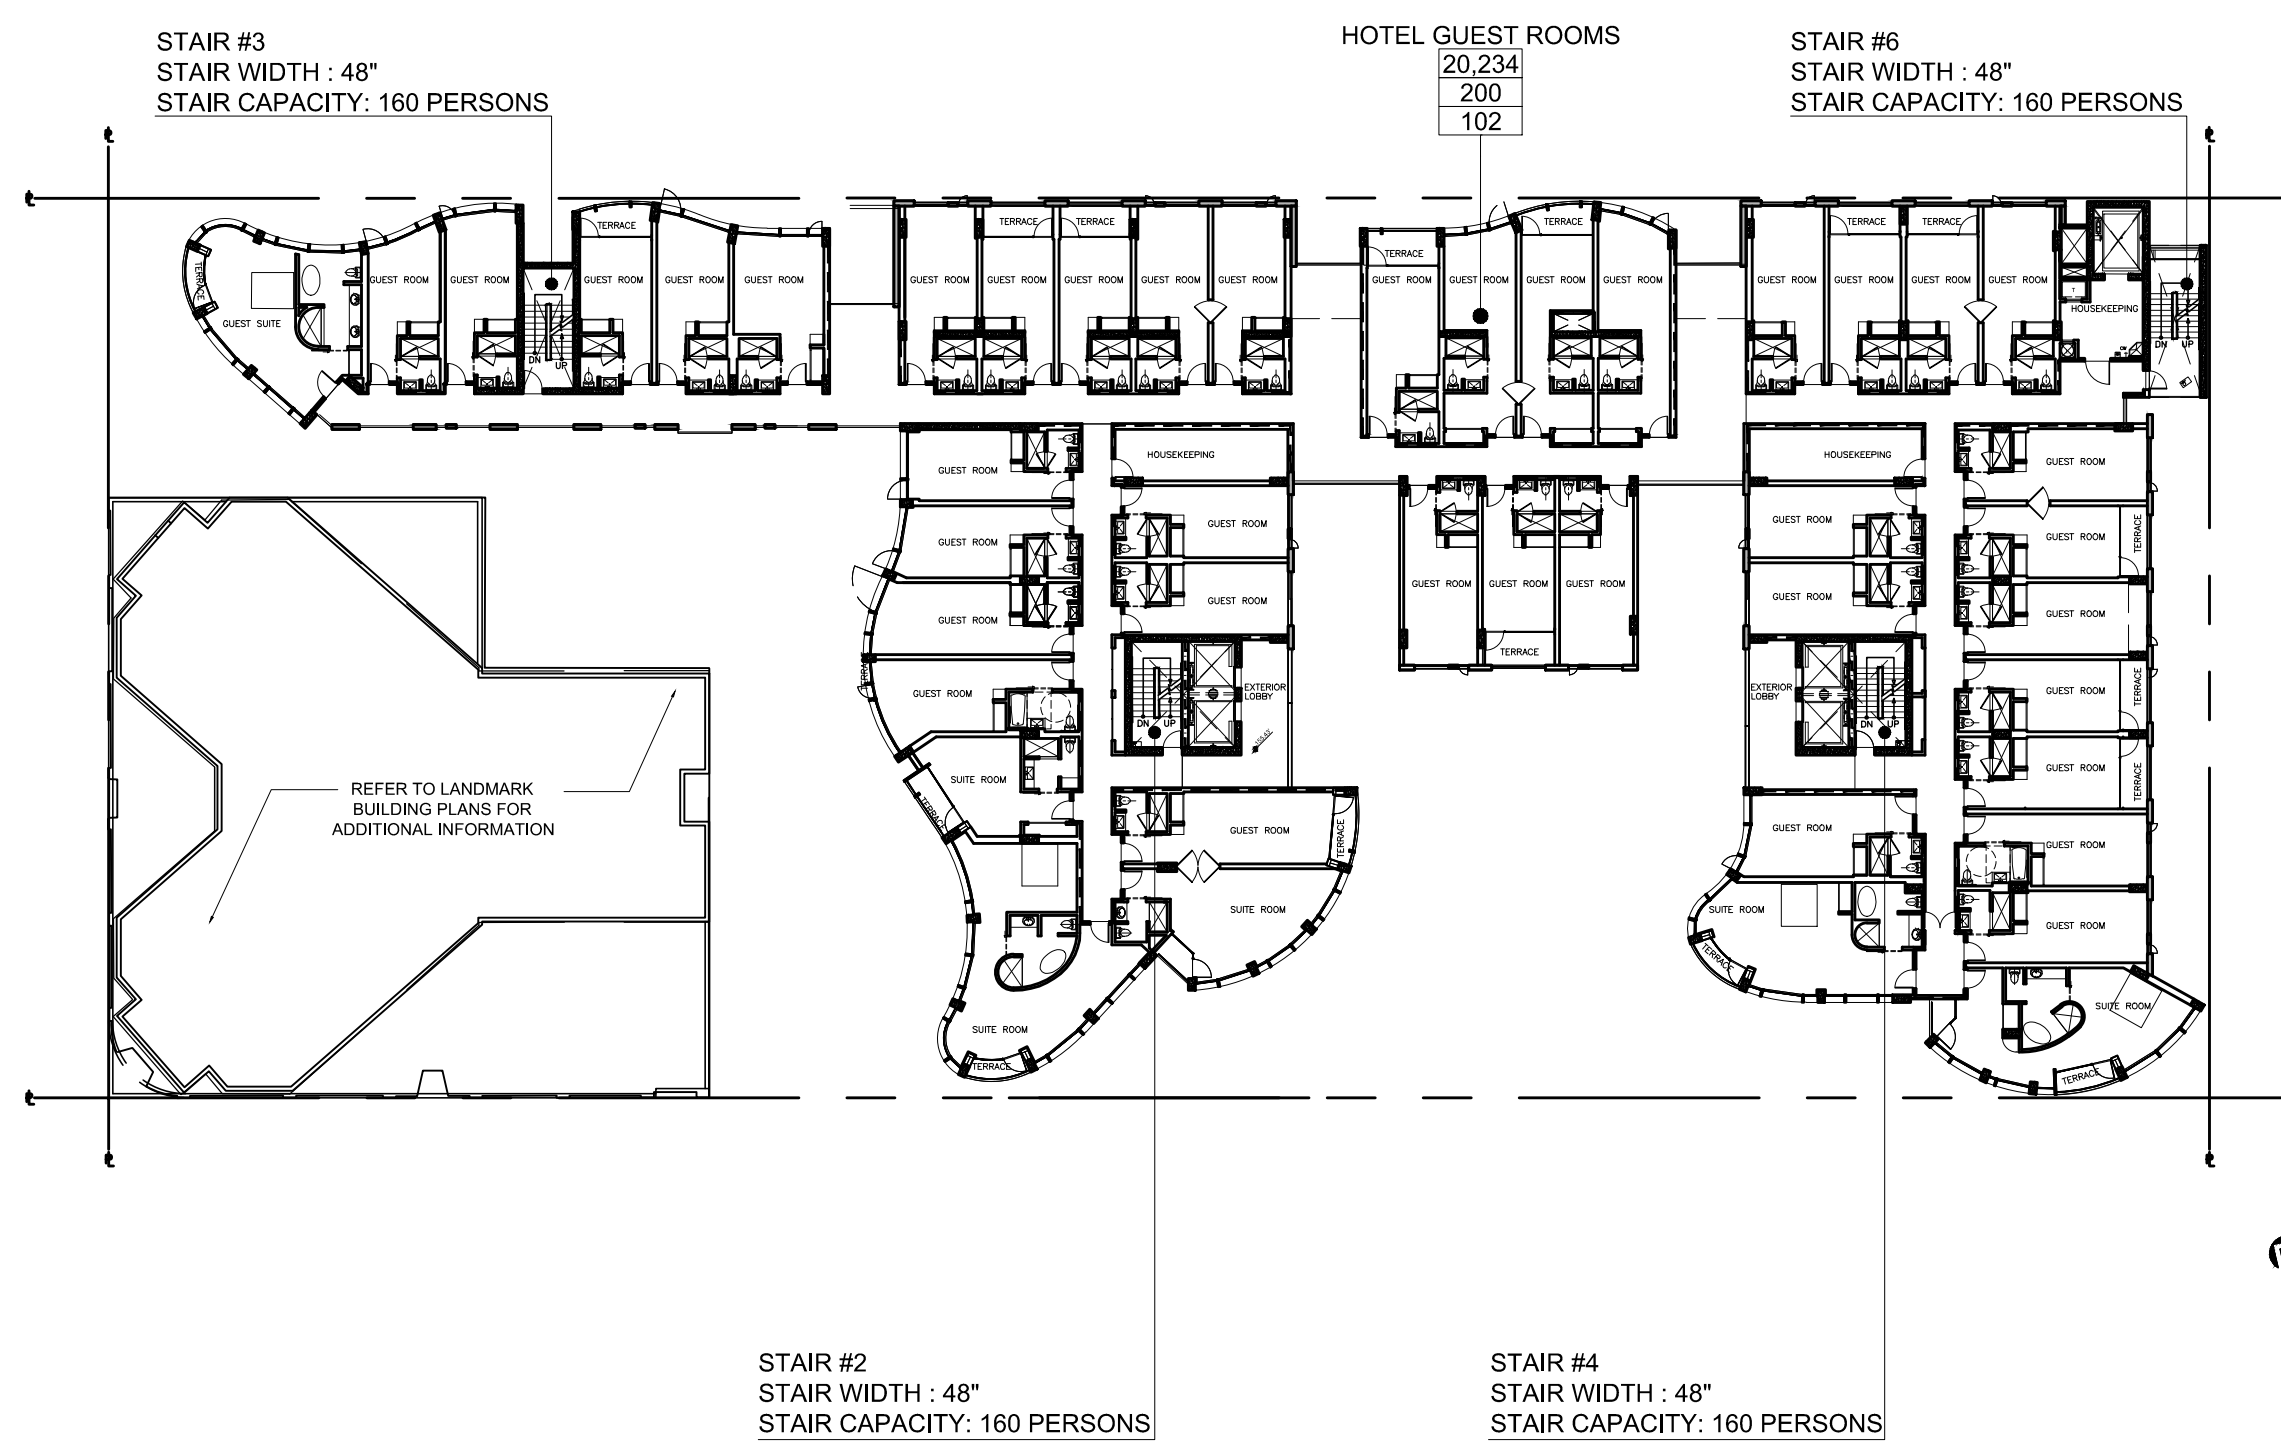


MAX TRAVEL DISTANCE TO AN EXIT: 72'-0"
MAX PERMITTED TRAVEL DISTANCE: 400'
FULLY SPRINKLED STRUCTURE

FIFTH FLOOR PLAN
OCCUPANCY: R1 - GROSS AREA: 20,234 S.F.
TOTAL OCCUPANTS: 102 : 4 STAIRS = 26
REQUIRED STAIR WIDTH: 26 x 0.3 = 7.8"
PROVIDED STAIR WIDTH: 48"
REQUIRED EXIT DOOR WIDTH: 26 x 0.2 = 5.2"
PROVIDED EXIT DOOR WIDTH: 36" NOMINALLY

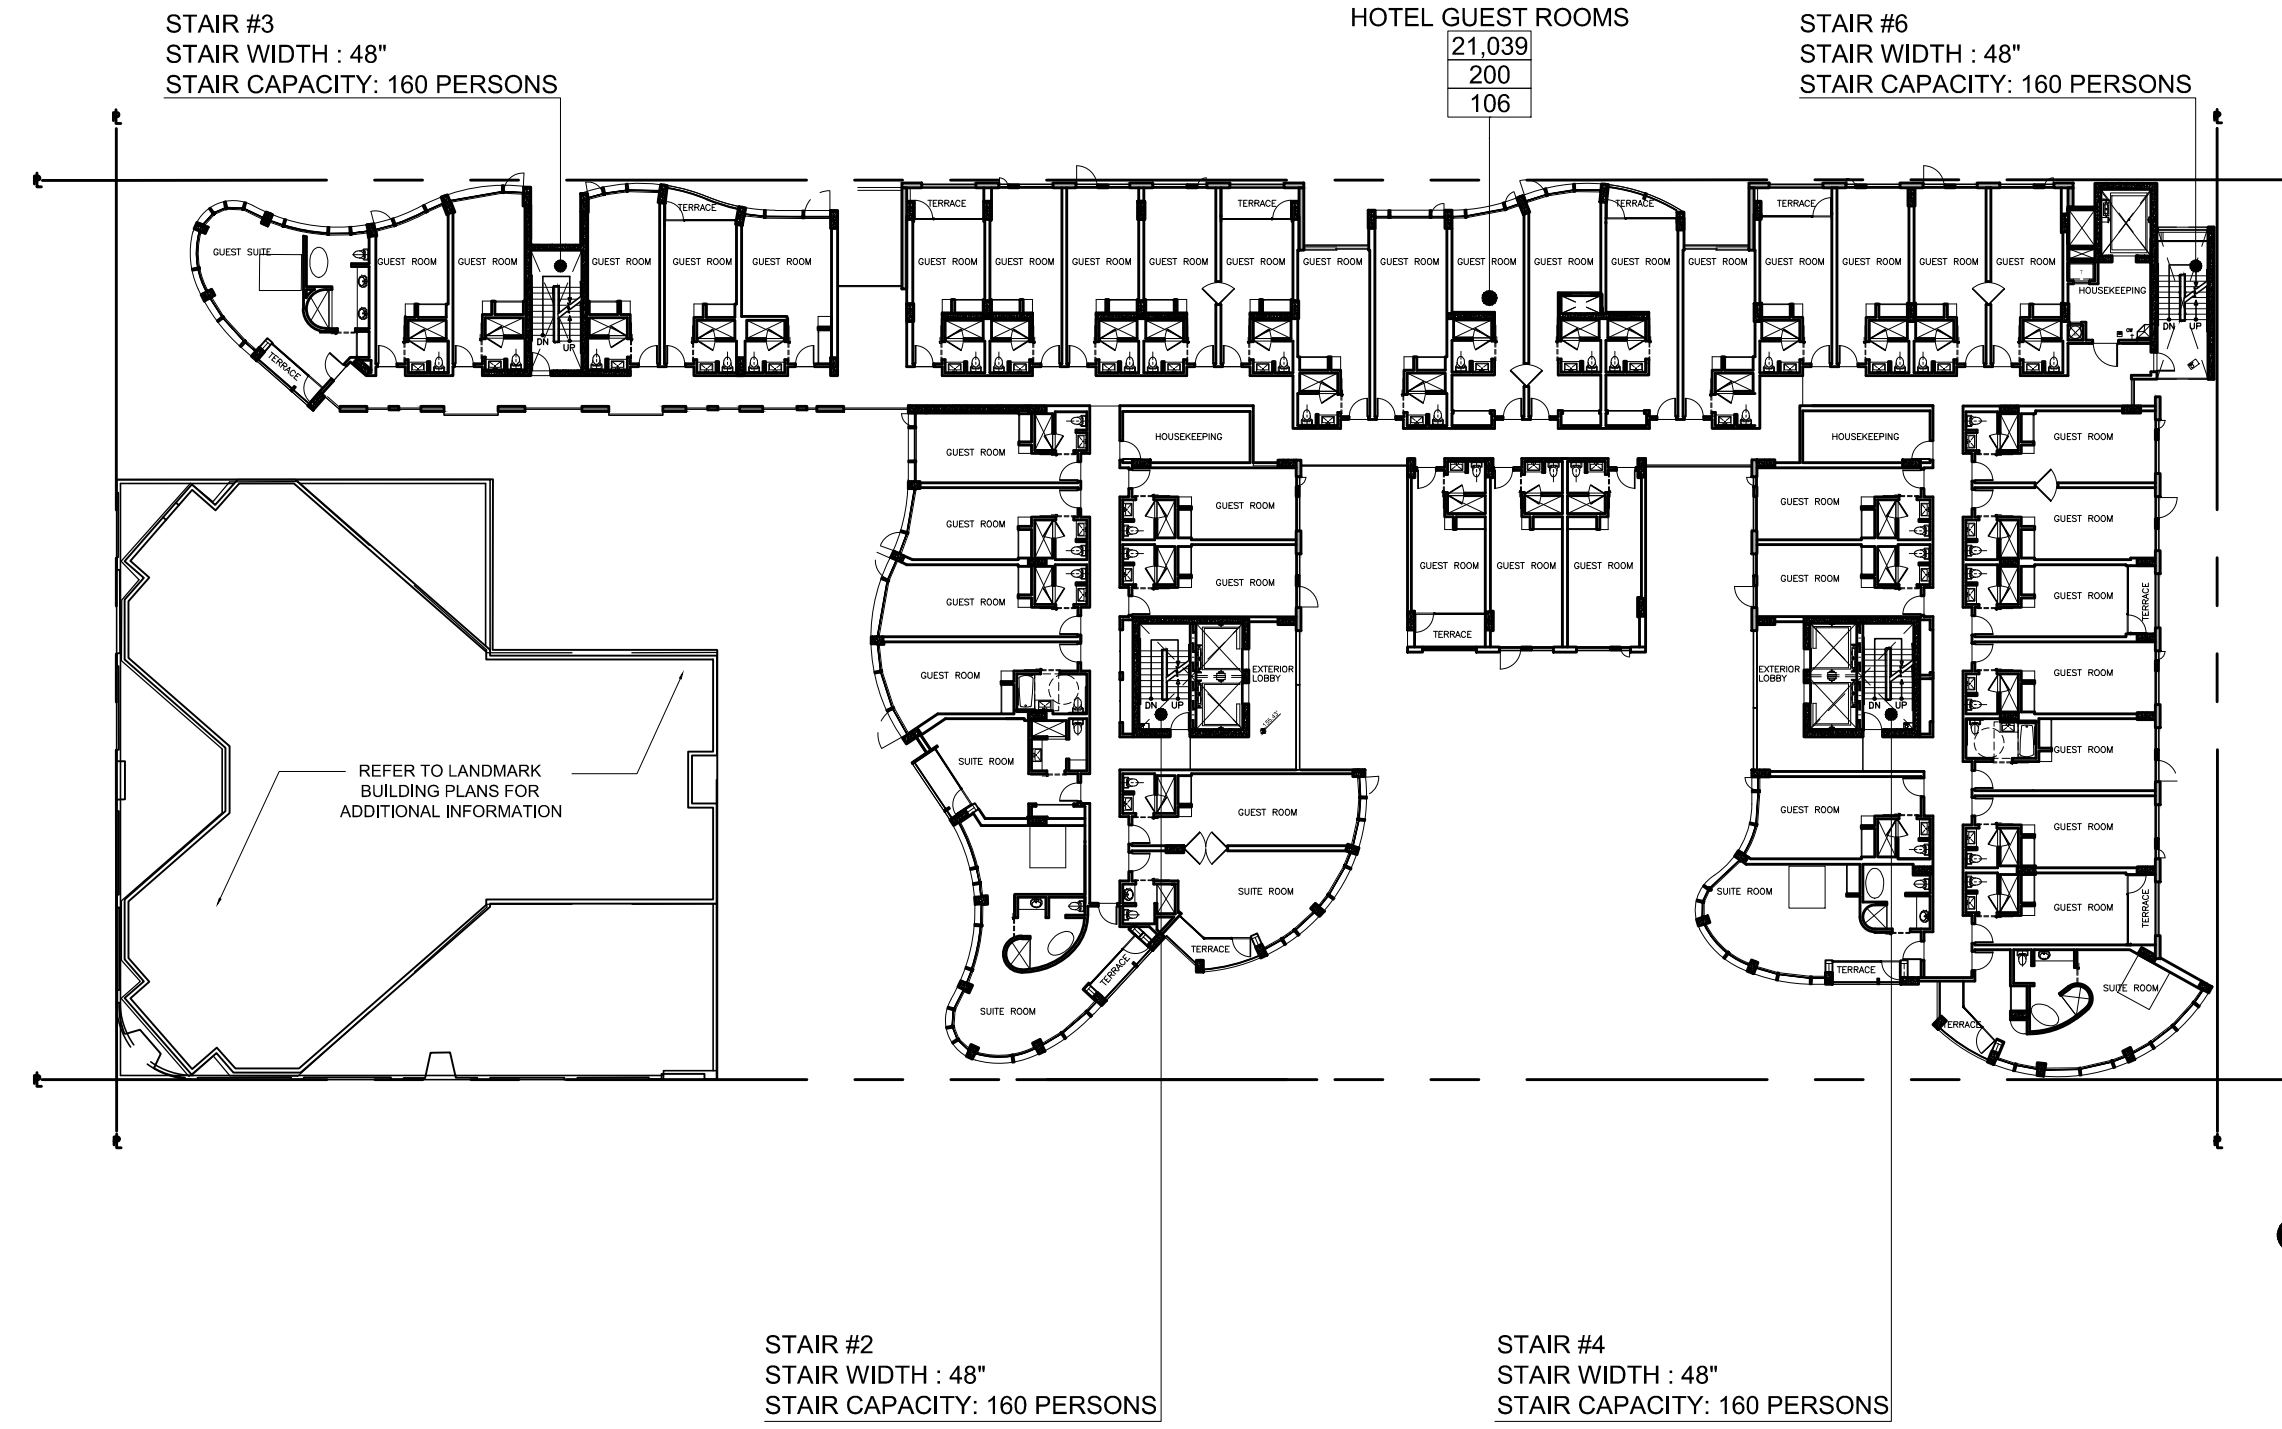


MAX TRAVEL DISTANCE TO AN EXIT: 72'-0"
MAX PERMITTED TRAVEL DISTANCE: 400'
FULLY SPRINKLED STRUCTURE

FOURTH FLOOR PLAN
OCCUPANCY: R1 - GROSS AREA: 21,039 S.F.
TOTAL OCCUPANTS: 106 : 4 STAIRS = 27
REQUIRED STAIR WIDTH: 27 x 0.3 = 8.1"
PROVIDED STAIR WIDTH: 48"
REQUIRED EXIT DOOR WIDTH: 27 x 0.2 = 5.4"
PROVIDED EXIT DOOR WIDTH: 36" NOMINALLY

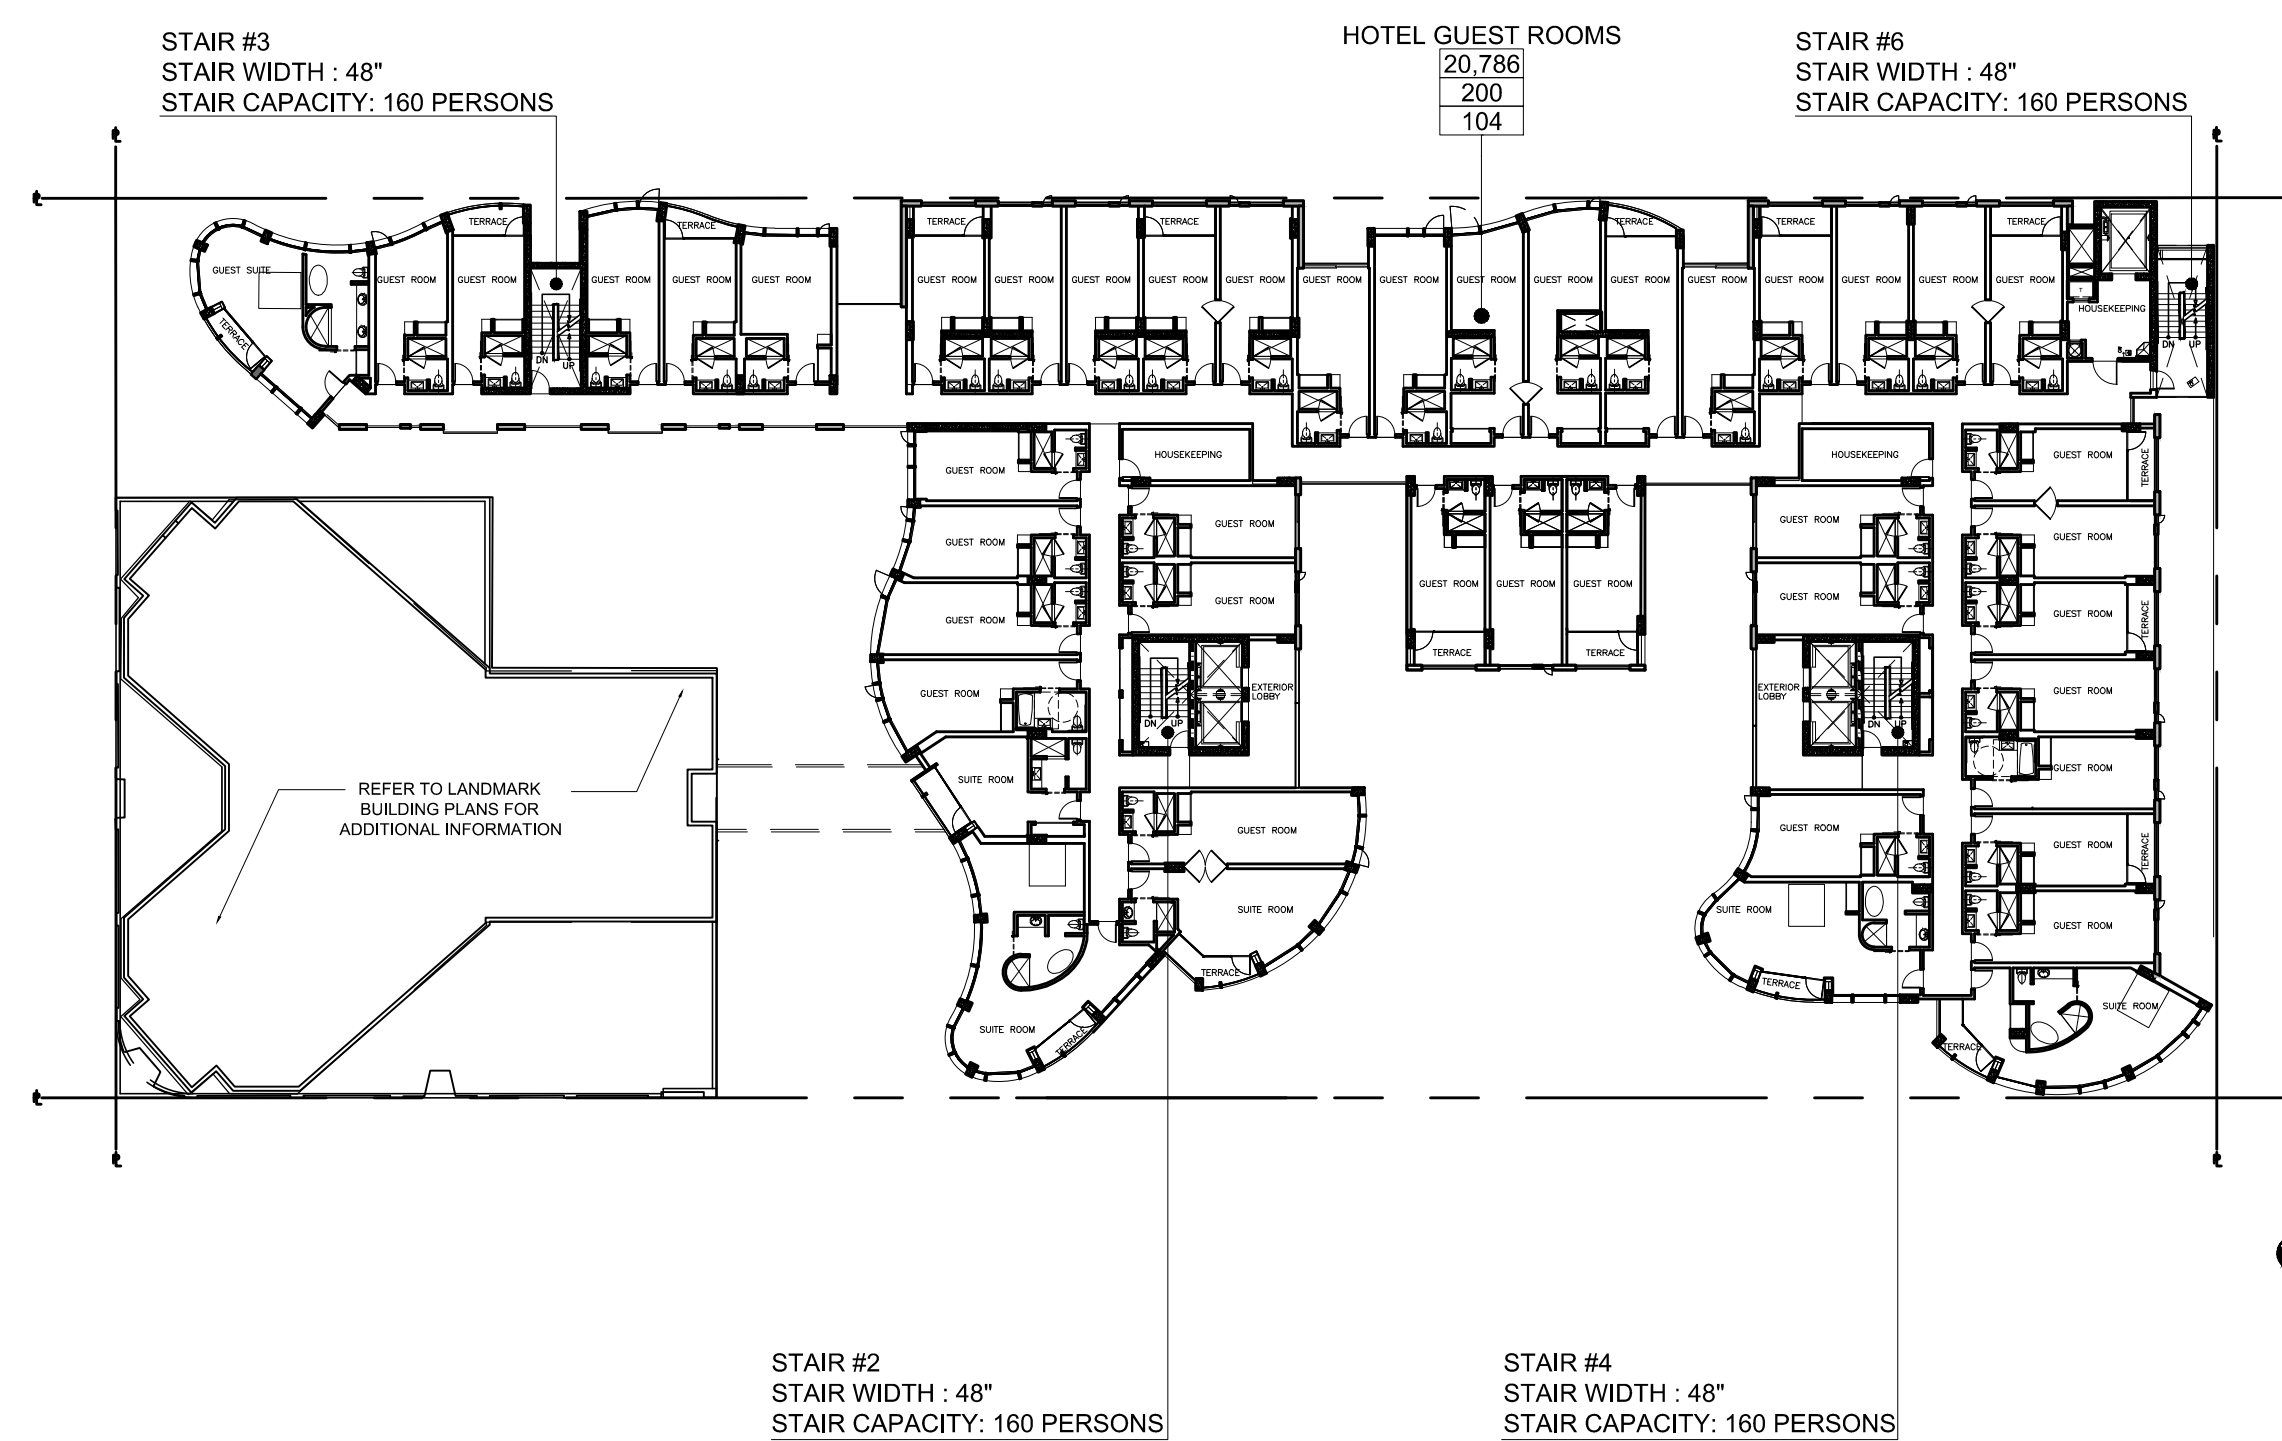


MAX TRAVEL DISTANCE TO AN EXIT: 72'-0"
MAX PERMITTED TRAVEL DISTANCE: 400'
FULLY SPRINKLED STRUCTURE

THIRD FLOOR PLAN
OCCUPANCY: R1 - GROSS AREA: 20,786 S.F.
TOTAL OCCUPANTS: 104 : 4 STAIRS = 26
REQUIRED STAIR WIDTH: 26 x 0.3 = 7.8"
PROVIDED STAIR WIDTH: 48"
REQUIRED EXIT DOOR WIDTH: 26 x 0.2 = 5.2"
PROVIDED EXIT DOOR WIDTH: 36" NOMINALLY

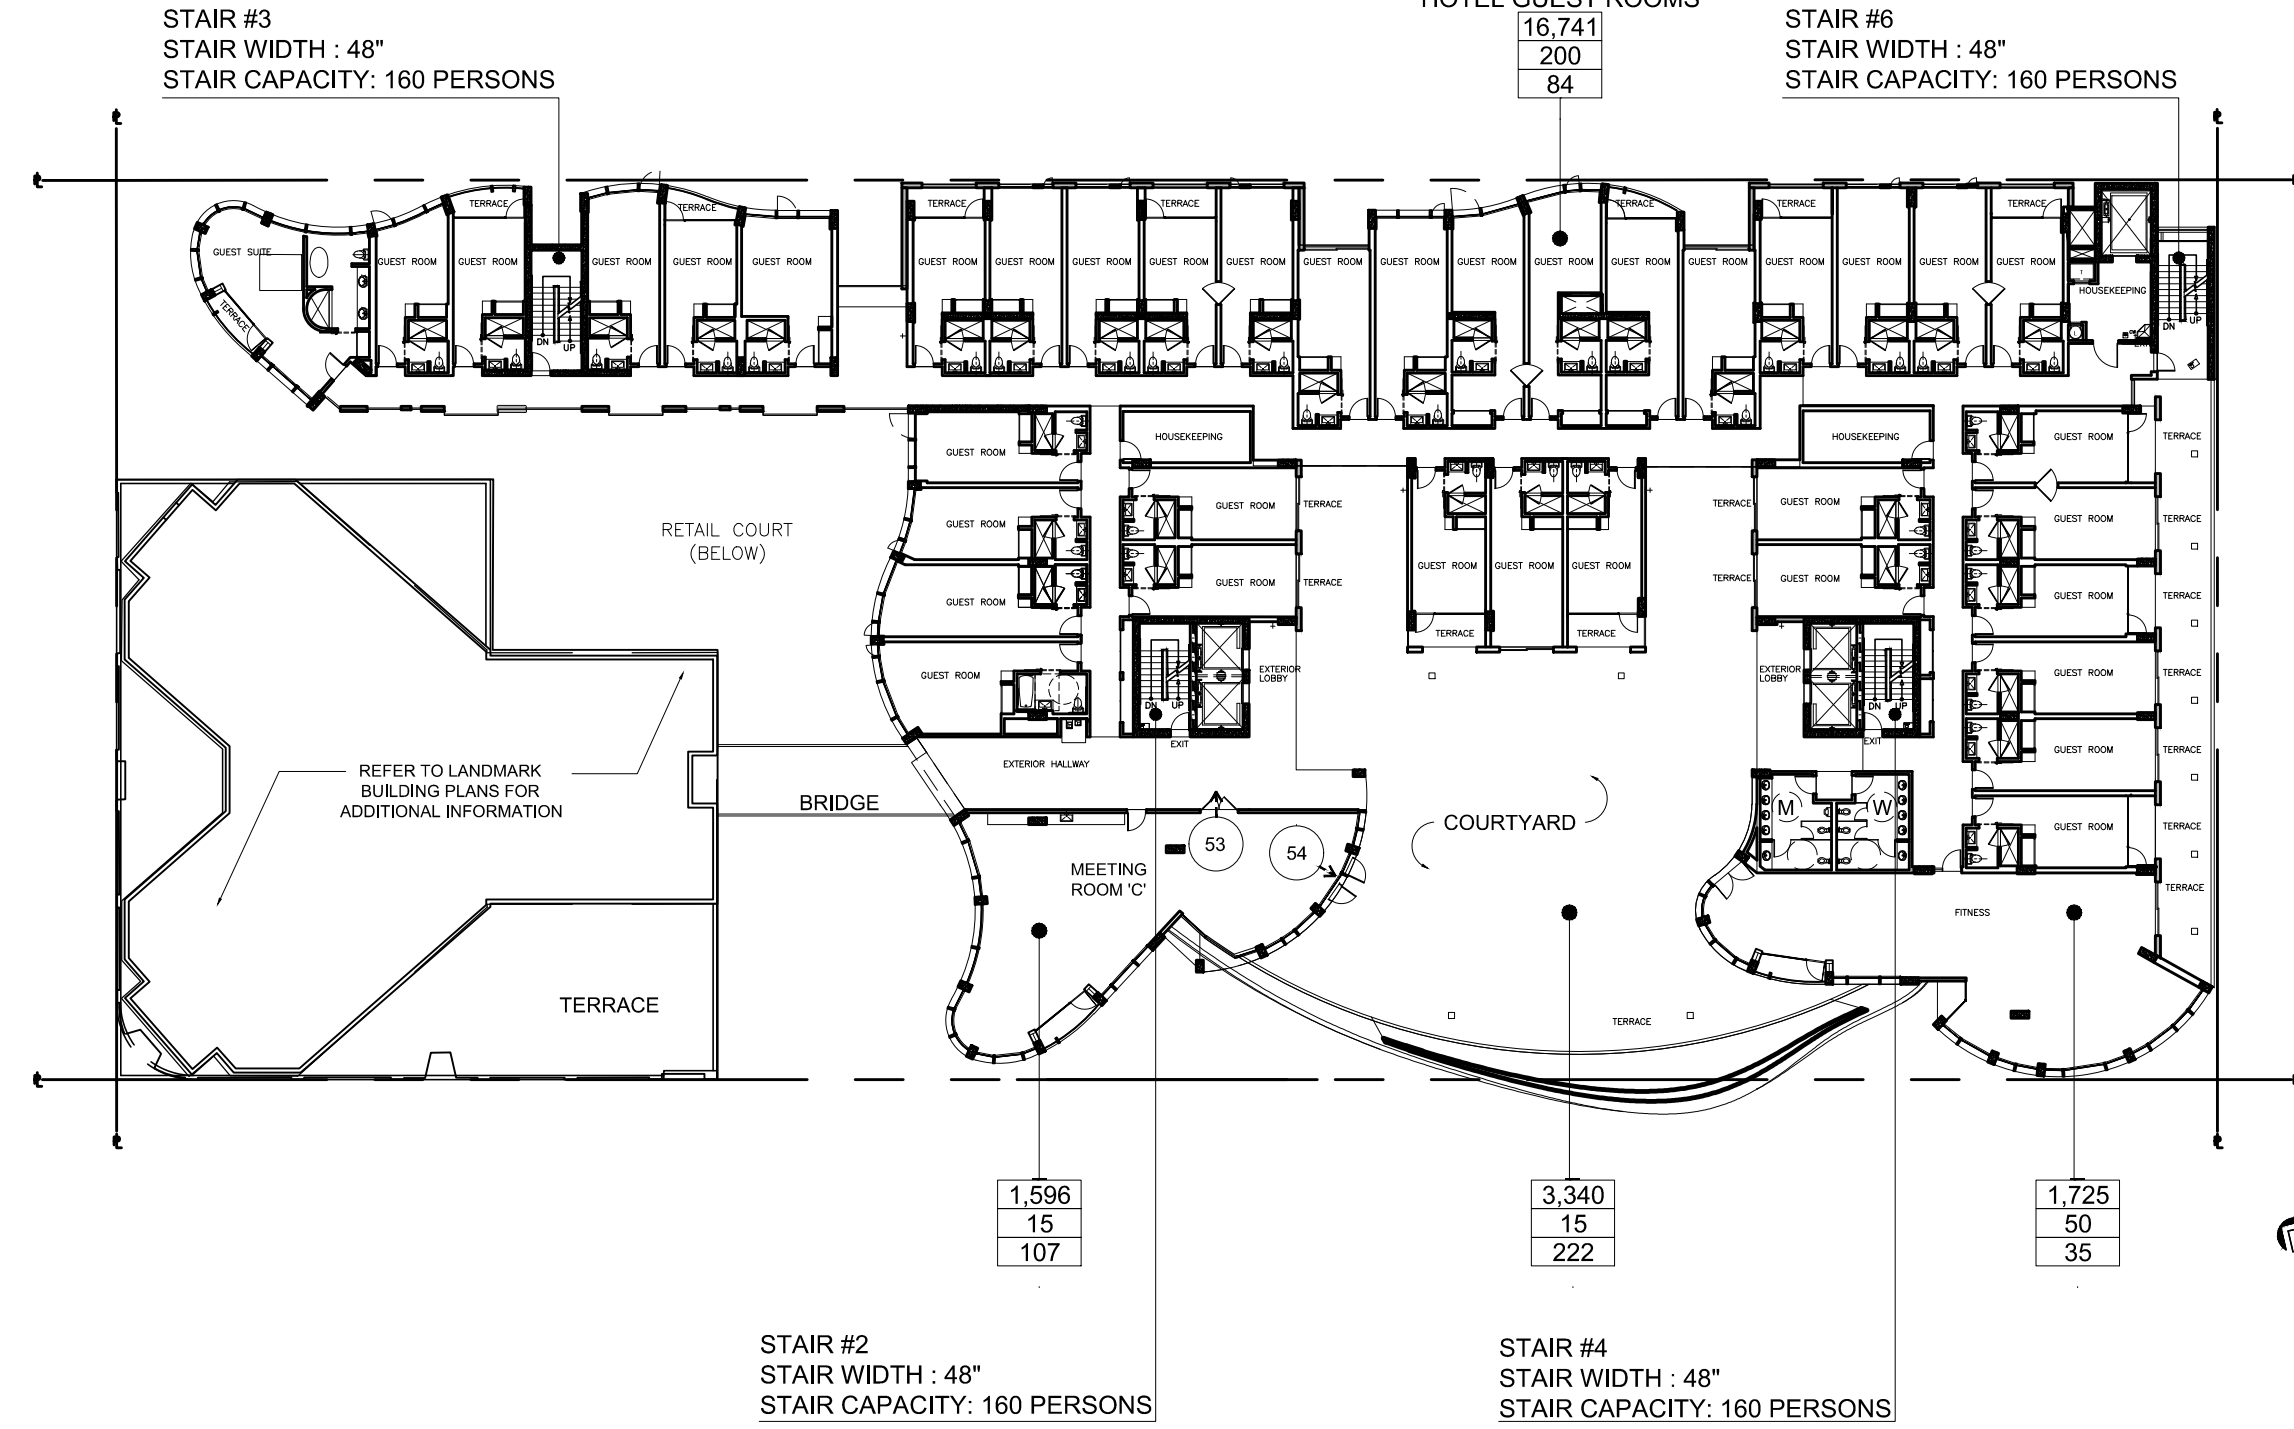

MAX TRAVEL DISTANCE TO AN EXIT: 72'-0"
MAX PERMITTED TRAVEL DISTANCE: 400'
FULLY SPRINKLED STRUCTURE

SECOND FLOOR PLAN
OCCUPANCY: R1 - GROSS AREA: 16,741 S.F.
TOTAL OCCUPANTS: 448 : 4 STAIRS = 112
REQUIRED STAIR WIDTH: 112 x 0.3 = 33.6"
PROVIDED STAIR WIDTH: 48"
REQUIRED EXIT DOOR WIDTH: 112 x 0.2 = 22.4"
PROVIDED EXIT DOOR WIDTH: 36" NOMINALLY

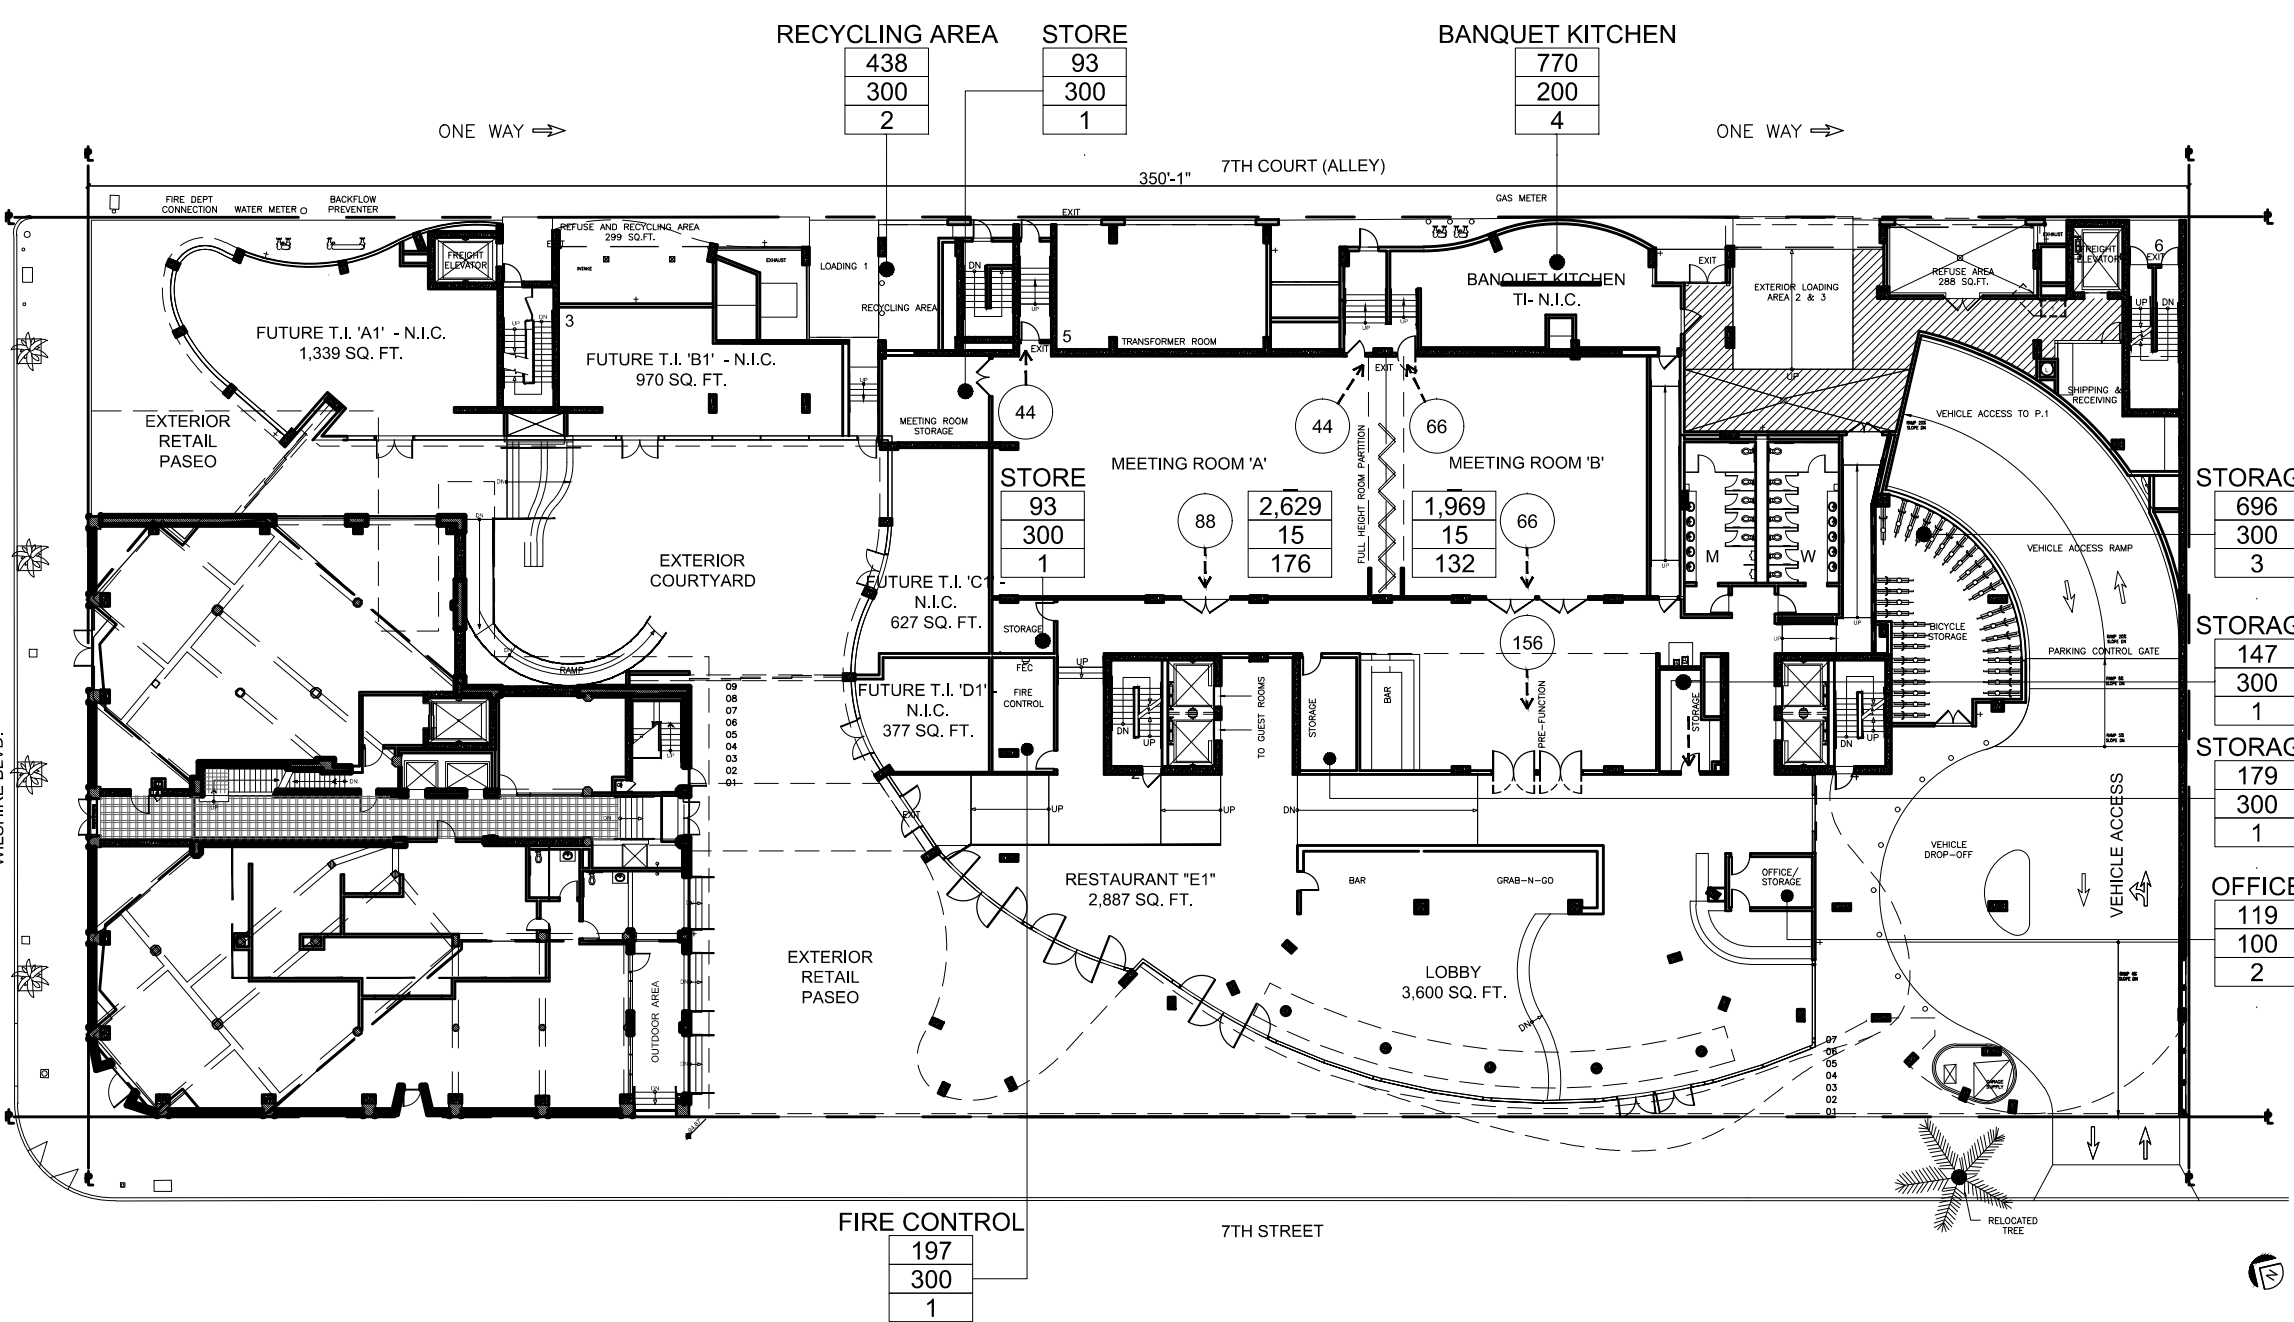

MAX TRAVEL DISTANCE FROM ANY POINT: 36'-0"
MAX PERMITTED TRAVEL DISTANCE TO AN EXIT: 250'
FULLY SPRINKLERED STRUCTURE

GROUND FLOOR PLAN
OCCUPANCY: R1, M, A-2.
SEE DOOR SCHEDULE FOR WIDTH OF
DOORS OUT OF ANNOTATED SPACES.

REVISION	DATE	DESCRIPTION
1	05/07/2015	MEETING ROOM 1
2	05/07/2015	MEETING ROOM 2
3	05/07/2015	MEETING ROOM 3
4	05/07/2015	MEETING ROOM 4
5	05/07/2015	MEETING ROOM 5



howard laks architects
1545 health street
santa monica, ca 90401
voice : 310-393-4465
fax : 310-393-2230

CONSULTANTS

710 WILSHIRE BOULEVARD
MIXED-USE HOTEL PROJECT
SANTA MONICA - CALIFORNIA 90401
HOTEL EGRESS DIAGRAMS

DRAWN	SKH
CHECKED	HLA
APPROVED	-
SCALE	N.T.S.
SHEET	A-006
DATE	June 25, 2013
PROJECT NUMBER	HLA 0000000-00000