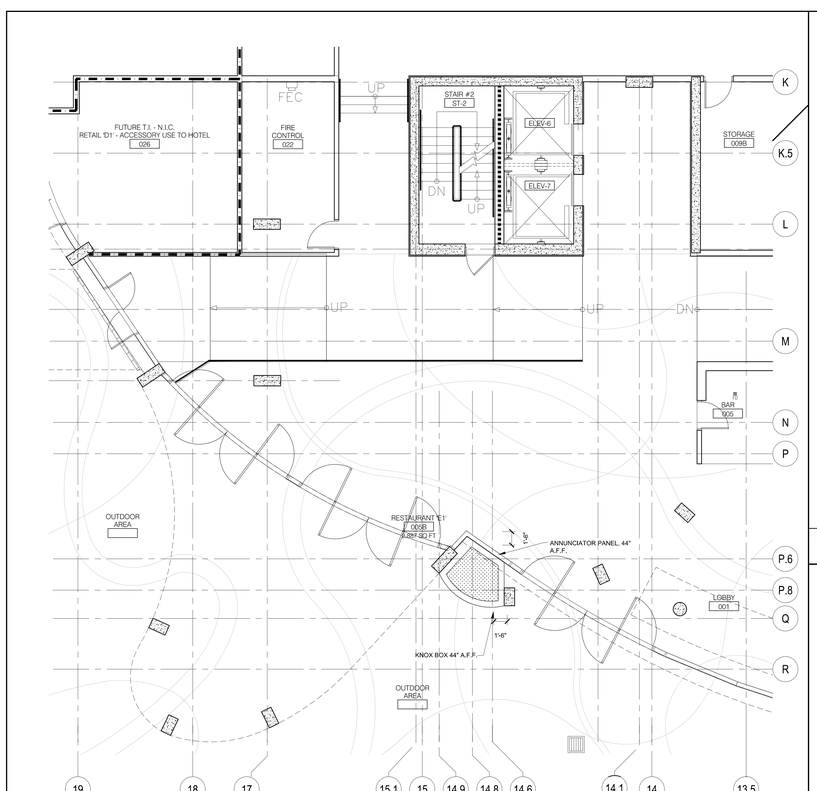

FIRE CONTROL ROOM
GROUND FLOOR

3/16" = 1'-0"

11

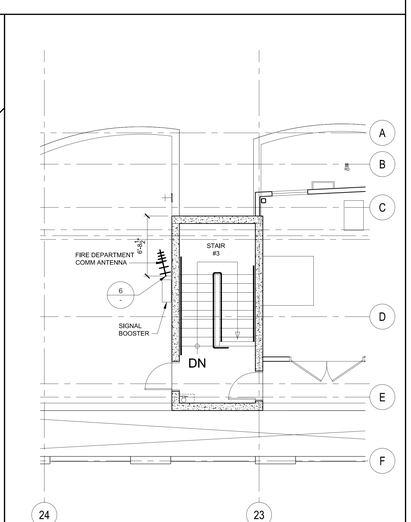

FD- UHF ANTENNA
7TH FLOOR

3/16" = 1'-0"

7

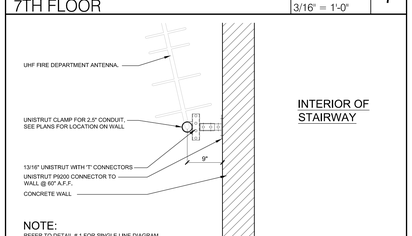

NOTE:
REFER TO DETAIL # 1 FOR SINGLE LINE DIAGRAM

ANTENNA TO WALL
UHF-FD

1" = 1'-0"

6

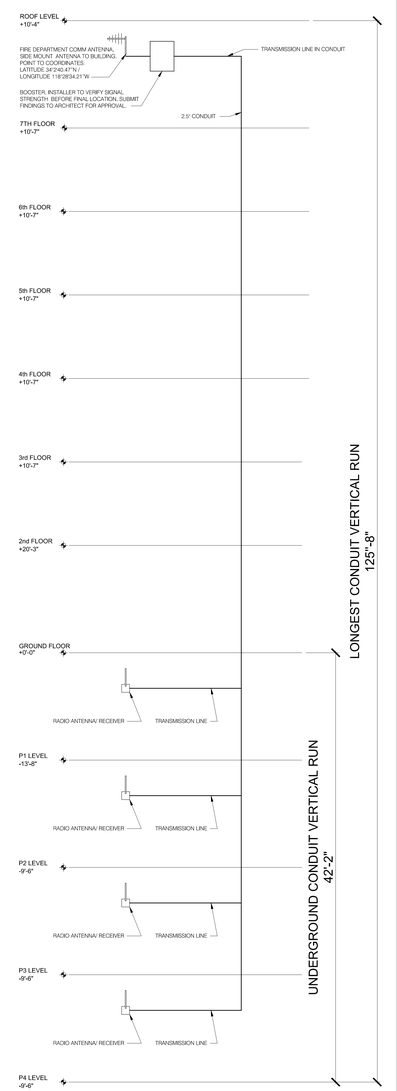

NOTE:

1. THIS DIAGRAM IS SCHEMATIC.
2. THE FINAL DESIGN WILL BE BASED ON THE SIGNAL STRENGTH TESTED AT THE TIME OF COMPLETION OF THE UNDERGROUND STRUCTURES.
3. CONTRACTOR TO COORDINATE.
4. ALL EQUIPMENT TO BE FCC CERTIFIED.
5. THE SYSTEM MUST COMPLY WITH NFPA 5000 ANNEX F & THE 2010 CFC SECTION 510.

FD - UHF RADIO
SINGLE LINE DIAGRAM

1/4" = 1'-0"

1

REVISIONS			
BY	DATE	DESCRIPTION	
-	05/31/2013	Milestone 02	
-	06/24/2013	Milestone 03	
-	08/30/2013	Milestone 04	
-	09/27/2013	Milestone 05	

howard laks architects
1545 twelfth street
santa monica, ca 90401
voice : 310-393-4455
fax : 310-393-2230

CONSULTANTS

710 WILSHIRE BOULEVARD

MIXED-USE HOTEL PROJECT
SANTA MONICA - CALIFORNIA 90401

FIRE DEPARTMENT EQUIPMENT

DRAWN: SKH
CHECKED: HLA
APPROVED: _
SCALE: NTS
SHEET: A-008
DATE: June 25, 2013
PROJECT NUMBER: HLA 0000000-00000