


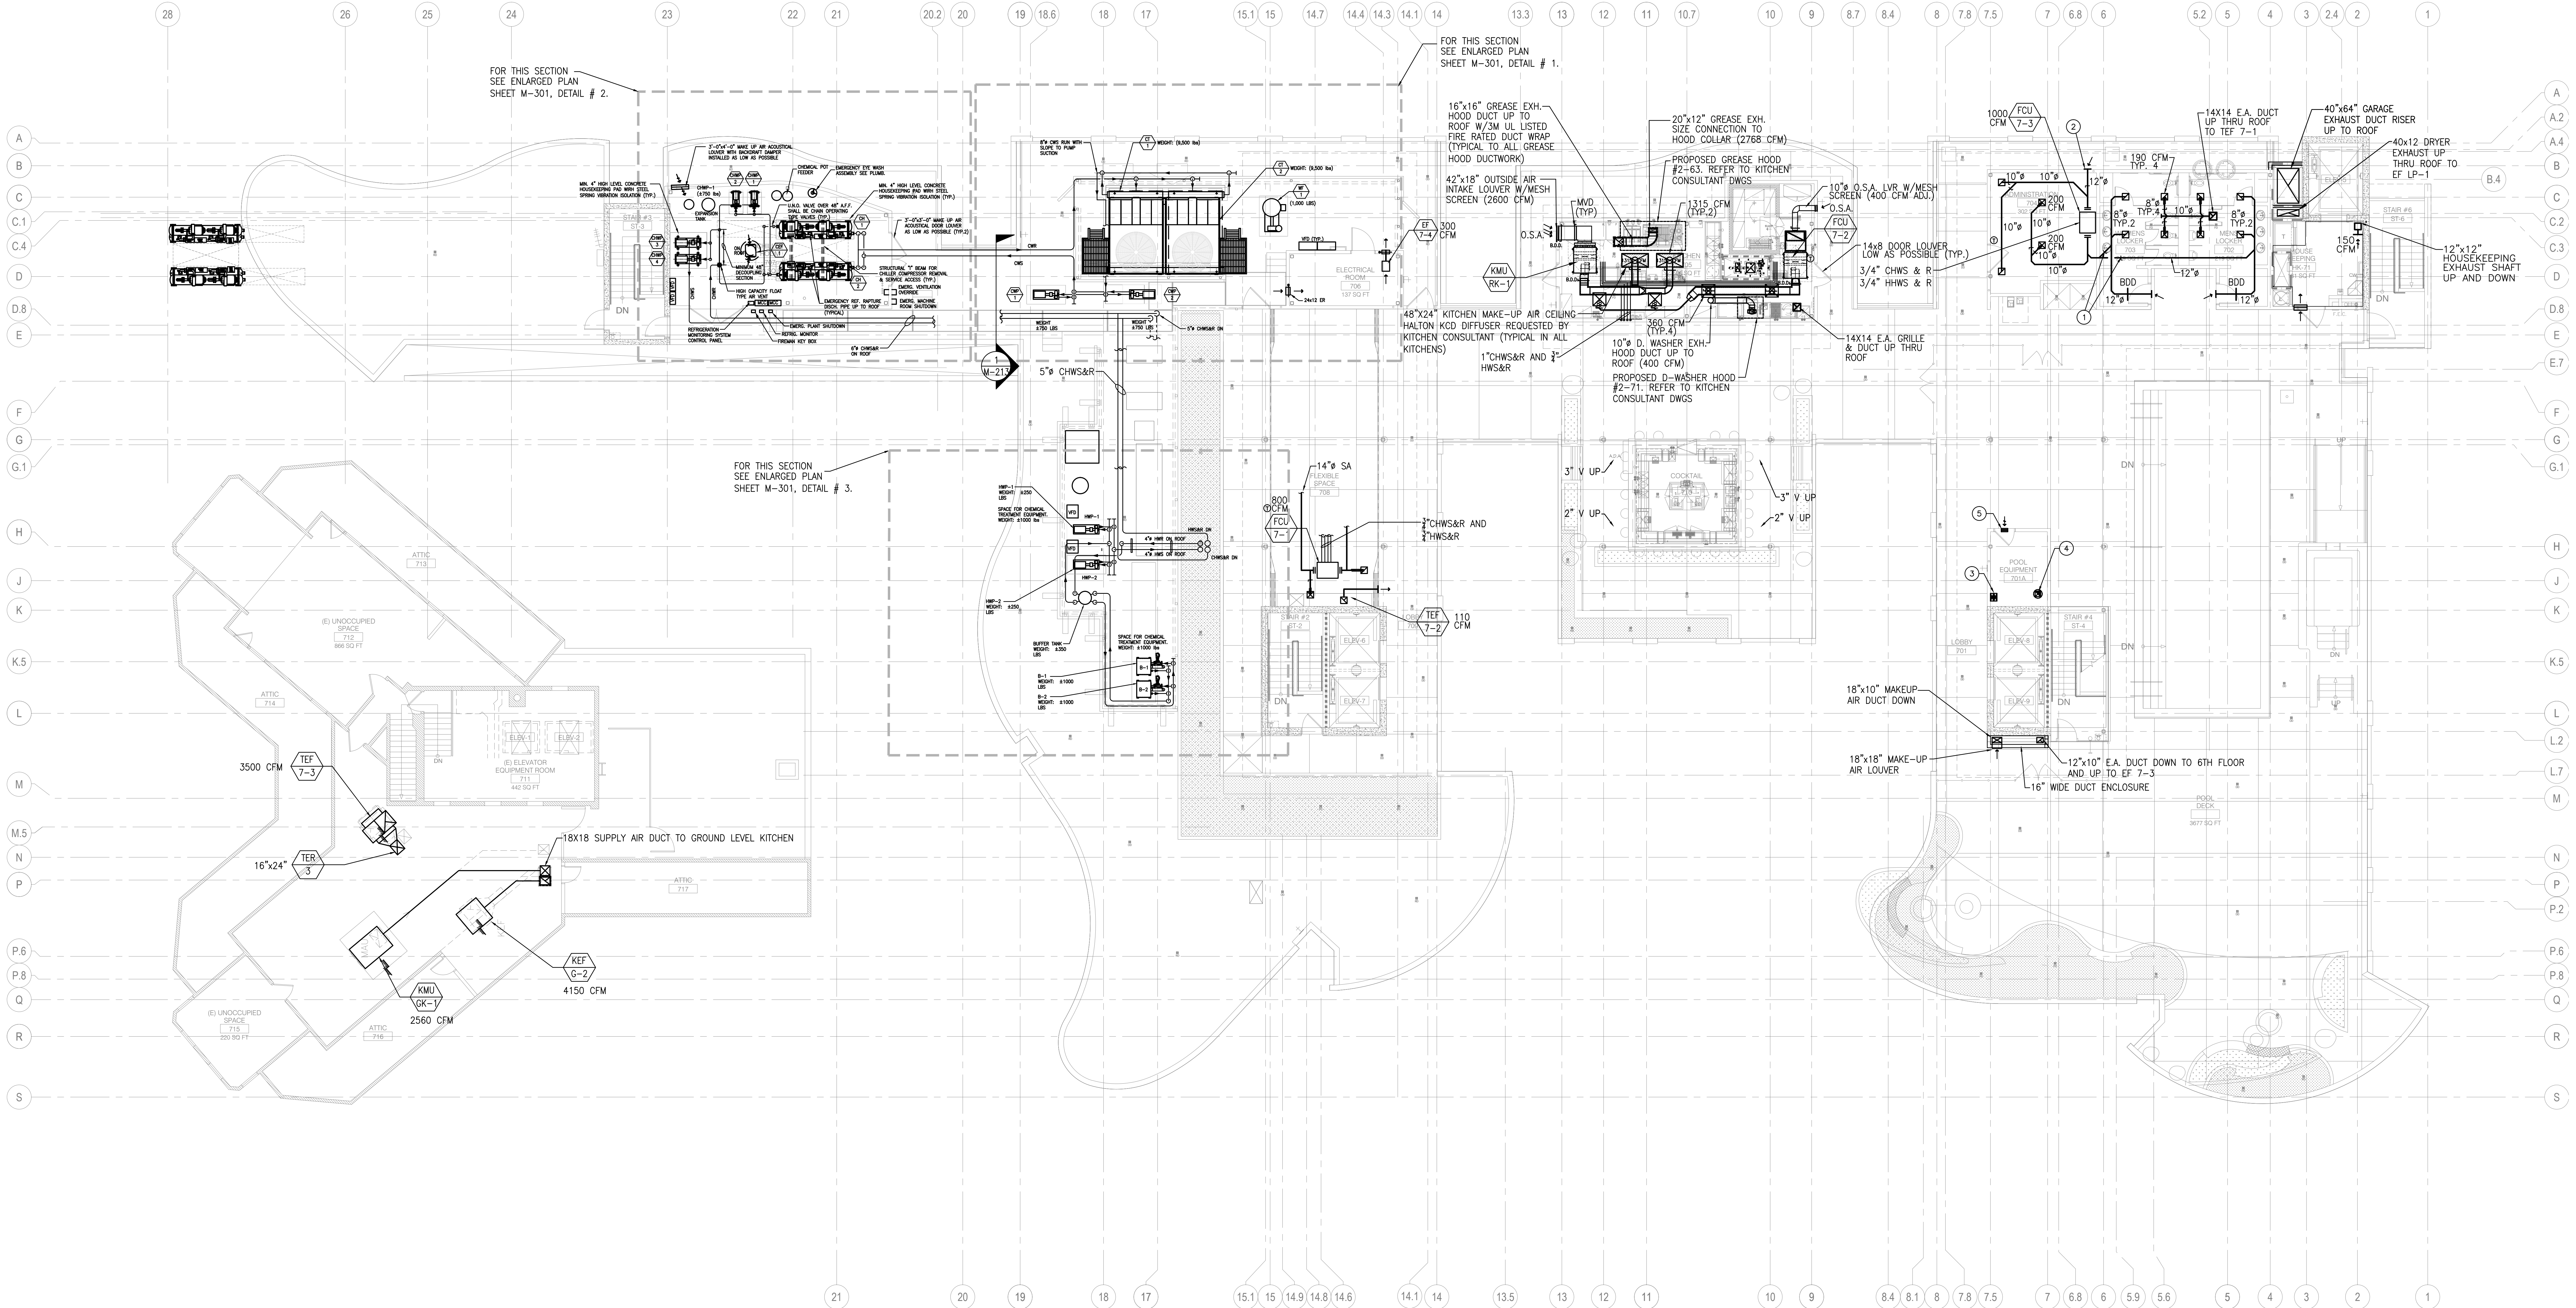

KEY NOTES:

- 1 12"Ø SUPPLY AIR DUCT. 300 CFM.
- 2 18x12 O.S.A. LOUVER. 600 CFM.
- 3 PROVIDE (2) 6"x14" COMBUSTION AIR DUCTS UP THRU ROOF AND GOOSENECK WITH 3" WIRE MESH SCREEN OPENING. ONE (1) DUCT SHALL EXTEND DOWN ALONG WALL TO 12" ABOVE FLOOR & ONE (1) DUCT DOWN TO 12" BELOW CEILING.
- 4 10"x10" CEILING GRILLE WITH 10"x10" DUCT UP THRU ROOF TO EF 7-2.
- 5 12"x12" INTAKE AIR DOOR LOUVER

REVISION	DATE	DESCRIPTION
1	05/07/2015	MECHANICAL
2	06/04/2015	MECHANICAL
3	06/04/2015	MECHANICAL
4	10/20/2015	MECHANICAL
5	03/27/2016	MECHANICAL

hla
howard laks architects
1545 nellis street
santa monica, ca 90401
voice : 310-393-4465
fax : 310-393-2230

CONSULTANTS
Donald F. Dickerson Associates
CONSULTING MECHANICAL & ELECTRICAL ENGINEERS
1700 ALVARADO STREET, SUITE 404
SANTA MONICA, CA 90401
(310) 393-9888
E-MAIL: DONALD@DFA.COM

710 WILSHIRE BOULEVARD
MIXED-USE HOTEL PROJECT
SANTA MONICA - CALIFORNIA, 90401
ROOF TERRACE (W/ PARTIAL SEVENTH FLOOR)

DRAWN	--
CHECKED	--
APPROVED	--
SCALE	1/8" = 1'-0"
SHEET	M-213
DATE	June 25, 2013
PROJECT NUMBER	HLA 0000000-00000