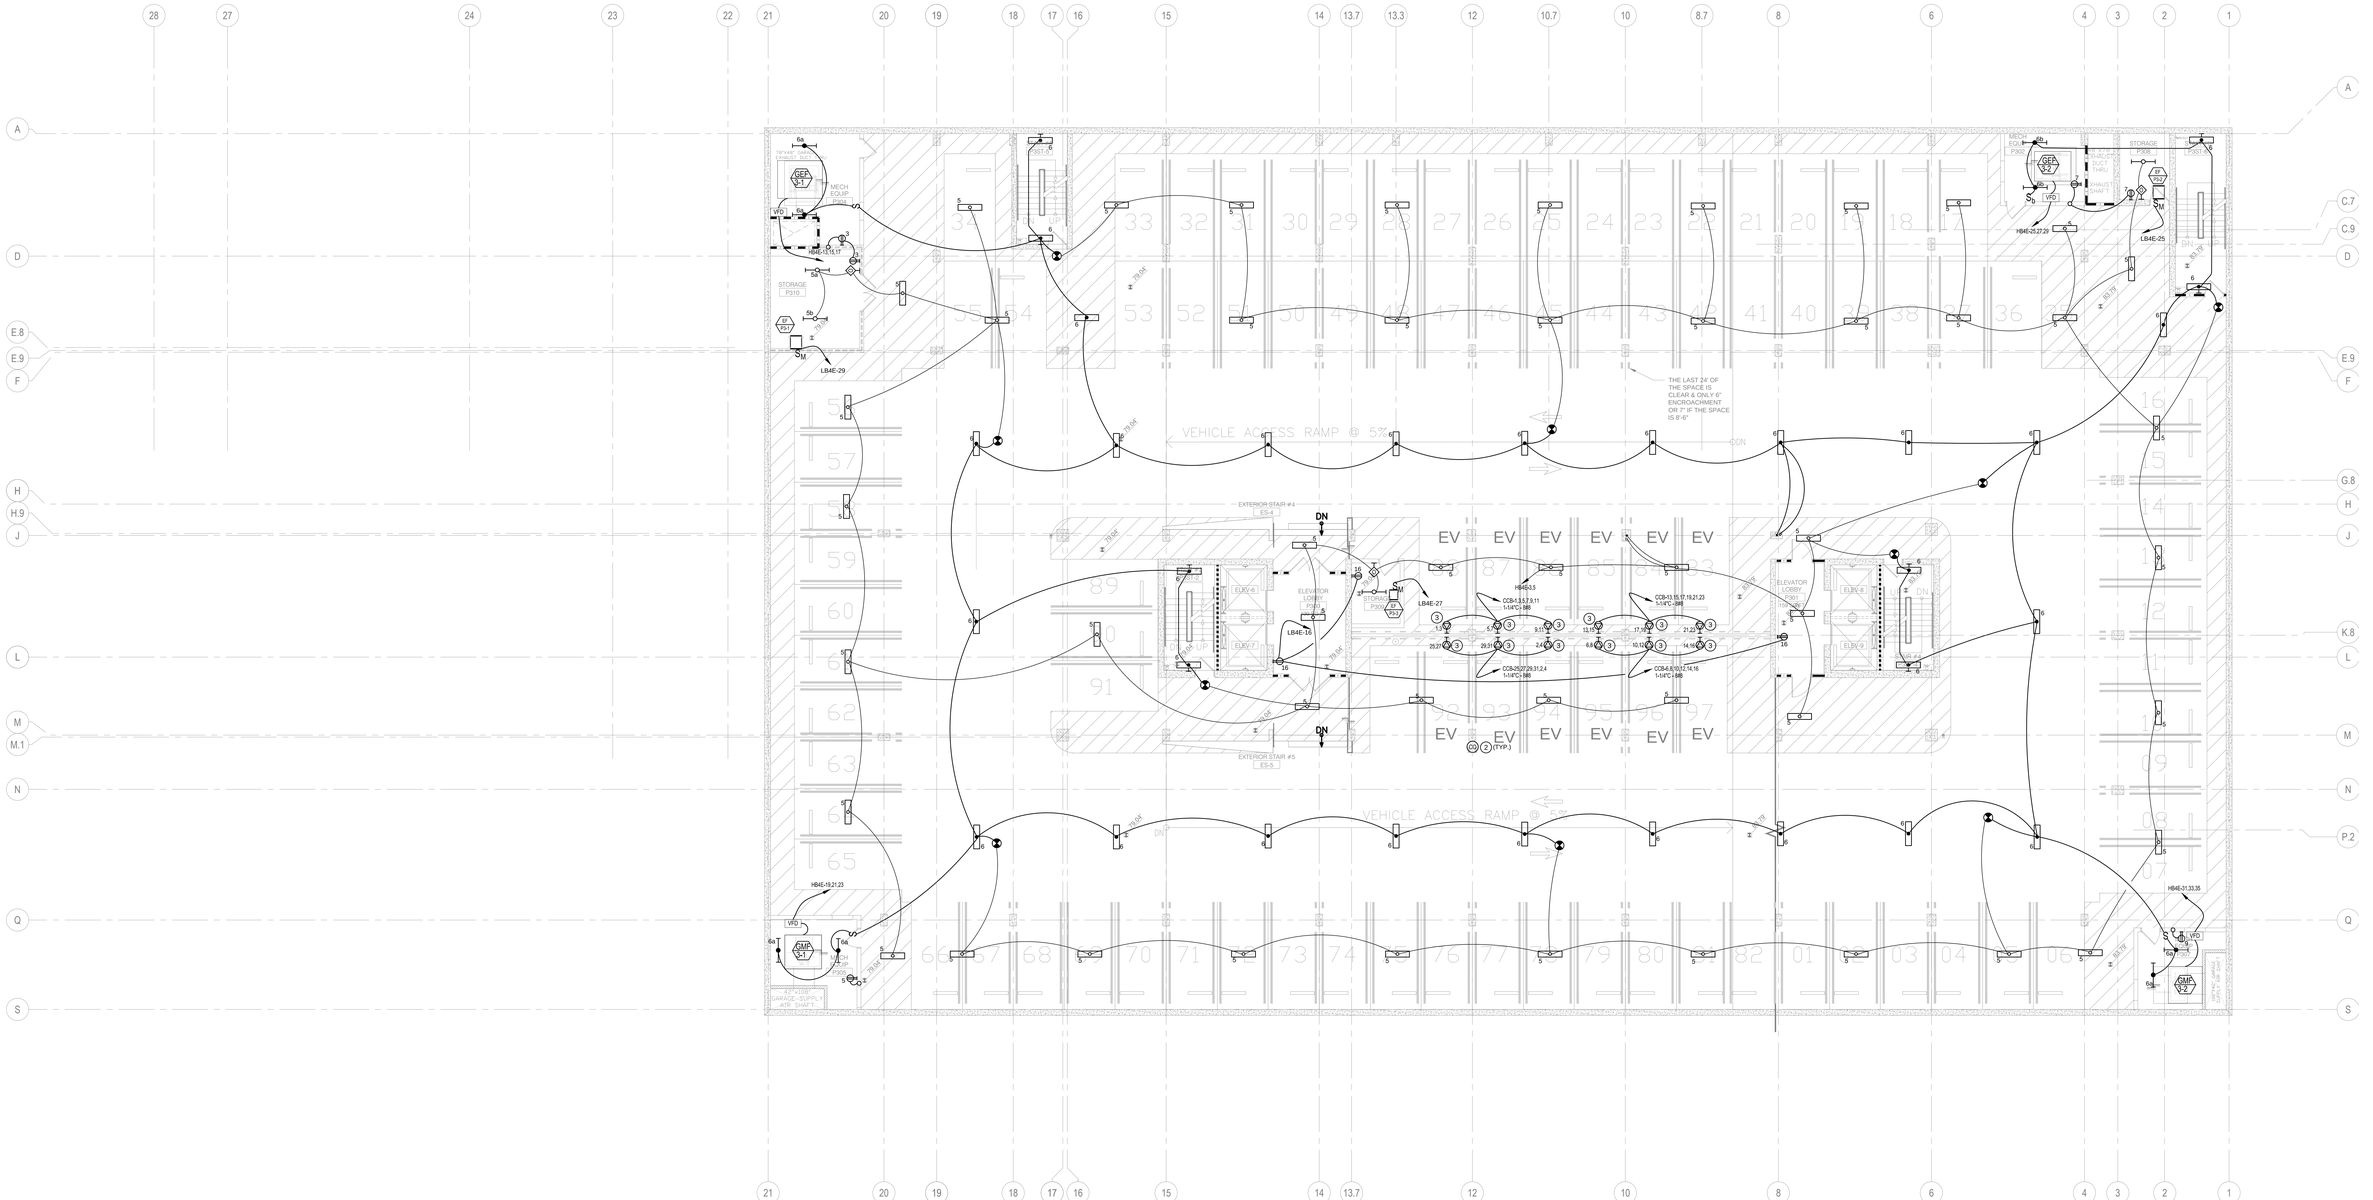

SHEET NOTES:

1. FOR EXACT LOCATION AND CONTROL REQUIREMENTS OF HVAC AND PLUMBING EQUIPMENT REFER TO CORRESPONDING DRAWINGS.

2. PROVIDE EXTRA UNSWITCHED HOT WIRE FOR EXIT SIGNS. LOCATION AND QUANTITY OF EXIT SIGNS SHALL MATCH ARCHITECTURAL DRAWINGS.

KEY NOTES:

1. REFER TO SINGLE LINE DIAGRAM FOR CIRCUIT INFORMATION.
2. CARBON MONOXIDE SENSORS (BY HVAC CONTRACTOR). FOR QUANTITIES AND LOCATION REFER TO HVAC DRAWINGS. INTERCONNECT ALL SENSORS ON THIS PLAN WITH 3/4" CONDUIT AND RUN 1" CONDUIT FROM LAST SENSOR TO CARBON MONOXIDE CONTROL PANEL.
3. PROVIDE ADDITIONAL 1"C TO MPOE AREA ON P1 LEVEL FOR EV CHARGER COMMUNICATIONS

REVISIONS

BY	DATE	DESCRIPTION
-	06/07/2016	Milestone 02
-	06/24/2016	Milestone 03
-	08/04/2016	Milestone 04
-	09/16/2016	Milestone 05
-	10/27/2016	Milestone 05

hla

howard laks architects

1545 twelfth street
santa monica, ca 90401

voice : 310-393-4455
fax : 310-393-2233

CONSULTANTS

Donald P. Dickerson Associates
CONSULTING MECHANICAL & ELECTRICAL ENGINEERS
1800 SOUTH BRAND BOULEVARD, SUITE 404
GLENDALE, CA 91204
TEL: (818) 956-1616
FAX: (818) 956-1845
E-MAIL: DPDA@DPDA.COM
JOB NO. 201225

710 WILSHIRE BOULEVARD

MIXED-USE HOTEL PROJECT
SANTA MONICA - CALIFORNIA 90401

PARKING FLOOR PLAN - P3

DRAWN --
CHECKED --
APPROVED --
SCALE 1/8" = 1'-0"
SHEET E-203
DATE June 25, 2013
PROJECT NUMBER HLA 0000000-00000