
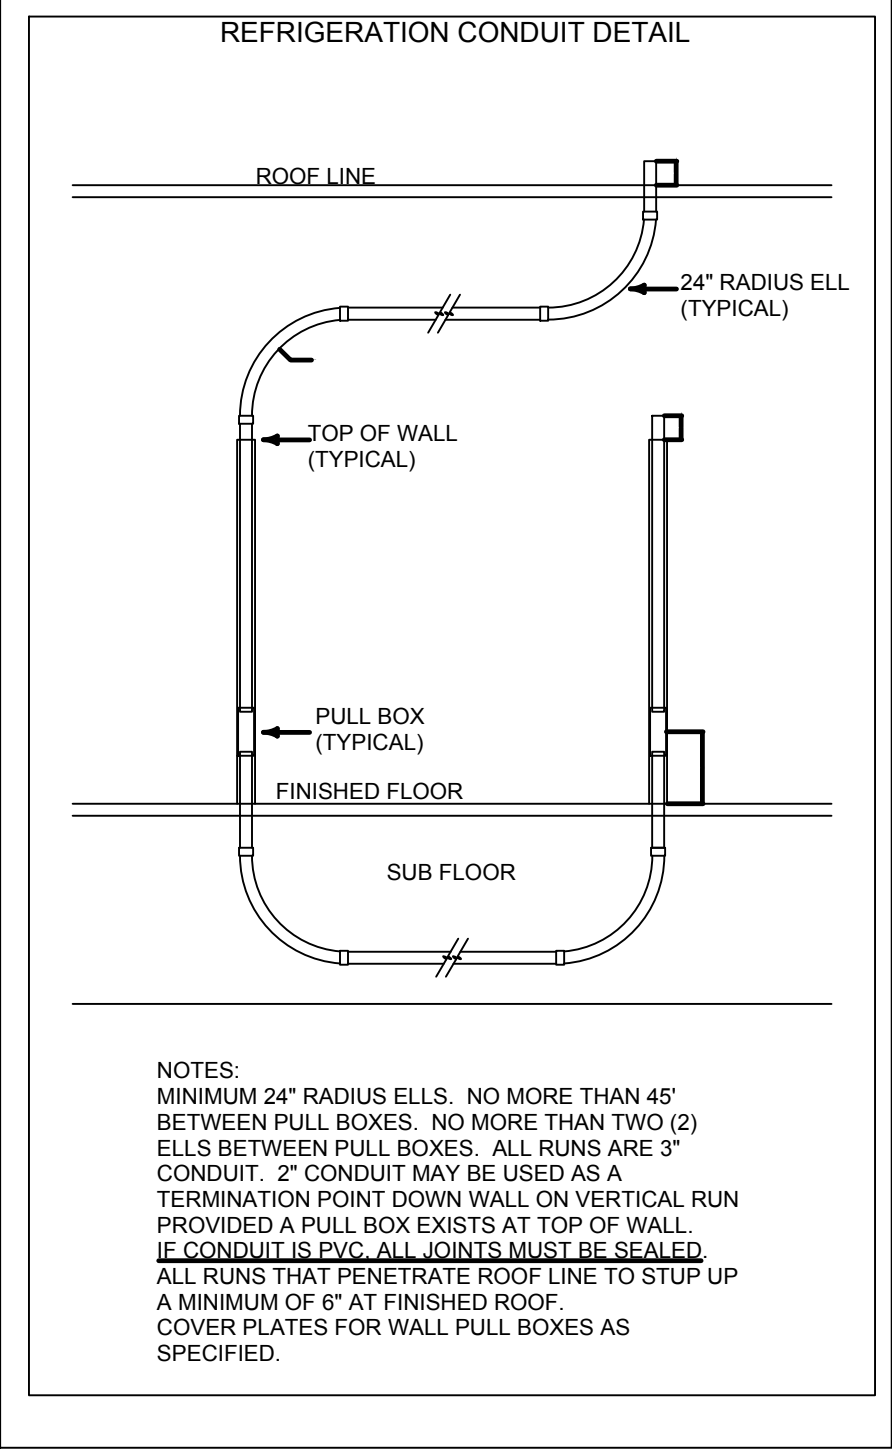


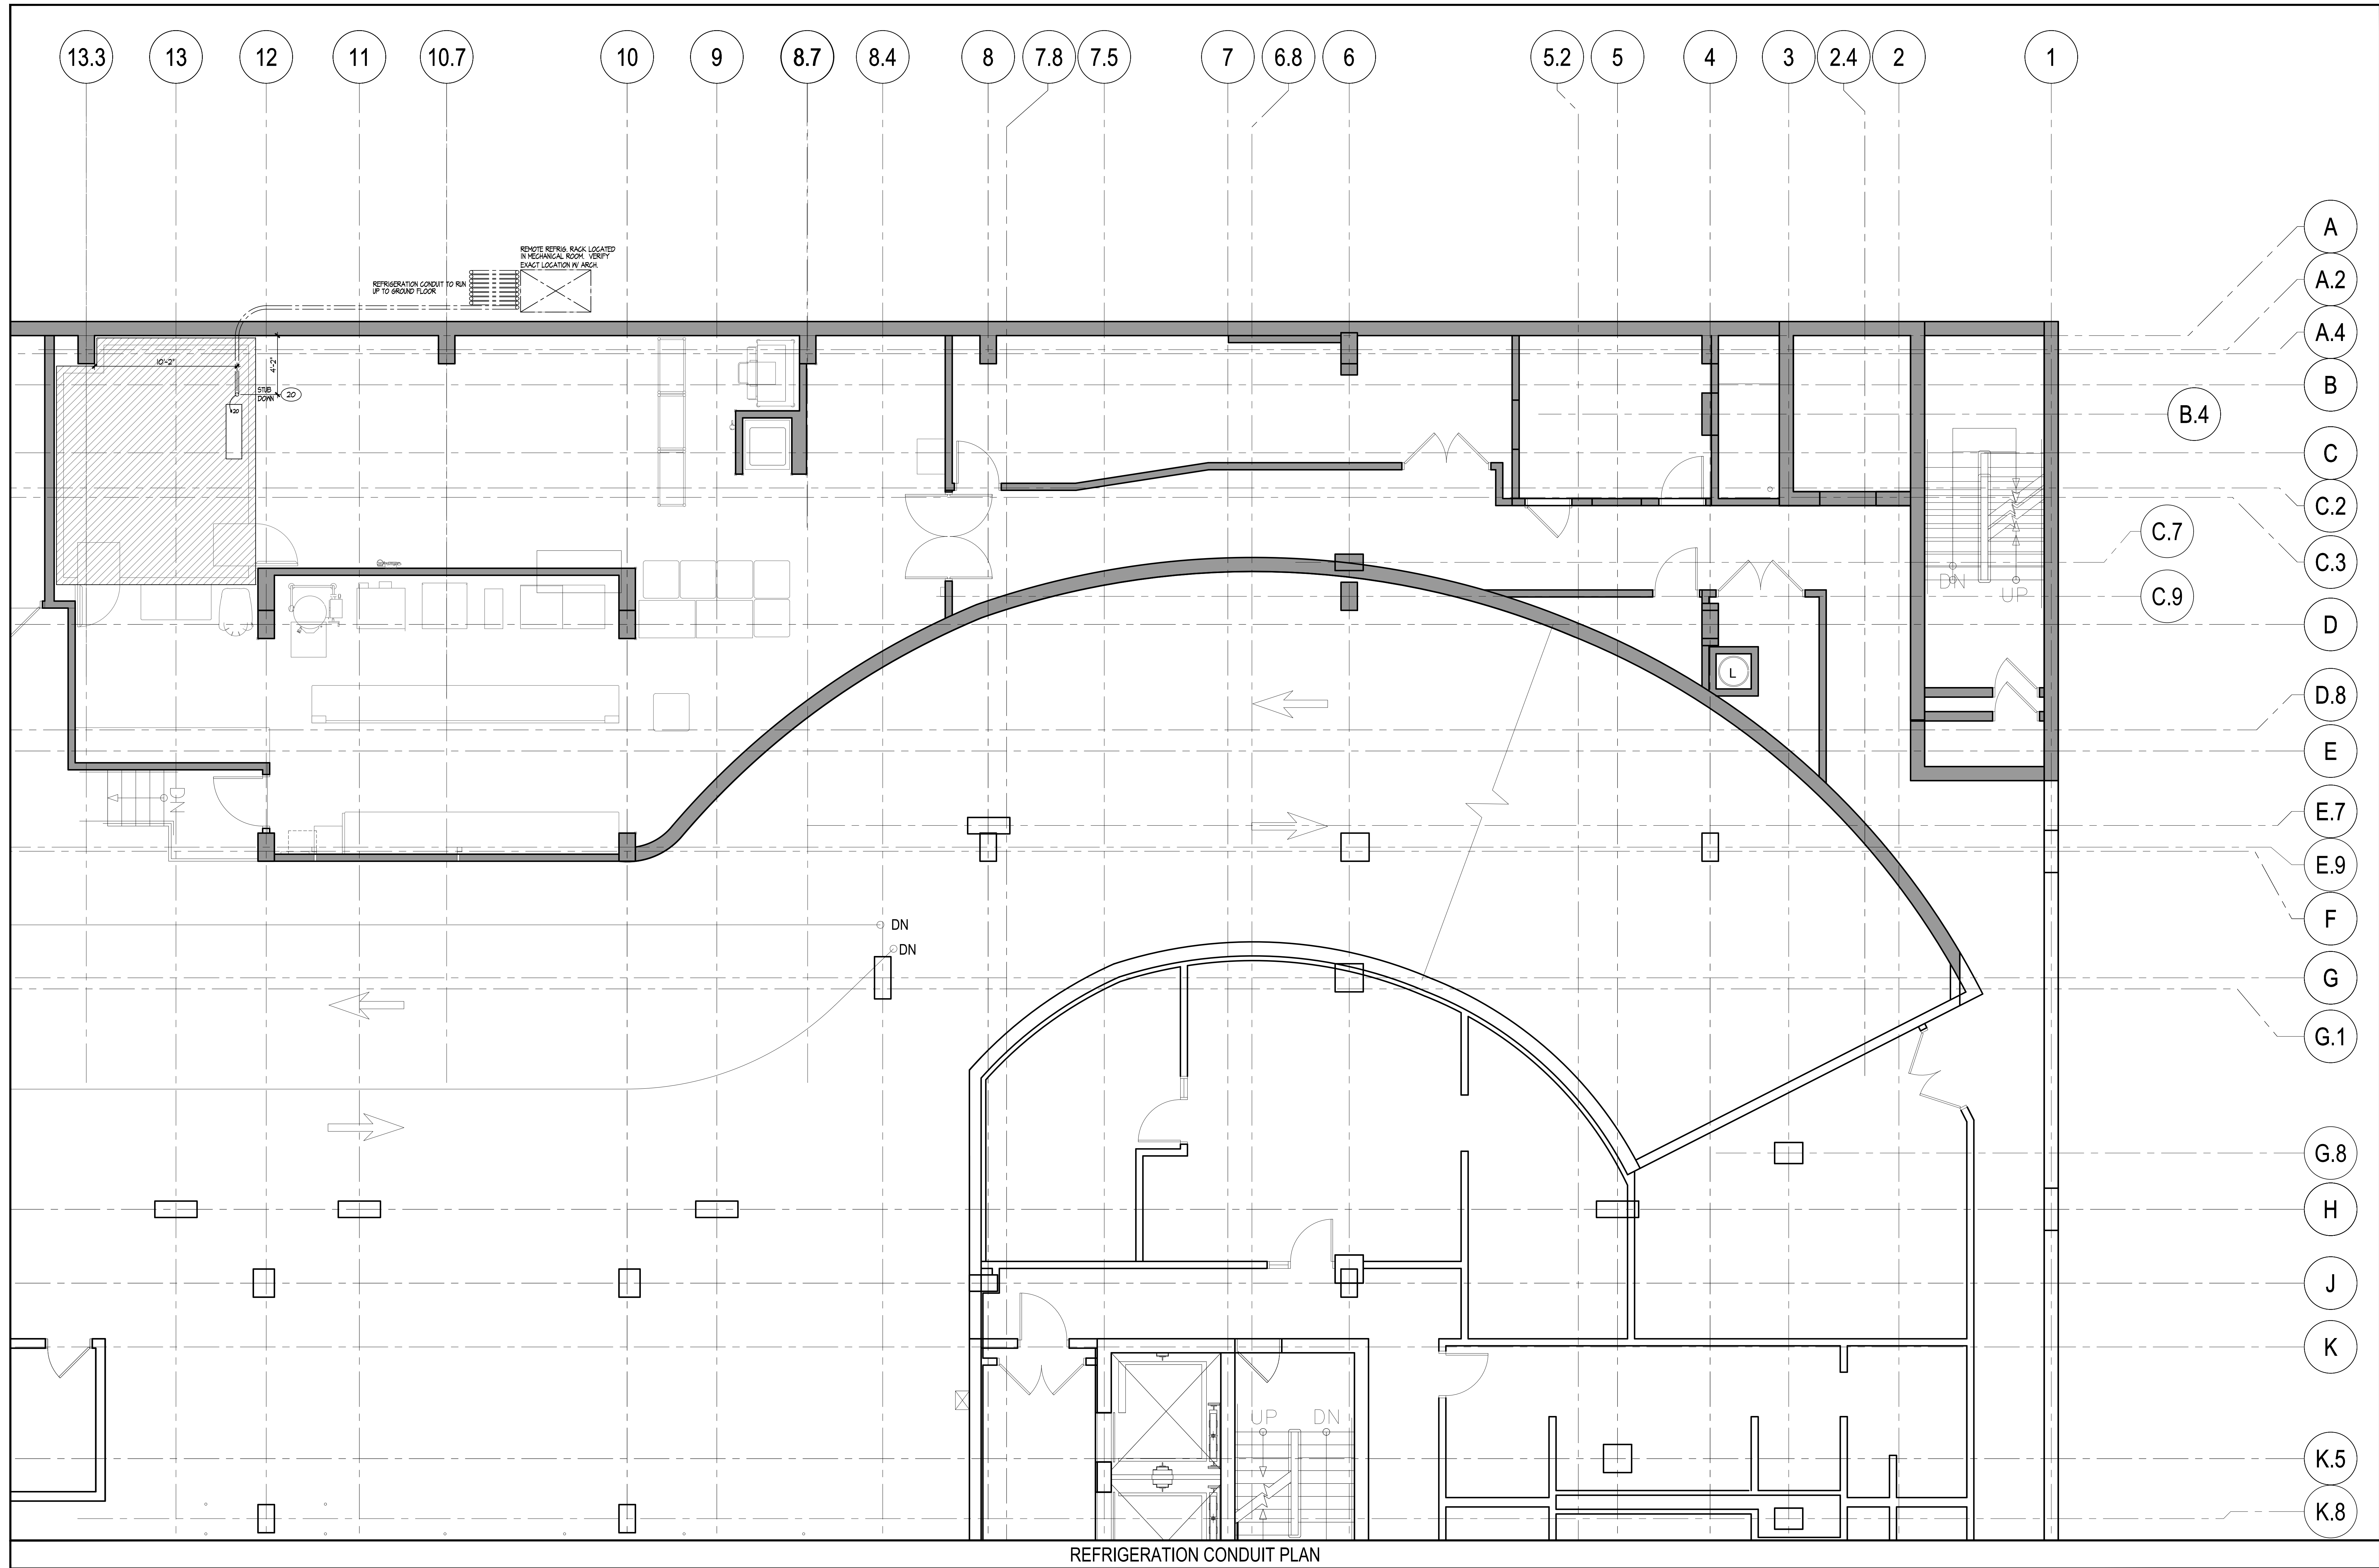

CONDUIT LEGEND	
---	1/2" DIA. CONDUIT LINES FOR REMOTE REFRIGERATION TO RUN UNDERGROUND TO PULLBOX / SUB-UP LOCATIONS AS SHOWN ON PLAN, W/ 24" R. MIN. BENDS.
---	1/2" DIA. CONDUIT LINES FOR REMOTE REFRIGERATION TO RUN OVERHEAD TO PULLBOX / SUB-DOWN LOCATIONS AS SHOWN ON PLAN, W/ 24" R. MIN. BENDS.
---	1/2" DIA. CONDUIT FOR POS LINES TO RUN UNDERGROUND TO PULLBOX / SUB-UP LOCATIONS AS SHOWN ON PLAN, W/ 24" R. MIN. BENDS.
---	1/2" DIA. CONDUIT FOR POS LINES TO RUN OVERHEAD TO PULLBOX / SUB-DOWN LOCATIONS AS SHOWN ON PLAN, W/ 24" R. MIN. BENDS.
---	1/2" DIA. CONDUIT FOR BEER LINES TO RUN UNDERGROUND TO PULLBOX / SUB-UP LOCATIONS AS SHOWN ON PLAN, W/ 24" R. MIN. BENDS.
---	1/2" DIA. CONDUIT FOR BEER LINES TO RUN OVERHEAD TO PULLBOX / SUB-DOWN LOCATIONS AS SHOWN ON PLAN, W/ 24" R. MIN. BENDS.
* LINE RUNS SHOWN ARE FOR INFORMATIVE PURPOSES ONLY. LINES TO RUN THE SHORTEST DISTANCE POSSIBLE ALLOWED BY FIELD CONDITIONS.	

REVISION	DATE	DESCRIPTION
1	06/07/2013	Medium 02
2	06/07/2013	Medium 03
3	06/07/2013	Medium 04
4	06/07/2013	Medium 05

hla
howard laks architects
1545 health street
santa monica, ca 90401
voice : 310-393-4465
fax : 310-393-2230

Kitchen Professionals
16742 Concord Street, Suite 103
Huntington Beach, Ca 92647
Phone: 714.841.0531 Fax: 714.441.9986

710 WILSHIRE BOULEVARD
MIXED-USE HOTEL PROJECT
SANTA MONICA - CALIFORNIA 90401
MAIN KITCHEN REFRIGERATION CONDUIT PLAN

DRAWN: JL
CHECKED: CH
APPROVED: -
SCALE: 1/4" = 1'-0"
SHEET: K-0.5.1
DATE: June 25, 2013
PROJECT NUMBER: HLA 0000000-00000