



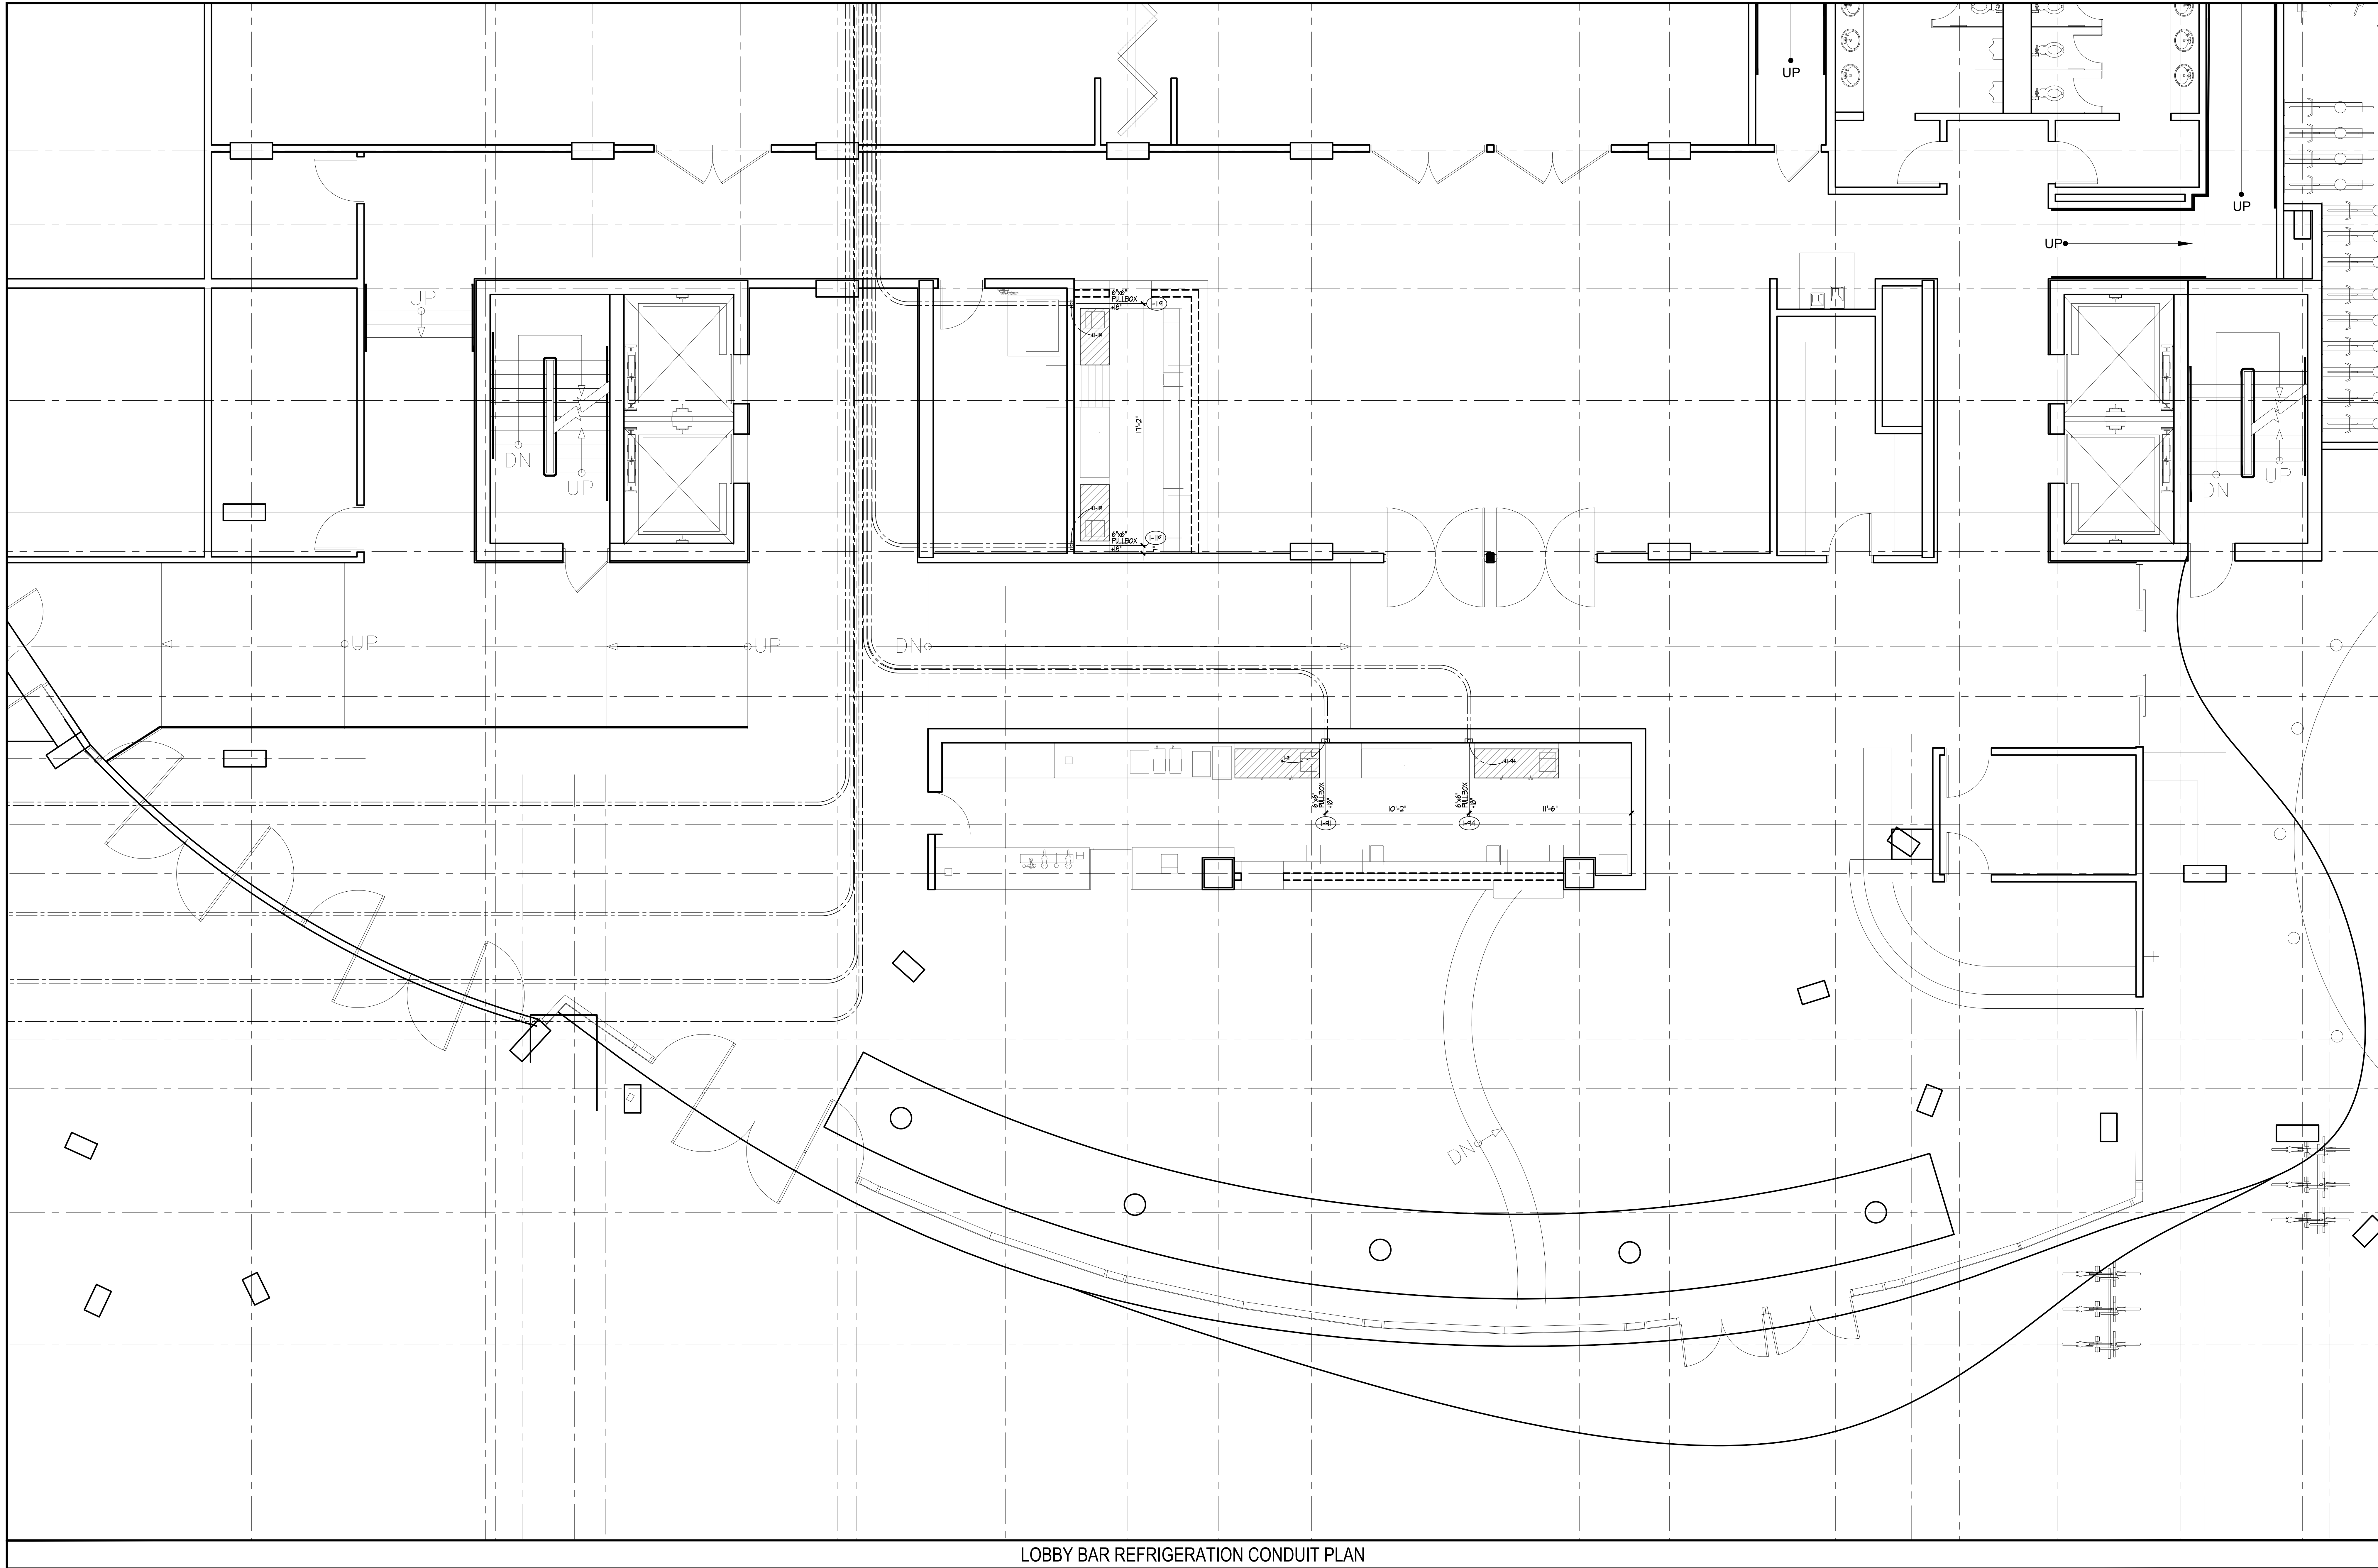

LOBBY BAR REFRIGERATION CONDUIT PLAN

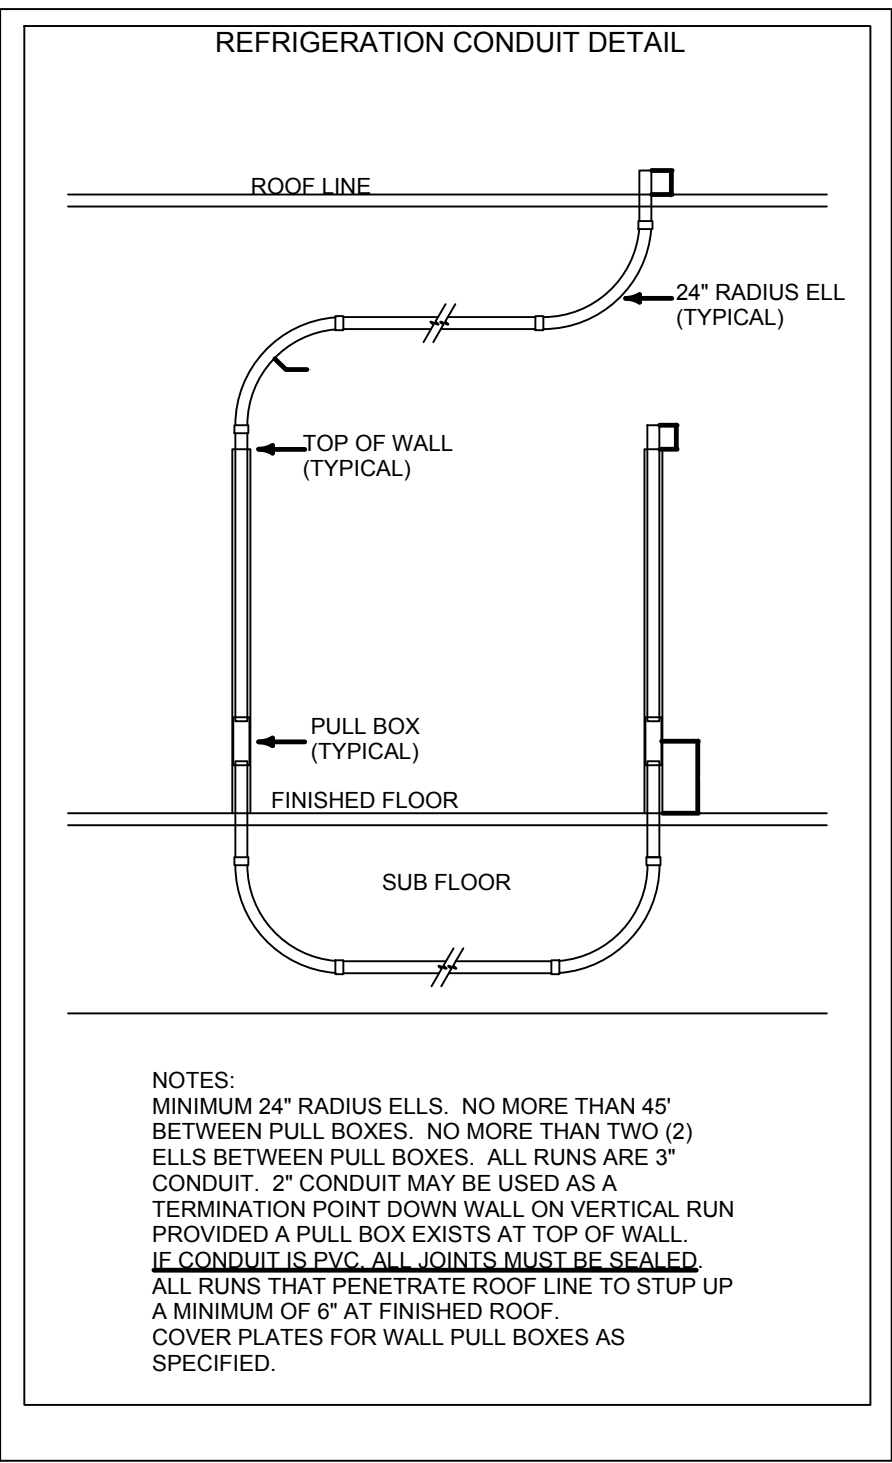

NOTES:
MINIMUM 24" RADIUS ELLS. NO MORE THAN 45°
BETWEEN PULL BOXES. NO MORE THAN TWO (2)
ELLs BETWEEN PULL BOXES. ALL RUNS ARE 3"
CONDUIT. 2" CONDUIT MAY BE USED AS A
TERMINATION POINT DOWN WALL ON VERTICAL RUN
PROVIDED A PULL BOX EXISTS AT TOP OF WALL.
IF CONDUITS DWG. ALL JOINTS MUST BE SEALED.
ALL RUNS THAT PENETRATE ROOF LINE TO STUP UP
A MINIMUM OF 6" AT FINISHED ROOF.
COVER PLATES FOR WALL PULL BOXES AS
SPECIFIED.

CONDUIT LEGEND

=====	3" DIA. CONDUIT LINES FOR REMOTE REFRIGERATION TO RUN UNDERGROUND TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
=====	3" DIA. CONDUIT LINES FOR REMOTE REFRIGERATION TO RUN OVERHEAD TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
=====	6" DIA. CONDUIT FOR SOGA LINES TO RUN UNDERGROUND TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
=====	6" DIA. CONDUIT FOR SOGA LINES TO RUN OVERHEAD TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
=====	1" DIA. CONDUIT FOR POS LINES TO RUN UNDERGROUND TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
=====	1" DIA. CONDUIT FOR POS LINES TO RUN OVERHEAD TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
=====	6" DIA. CONDUIT FOR BEER LINES TO RUN UNDERGROUND TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
=====	6" DIA. CONDUIT FOR BEER LINES TO RUN OVERHEAD TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
* LINE RUNS SHOWN ARE FOR INFORMATION PURPOSES ONLY. LINES TO RUN THE SHORTEST DISTANCE POSSIBLE ALLOWED BY FIELD CONDITIONS.	

REVISION	DATE	DESCRIPTION
1	06/07/2013	MECHANICAL
2	06/04/2013	MECHANICAL
3	06/04/2013	MECHANICAL
4	06/04/2013	MECHANICAL
5	06/07/2013	MECHANICAL

hla
howard laks architects
1545 health street
santa monica, ca 90401
voice : 310-393-4465
fax : 310-393-2230

CONSULTANTS
Kitchen Professionals
16742 Canyon Street, Suite 103
Huntington Beach, Ca 92647
Phone: 714.841.0531 Fax: 714.541.9986

710 WILSHIRE BOULEVARD
MIXED-USE HOTEL PROJECT
SANTA MONICA - CALIFORNIA 90401
LOBBY BAR REFRIGERATION CONDUIT PLAN

DRAWN	JL
CHECKED	CH
APPROVED	-
SCALE	1/4" = 1'-0"
SHEET	K-1.5.2
DATE	June 25, 2013
PROJECT NUMBER	H.A. 0000000-00000