



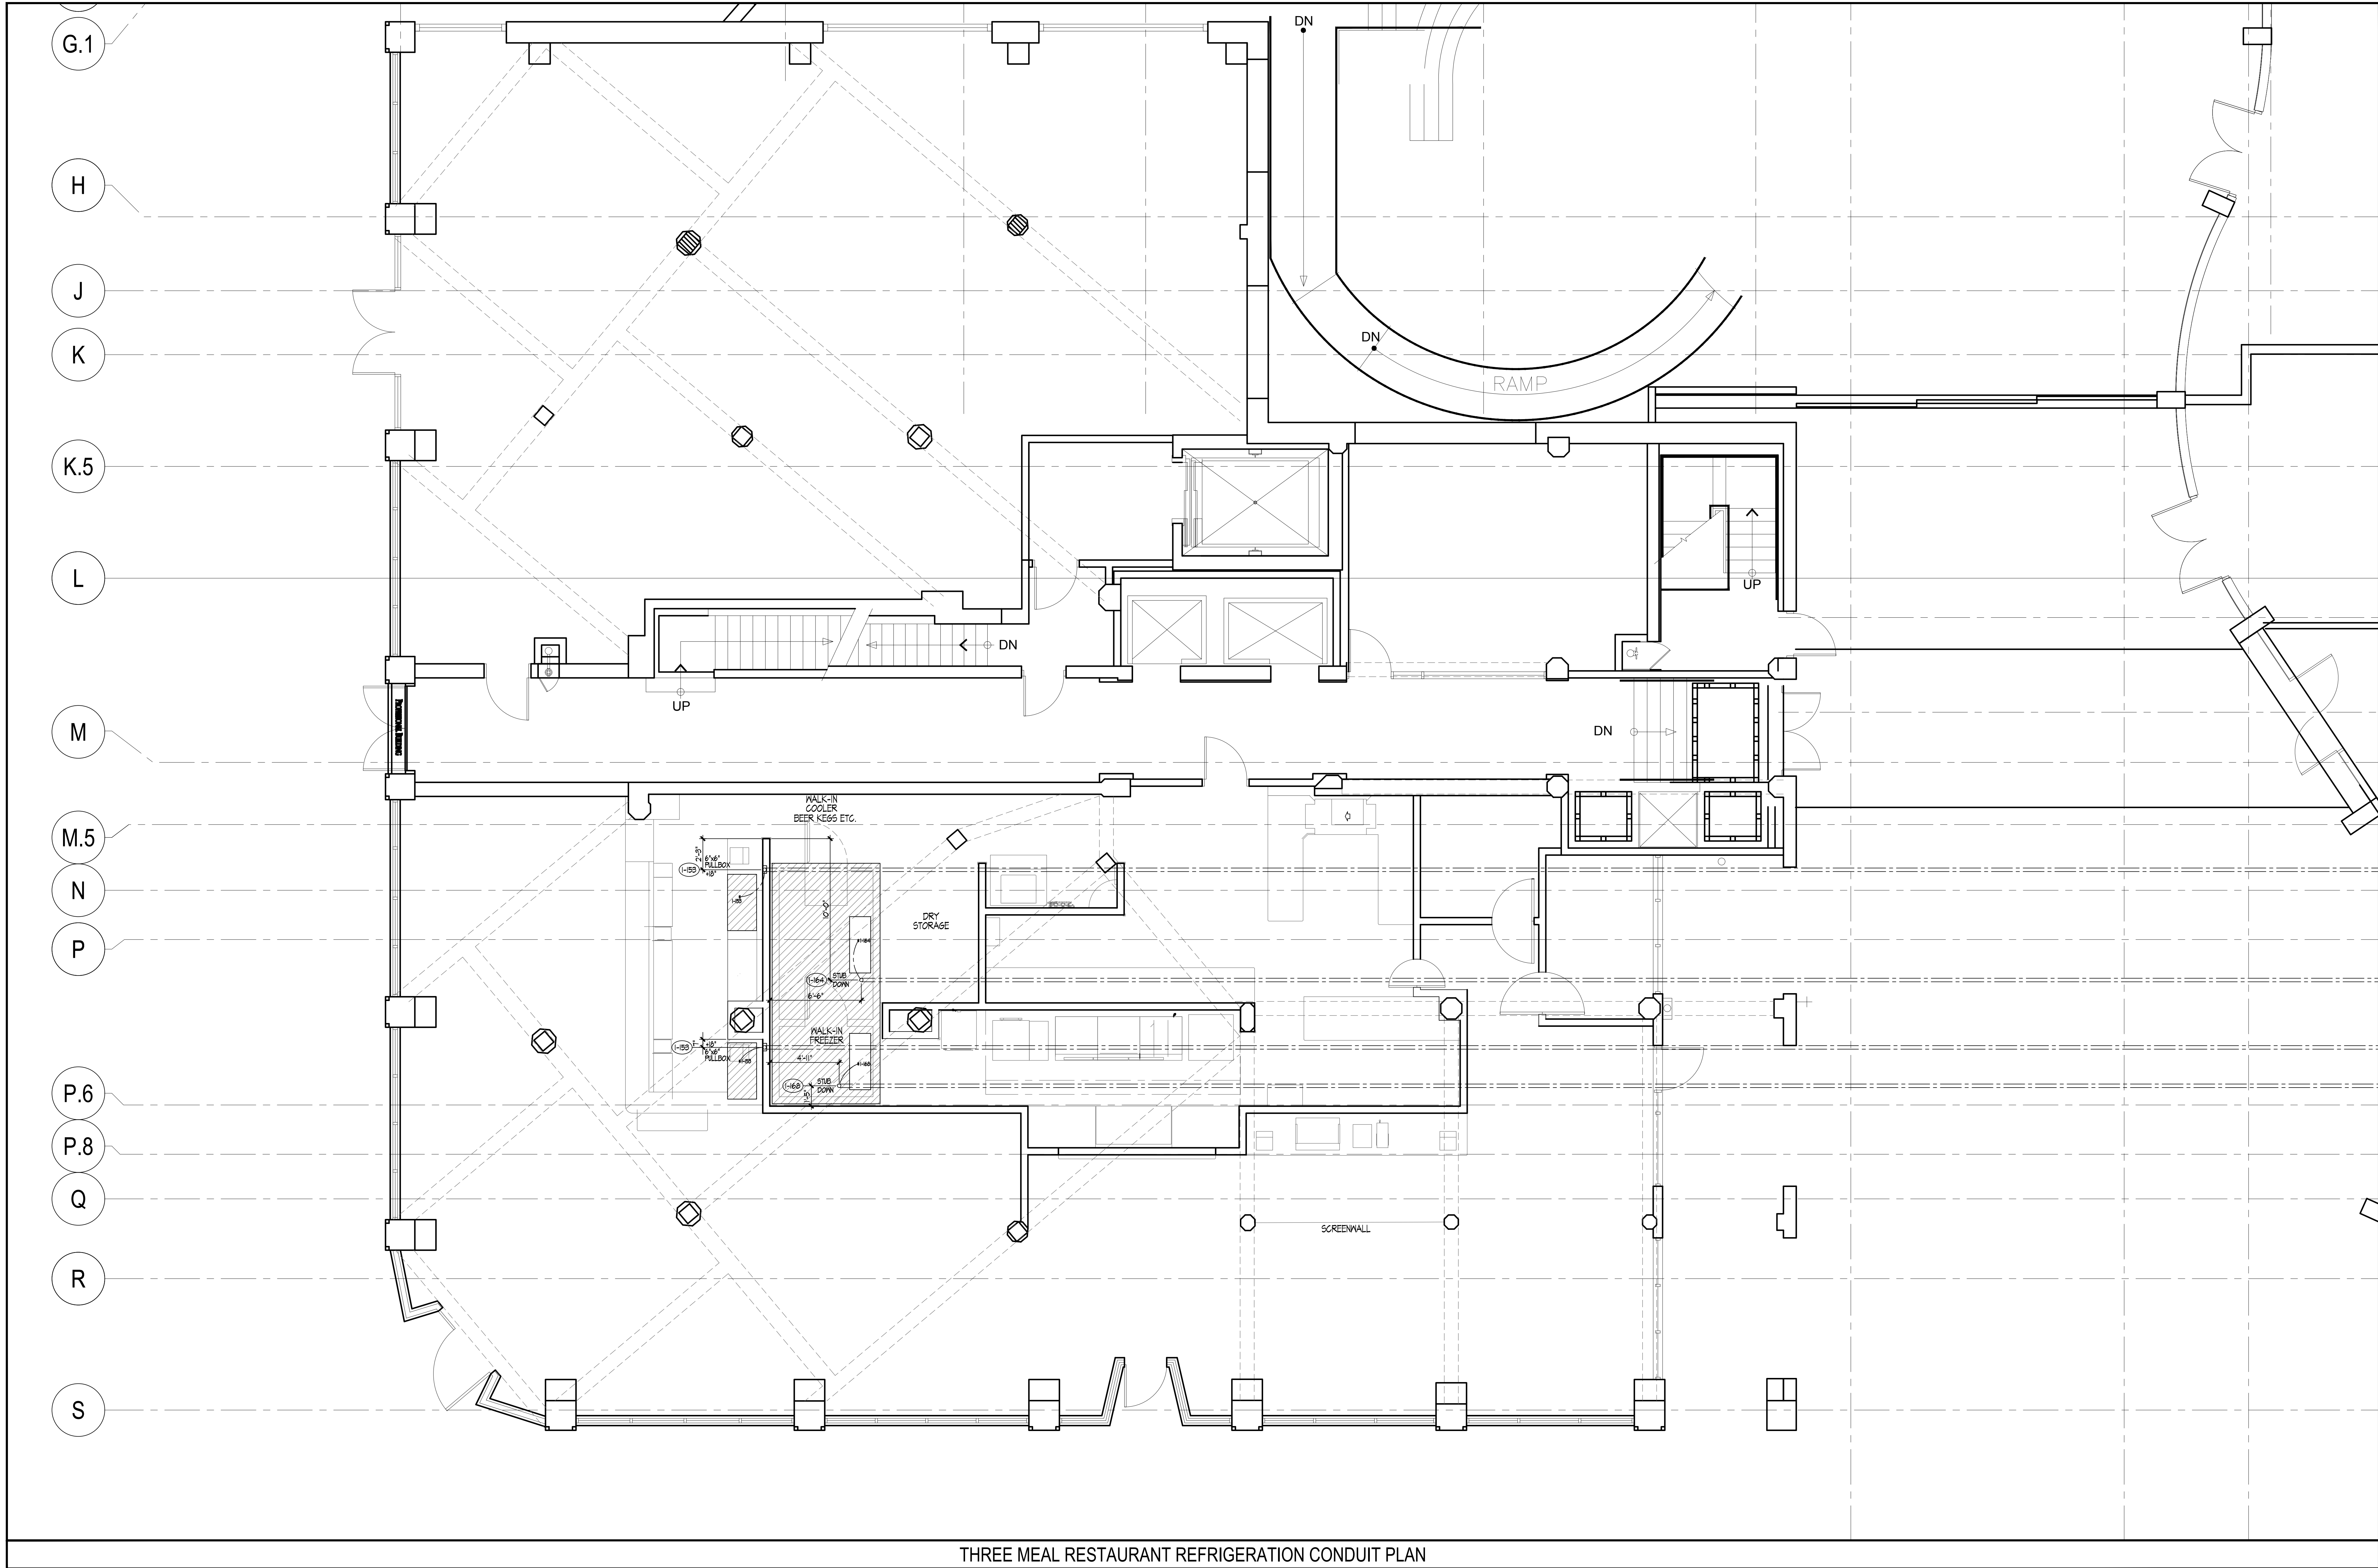

THREE MEAL RESTAURANT REFRIGERATION CONDUIT PLAN

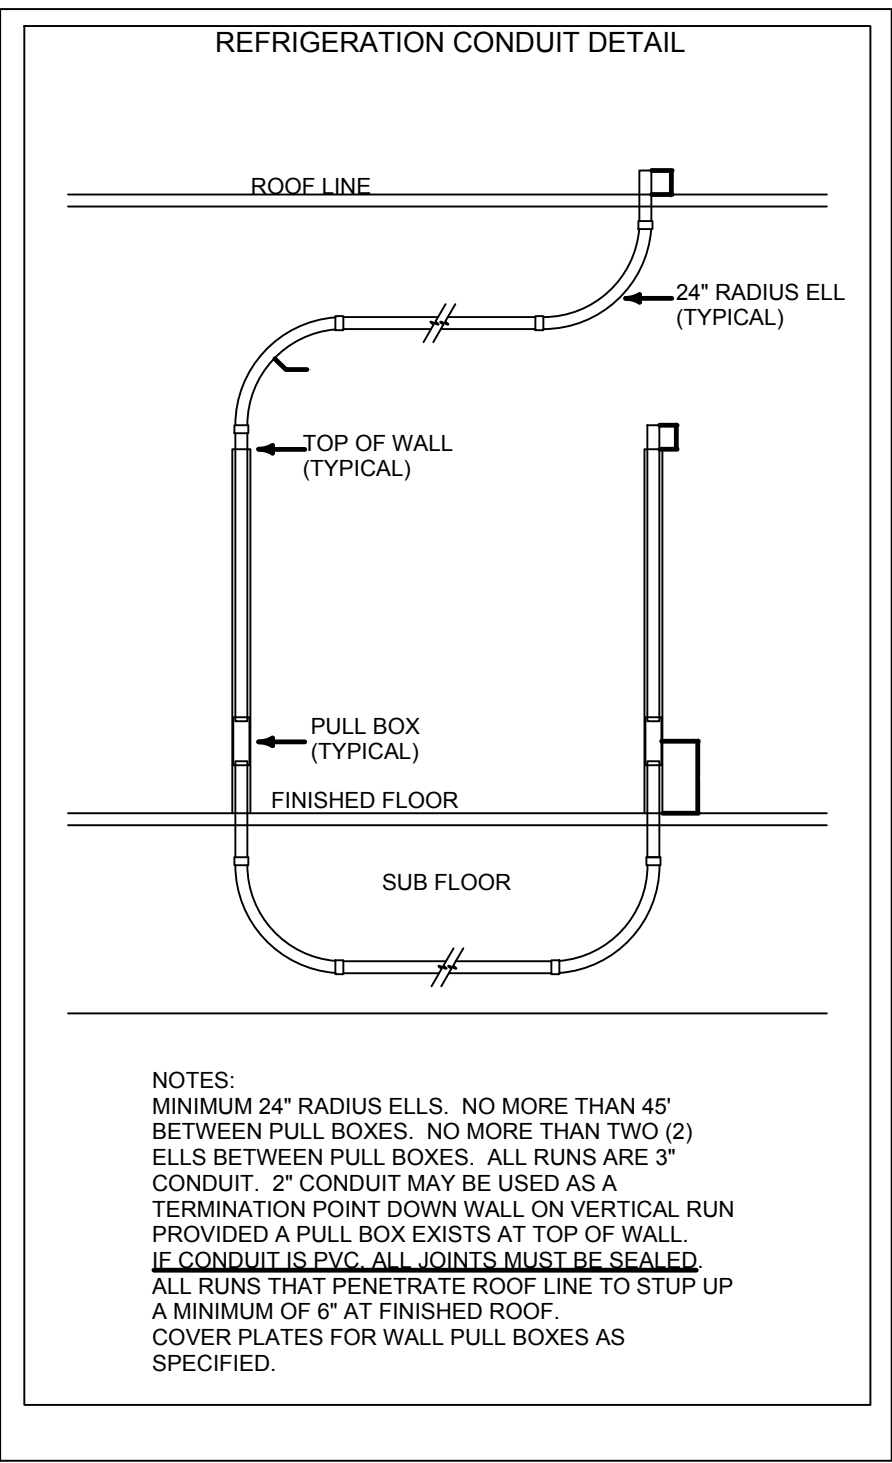

CONDUIT LEGEND	
----	3" DIA. CONDUIT LINES FOR REMOTE REFRIGERATION TO RUN UNDERGROUND TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
----	3" DIA. CONDUIT LINES FOR REMOTE REFRIGERATION TO RUN OVERHEAD TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
----	6" DIA. CONDUIT FOR SODA LINES TO RUN UNDERGROUND TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
----	6" DIA. CONDUIT FOR SODA LINES TO RUN OVERHEAD TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
----	1" DIA. CONDUIT FOR POS LINES TO RUN UNDERGROUND TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
----	1" DIA. CONDUIT FOR POS LINES TO RUN OVERHEAD TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
----	6" DIA. CONDUIT FOR BEER LINES TO RUN UNDERGROUND TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
----	6" DIA. CONDUIT FOR BEER LINES TO RUN OVERHEAD TO PULLBOX/ STUB-UP LOCATIONS AS SHOWN ON PLAN. W/ 24" R. MIN. BENDS.
* LINE RUNS SHOWN ARE FOR INFORMATION PURPOSES ONLY. LINES TO RUN THE SHORTEST DISTANCE POSSIBLE ALLOWED BY FIELD CONDITIONS.	

REVISION	DATE	DESCRIPTION
1	06/07/2013	MEASUREMENT
2	06/07/2013	MEASUREMENT
3	06/07/2013	MEASUREMENT
4	06/07/2013	MEASUREMENT
5	06/07/2013	MEASUREMENT

hla
howard laks architects
1545 health street
santa monica, ca 90401
voice : 310-393-4465
fax : 310-393-2220

Kitchen Professionals
18742 Concord Street, Suite 103
Huntington Beach, Ca 92647
Phone: 714.841.0531 Fax: 714.441.9986

710 WILSHIRE BOULEVARD
MIXED-USE HOTEL PROJECT
SANTA MONICA - CALIFORNIA 90401
THREE MEAL RESTAURANT REFRIGERATION CONDUIT PLAN

DRAWN	JL
CHECKED	CH
APPROVED	-
SCALE	1/4" = 1'-0"
SHEET	K-1.5.3
DATE	June 25, 2013
PROJECT NUMBER	H.A. 0000000-00000